


OIL ANALYSIS REPORT



Machine Id

KAESER 8060071 (S/N 1786) Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Junž023 Novž023 May2024					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC91198	KC06017408	KC103136
Sample Date		Client Info		29 May 2024	23 Nov 2023	13 Jun 2023
Machine Age	hrs	Client Info		23767	19338	15376
Oil Age	hrs	Client Info		4429	0	4245
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	11	4
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	64	5	78
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	60	27	78
Calcium	ppm	ASTM D5185m	2	1	0	3
Phosphorus	ppm	ASTM D5185m		0	0	3
Zinc	ppm	ASTM D5185m		0	21	3
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		29	14	37
Potassium	ppm	ASTM D5185m	>20	4	<1	6
Water	%	ASTM D6304	>0.05	0.027	0.012	0.021
ppm Water	ppm	ASTM D6304	>500	272	129	218.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2374	3502	30765
Particles >6µm		ASTM D7647	>1300	833	741	<u> </u>
Particles >14µm		ASTM D7647	>80	44	38	▲ 899
Particles >21µm		ASTM D7647	>20	6	9	▲ 182
Particles >38μm		ASTM D7647	>4	0	0	<u> </u>
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13	19/17/12	<u>22/21/17</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.34	0.38



OIL ANALYSIS REPORT

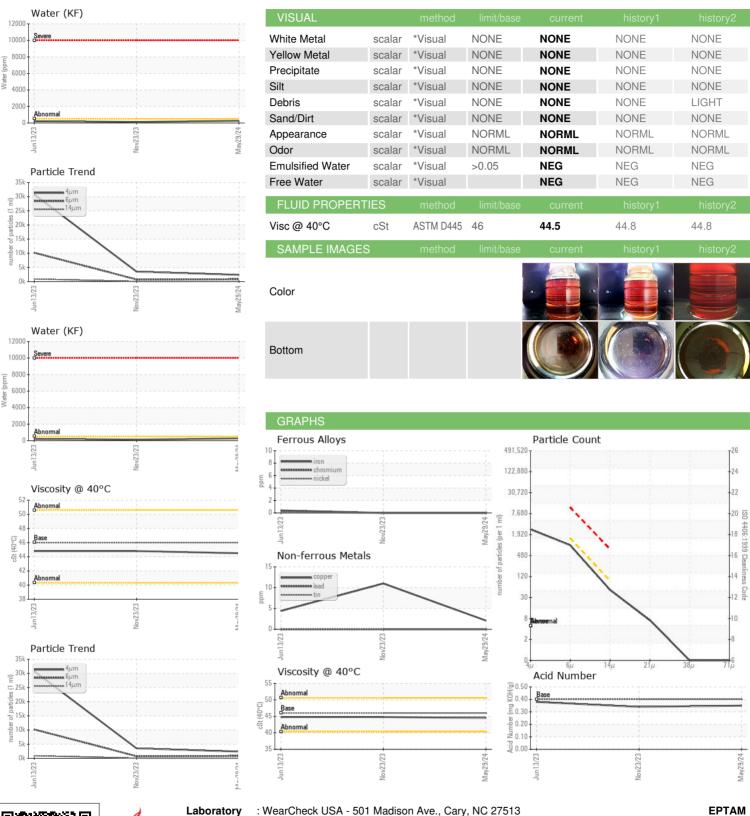





Certificate 12367

Sample No. Lab Number

: KC91198 : 06219717 Unique Number : 11097914 Test Package : IND 2

Received : 25 Jun 2024 **Tested** : 26 Jun 2024

Diagnosed

: 26 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - EPTPHI

65 HOWARD ST

US 08865

T:

F:

PHILLIPSBURG, NJ

Contact: Service Manager