


# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# 8494421 (S/N 1035)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar202	3 May <sup>2</sup> 023	Apr2024 J	ın2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP27173	KCP27881	KC112210
Sample Date		Client Info		18 Jun 2024	24 Apr 2024	09 May 2023
Machine Age	hrs	Client Info		9990	8856	3351
Oil Age	hrs	Client Info		1500	2500	3351
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	2
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	1
Copper	ppm	ASTM D5185m	>50	2	2	2
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	92	86	72
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	85	83	93
Calcium	ppm	ASTM D5185m	2	2	2	4
Phosphorus	ppm	ASTM D5185m		7	15	2
Zinc	ppm	ASTM D5185m		0	2	0
Sulfur	ppm	ASTM D5185m		19309	18753	20426
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	2
Sodium	ppm	ASTM D5185m		24	20	14
Potassium	ppm	ASTM D5185m	>20	2	0	4
Water	%	ASTM D6304	>0.05	0.019	0.014	0.030
ppm Water	ppm	ASTM D6304	>500	196	145	308.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5181	17560	
Particles >6μm		ASTM D7647	>1300	<u> </u>	<b>△</b> 5493	
Particles >14µm		ASTM D7647	>80	<b>83</b>	<b>▲</b> 382	
Particles >21µm		ASTM D7647	>20	10	<u>113</u>	
Particles >38µm		ASTM D7647	>4	1	<u> </u>	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/18/14</b>	<u>\$\text{21/20/16}\$</u>	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
A si al Niversala au (ANI)	I/OII/-	ACTM DODAE	0.4	0.25	0.00	0.00

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.33

0.35

0.38



## **OIL ANALYSIS REPORT**

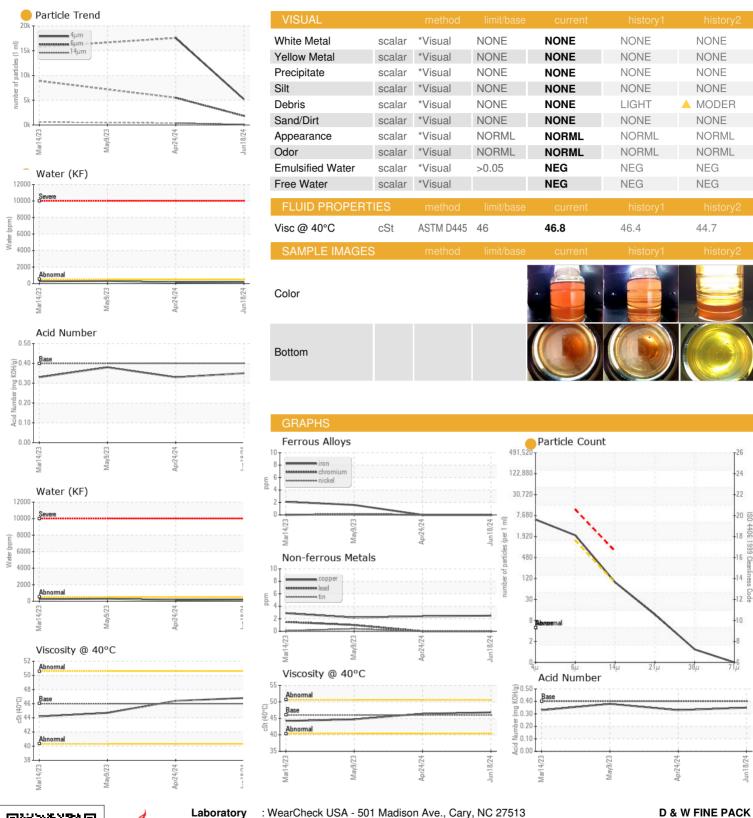





Laboratory Sample No.

Lab Number Unique Number : 11097918

: KCP27173 : 06219721

Received

**Tested** : 26 Jun 2024 Diagnosed

: 26 Jun 2024 - Don Baldridge

: 25 Jun 2024

1372 N OLD LAURENS RD FOUNTAIN INN, SC US 29644

Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: