


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 9000020

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
SAMPLE INFORM	MATION	method				history2
Sample Number		Client Info		KC129146		
Sample Date		Client Info		10 Jun 2024		
Machine Age	hrs	Client Info		719		
Oil Age	hrs	Client Info		719		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum		ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
	ppm					
Copper Tin	ppm	ASTM D5185m	>50 >10	2		
	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	56		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		4		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	<i>></i> 20	12		
Potassium		ASTM D5185m	>20	9		
Water	ppm %	ASTM D5165111	>0.05	0.022		
ppm Water	ppm	ASTM D6304	>500	228		
FLUID CLEANLIN	• •				hiotory1	history?
	NESS	method ASTM D7647	limit/base	current 2046	history1	history2
Particles >4µm Particles >6µm		ASTM D7647	>1300	907		
•				40		
Particles >14µm		ASTM D7647	>80			
Particles >21µm		ASTM D7647	>20	5		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/12		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.33



OIL ANALYSIS REPORT

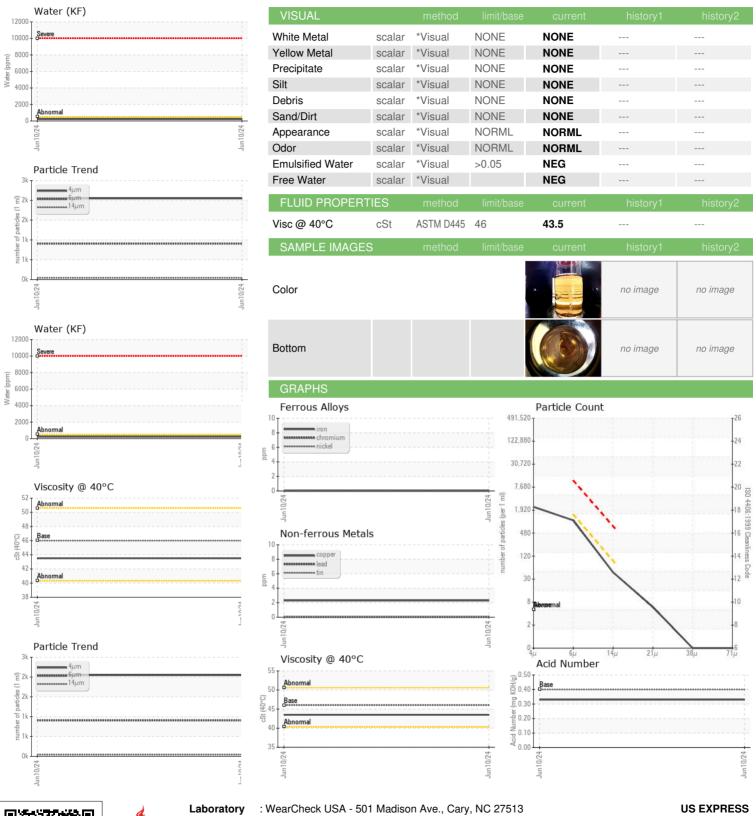





Certificate 12367

Sample No. Lab Number : 06219727 Unique Number : 11097924 Test Package : IND 2

: KC129146

Received : 25 Jun 2024 **Tested** : 26 Jun 2024 Diagnosed : 26 Jun 2024 - Don Baldridge

4815 CRACKERSPORT RD ALLENTOWN, PA

US 18104 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: