


# **OIL ANALYSIS REPORT**

Sample Rating Trend







Machine Id
LSC 3
Component
Screw Compressor
Fluid

**CAMCO 717 HT (--- GAL)** 

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

Moderate concentration of visible dirt/debris present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM  | MATION   | method  | limit/base         | current  | history1   | history2  |
|--|--|---|--------------------|--|--|---|
| Sample Number  |  | Client Info   |                    | WC0887189  | WC0826444  | WC0824936   |
| Sample Date  |  | Client Info   |                    | 22 May 2024  | 23 Nov 2023  | 15 Jun 2023   |
| Machine Age  | hrs  | Client Info   |                    | 55213  | 51906  | 49038   |
| Oil Age  | hrs  | Client Info   |                    | 0  | 0  | 0   |
| Oil Changed  |  | Client Info   |                    | N/A  | N/A  | N/A   |
| Sample Status  |  |   |                    | ABNORMAL   | NORMAL   | NORMAL  |
| WEAR METALS  |  | method  | limit/base         | current  | history1   | history2  |
| Iron   | ppm  | ASTM D5185m   | >60                | 0  | 0  | <1  |
| Chromium   | ppm  | ASTM D5185m   | >4                 | 0  | 0  | 0   |
| Nickel   | ppm  | ASTM D5185m   |                    | 0  | 0  | 0   |
| Titanium   | ppm  | ASTM D5185m   |                    | 0  | 0  | 0   |
| Silver   | ppm  | ASTM D5185m   |                    | 0  | 0  | 0   |
| Aluminum   | ppm  | ASTM D5185m   | >5                 | 0  | 0  | <1  |
| Lead   | ppm  | ASTM D5185m   | >10                | 0  | 0  | 0   |
| Copper   | ppm  | ASTM D5185m   | >30                | 0  | 0  | 0   |
| Tin  | ppm  | ASTM D5185m   | >15                | 0  | <1   | 0   |
| Vanadium   | ppm  | ASTM D5185m   |                    | 0  | 0  | 0   |
| Cadmium  | ppm  | ASTM D5185m   |                    | 0  | 0  | 0   |
|  |  |   |                    |  |  |   |
| ADDITIVES  |  | method  | limit/base         | current  | history1   | history2  |
| ADDITIVES Boron  | ppm  | method ASTM D5185m  | limit/base         | current<br>0   | history1   | history2  |
|  | ppm<br>ppm   |   | limit/base         |  |  |   |
| Boron  |  | ASTM D5185m   | limit/base         | 0  | 0  | 0   |
| Boron<br>Barium  | ppm  | ASTM D5185m<br>ASTM D5185m  | limit/base         | 0<br>0   | 0  | 0   |
| Boron<br>Barium<br>Molybdenum  | ppm<br>ppm   | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m   | limit/base         | 0<br>0<br>0  | 0<br>0<br>0  | 0<br>0<br>0   |
| Boron<br>Barium<br>Molybdenum<br>Manganese   | ppm<br>ppm   | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m  | limit/base         | 0<br>0<br>0  | 0<br>0<br>0<br><1  | 0<br>0<br>0<br><1   |
| Boron<br>Barium<br>Molybdenum<br>Manganese<br>Magnesium  | ppm<br>ppm<br>ppm<br>ppm                             | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m   | limit/base         | 0<br>0<br>0<br>0   | 0<br>0<br>0<br><1<br><1  | 0<br>0<br>0<br><1<br>0  |
| Boron<br>Barium<br>Molybdenum<br>Manganese<br>Magnesium<br>Calcium   | ppm<br>ppm<br>ppm<br>ppm                             | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m  | limit/base         | 0<br>0<br>0<br>0<br>0  | 0<br>0<br>0<br><1<br><1<br>2   | 0<br>0<br>0<br><1<br>0  |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus   | ppm<br>ppm<br>ppm<br>ppm<br>ppm                      | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m   | limit/base         | 0<br>0<br>0<br>0<br>0<br>0   | 0<br>0<br>0<br><1<br><1<br>2   | 0<br>0<br>0<br><1<br>0  |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc  | ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm        | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m  | limit/base         | 0<br>0<br>0<br>0<br>0<br>0<br>0  | 0<br>0<br>0<br><1<br><1<br>2<br>1  | 0<br>0<br>0<br><1<br>0<br>0   |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur   | ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm        | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m   |                    | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0   | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0   | 0<br>0<br>0<br><1<br>0<br>0<br>0                                      |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINANTS                                | ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm        | ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m<br>ASTM D5185m   | limit/base         | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0   | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0<br>1  | 0<br>0<br>0<br><1<br>0<br>0<br>0<br>0<br>0                            |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINANTS                                | ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm | ASTM D5185m   | limit/base         | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>current                            | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0<br>1<br>history1                                  | 0<br>0<br>0<br><1<br>0<br>0<br>0<br>0<br>0<br>history2                |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINANTS Silicon Sodium                 | ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm<br>ppm | ASTM D5185m   | limit/base >50     | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>current                            | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0<br>1<br>history1<br><1                            | 0<br>0<br>0<br>0<br><1<br>0<br>0<br>0<br>0<br>0<br>history2           |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINANTS Silicon Sodium Potassium       | ppm              | ASTM D5185m             | limit/base >50 >20 | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>current<br>0<br>                   | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0<br>1<br>history1<br><1<br><1                      | 0<br>0<br>0<br>0<br><1<br>0<br>0<br>0<br>0<br>0<br>history2           |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINANTS Silicon Sodium Potassium Water | ppm              | ASTM D5185m | limit/base         | 0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>0<br>current<br>0<br><1<br><1<br><1<br>0.002 | 0<br>0<br>0<br><1<br><1<br>2<br>1<br>0<br>1<br>history1<br><1<br><1<br><1<br><1<br>0.001 | 0<br>0<br>0<br>0<br><1<br>0<br>0<br>0<br>0<br>history2<br>0<br>0<br>0 |




## **OIL ANALYSIS REPORT**

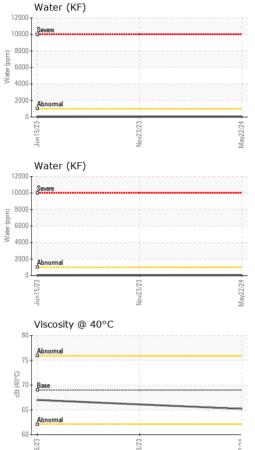


| VISUAL                       |        | method              | limit/base | current         | history1         | history2         |
|------------------------------|--------|---------------------|------------|-----------------|------------------|------------------|
| White Metal                  | scalar | *Visual             | NONE       | NONE            | NONE             | NONE             |
| Yellow Metal                 | scalar | *Visual             | NONE       | NONE            | NONE             | NONE             |
| Precipitate                  | scalar | *Visual             | NONE       | NONE            | NONE             | NONE             |
| Silt                         | scalar | *Visual             | NONE       | NONE            | NONE             | LIGHT            |
| Debris                       | scalar | *Visual             | NONE       | ▲ MODER         | NONE             | NONE             |
| Sand/Dirt                    | scalar | *Visual             | NONE       | NONE            | NONE             | NONE             |
| Appearance                   | scalar | *Visual             | NORML      | NORML           | NORML            | NORML            |
| Odor                         | scalar | *Visual             | NORML      | NORML           | NORML            | NORML            |
| <b>Emulsified Water</b>      | scalar | *Visual             | >0.1       | NEG             | NEG              | NEG              |
| Free Water                   | scalar | *Visual             |            | NEG             | NEG              | NEG              |
|                              |        |                     |            |                 |                  |                  |
| FLUID PROPERT                | IES    | method              | limit/base | current         | history1         | history2         |
| FLUID PROPERT<br>Visc @ 40°C | CSt    | method<br>ASTM D445 | limit/base | current<br>65.2 | history1<br>66.1 | history2<br>67.0 |
|                              | cSt    |                     |            |                 |                  |                  |
| Visc @ 40°C                  | cSt    | ASTM D445           | 69         | 65.2            | 66.1             | 67.0             |



# **GRAPHS** Ferrous Alloys Non-ferrous Metals Viscosity @ 40°C









Certificate 12367

Laboratory Sample No.

: WC0887189 Lab Number : 06219760 Unique Number : 11097957

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 25 Jun 2024 **Tested** Diagnosed

: 26 Jun 2024

: 26 Jun 2024 - Don Baldridge

TRACY, CA US 95376 Contact: DOUG CHITWOOD cchitwood@leprino.com T: (209)835-8340

**LEPRINO FOODS - TRACY** 

2401 MACARTHUR DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 ( Additional Tests: KF )

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (209)835-1826