




# OIL ANALYSIS REPORT

Sample Rating Trend

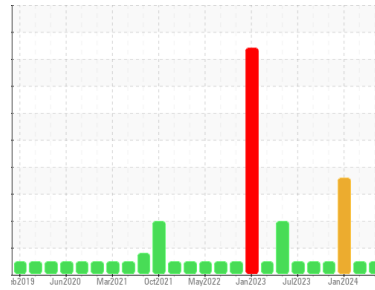

**NORMAL**



Machine Id  
**CTG-100**  
 Component  
**Reservoir Turbine**  
 Fluid  
**MOBIL DTE 732 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0043294</b>	RP0039441	RP0038818
Sample Date	Client Info			<b>24 Jun 2024</b>	07 Mar 2024	11 Jan 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m		<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	1	0
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>1137</b>	989	971
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>2</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	1	<1
Water	%	ASTM D6304	>0.03	<b>0.003</b>	0.001	▲ 0.271
ppm Water	ppm	ASTM D6304	>300	<b>33</b>	10.0	▲ 2710

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<b>295</b>	972	1653
Particles >6µm		ASTM D7647	>640	<b>89</b>	365	● 900
Particles >14µm		ASTM D7647	>80	<b>16</b>	69	● 153
Particles >21µm		ASTM D7647	>20	<b>8</b>	17	● 52
Particles >38µm		ASTM D7647	>4	<b>1</b>	4	● 8
Particles >71µm		ASTM D7647	>3	<b>0</b>	1	● 1
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>15/14/11</b>	17/16/13	● 18/17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	<b>0.047</b>	0.09	0.075


# OIL ANALYSIS REPORT

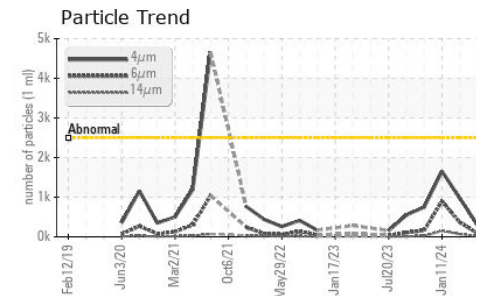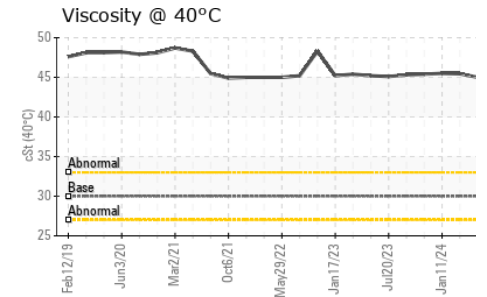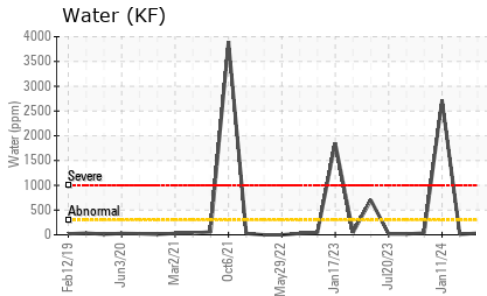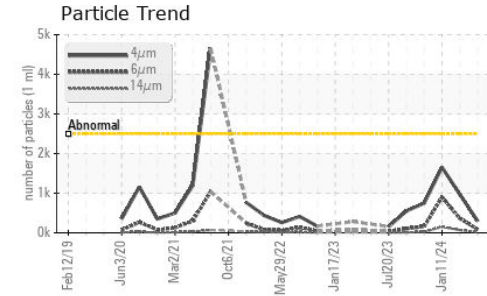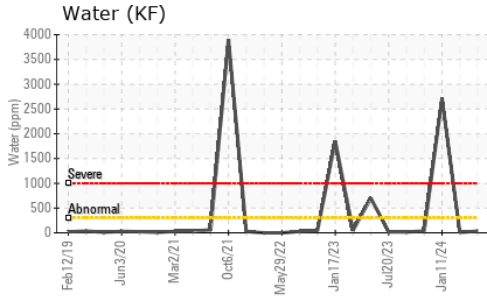

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	30.0	45.0	45.45 / 45.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

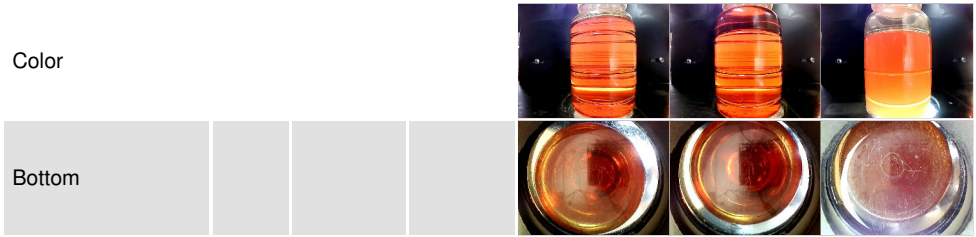


## GRAPHS


### Ferrous Alloys

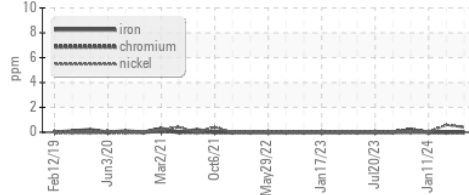


### Non-ferrous Metals

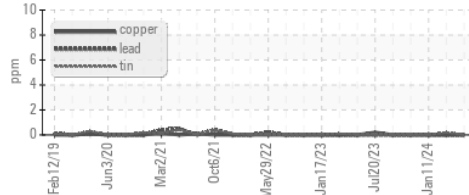


### Viscosity @ 40°C

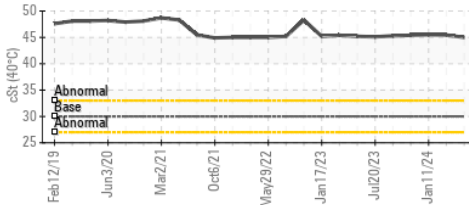

### Particle Count

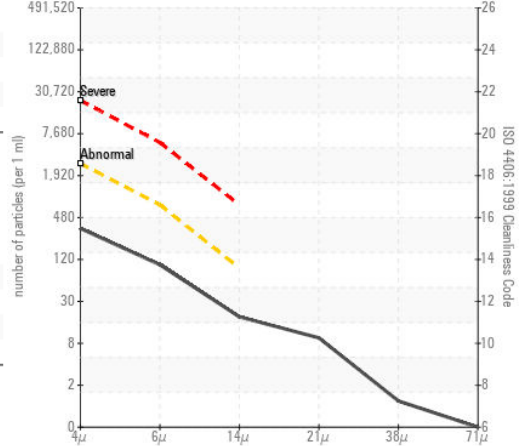

### Acid Number

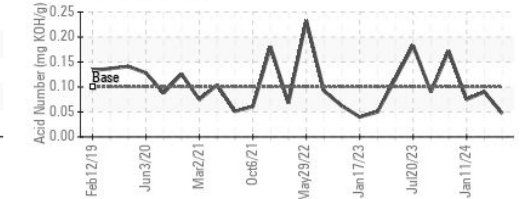

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : RP0043294

Lab Number : 06219771

Unique Number : 11097968

Test Package : IND 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 25 Jun 2024

Tested : 28 Jun 2024

Diagnosed : 28 Jun 2024 - Jonathan Hester

ENGIE-MATEP

474 BROOKLINE AVE

BOSTON, MA

US 02215

Contact: ROBERT ST SAUVEUR

robert.stsauveur@engie.com

T: (401)651-9381

F: