

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id

BUSCH VAC LINE 1 Component Vacuum Pump Fluid BUSCH VM 100 (5 QTS)

DIACNICCIC

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	/ IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP1442234		
Sample Date		Client Info		21 Jun 2024		
Machine Age	wks	Client Info		4		
Oil Age	wks	Client Info		4		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	0		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		10		
Calcium	ppm	ASTM D5185m		11		
Phosphorus	ppm	ASTM D5185m		6		
Zinc	ppm	ASTM D5185m		12		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>.1	0.015		
ppm Water	ppm	ASTM D6304	>1000	156		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.49		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>.1	NEG		
Free Water	scalar	*Visual]	NEG	: MARC BODEA	U - <u>C</u> LAMIDRP
						Page 1 of 2



OIL ANALYSIS REPORT

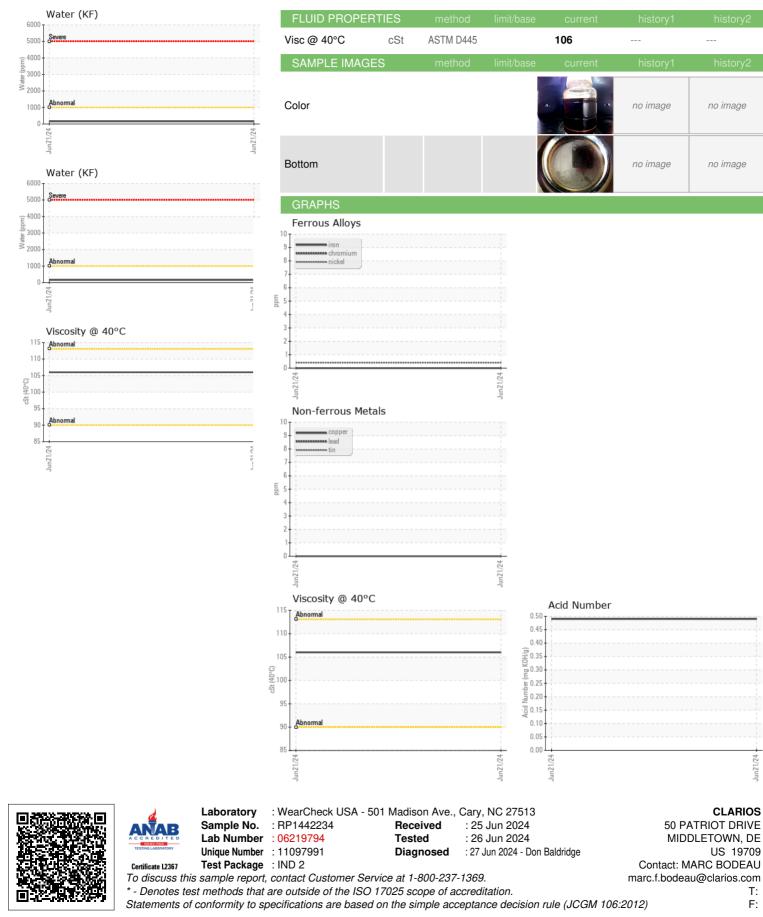

Contact/Location: MARC BODEAU - CLAMIDRP

Jun21/24

CLARIOS

US 19709

T:

F:

no image

no image