


OIL ANALYSIS REPORT

UNKNOWN **KAESER 6663 - LAYSTROM MFG**

Component Compressor

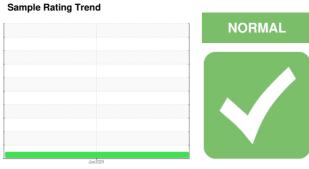

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000129		
Sample Date		Client Info		06 Jun 2024		
Machine Age	hrs	Client Info		50768		
Oil Age	hrs	Client Info		6125		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	11		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		292		
Zinc	ppm	ASTM D5185m		28		
Sulfur	ppm	ASTM D5185m		7056		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.19		



OIL ANALYSIS REPORT

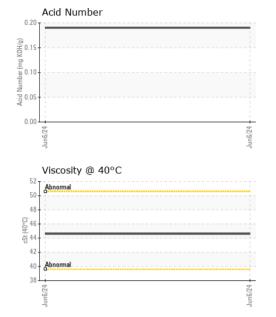





GRAPHS


Color

Bottom



Non-ferrous	s Metals	
copper		
10 + management tin	J	
0		
Jun6/24		Jun6/24





Contact/Location: MICHAEL FERRIS - UCDELDOW

no image

no image

no image

no image





Certificate 12367

Laboratory Sample No.

Lab Number : 06219825 Unique Number : 11098022

: UDI0000129 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Jun 2024

Tested : 26 Jun 2024 Diagnosed : 26 Jun 2024 - Wes Davis

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

DELTA INDUSTRIES - DOWNERS GROVE

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931