


OIL ANALYSIS REPORT

KAESER S-460

KAESER 6558150 - STYLE LINE CABINET AND TOP (S/N 1510)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000376	UCH05897544	
Sample Date		Client Info		14 Jun 2024	06 Jul 2023	
Machine Age	hrs	Client Info		21025	16954	
Oil Age	hrs	Client Info		4072	6200	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	1	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	9	8	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	<1	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	4	0	
Calcium	ppm	ASTM D5185m	2	0	<1	
Phosphorus	ppm	ASTM D5185m		0	2	
Zinc	ppm	ASTM D5185m		3	0	
Sulfur	ppm	ASTM D5185m		20814	18278	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		3	<1	
Potassium	ppm	ASTM D5185m	>20	2	2	
ELLUB DECRADA	TION	mathad	limit/base		history1	hiotom/0
FLUID DEGRADA	HON	method	IIIIII/Dase	current	history1	history2




OIL ANALYSIS REPORT

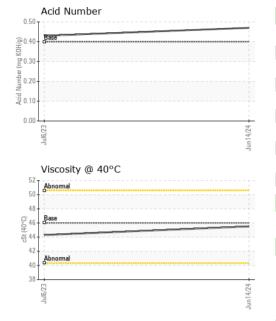


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.5	44.3	
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						no image
					Same 1	


GRAPHS

Bottom



10	Non-ferrous Metals	
8-	copper	
mdd 4	overessessing fill	
2.		
0	4 4	_
	Jul6,223	









Certificate 12367

Laboratory Sample No.

: UDI0000376 Lab Number : 06219829 Unique Number : 11098026 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Jun 2024

Tested : 26 Jun 2024 : 26 Jun 2024 - Wes Davis Diagnosed

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

DELTA INDUSTRIES - DOWNERS GROVE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931 Contact/Location: MICHAEL FERRIS - UCDELDOW

no image