




# OIL ANALYSIS REPORT

Sample Rating Trend

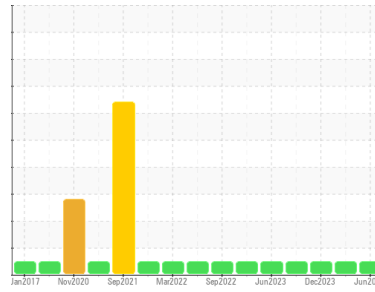

**NORMAL**



Machine Id  
**KAESER 4098280 - ROCHLING AUTOMOTIVE (S/N 1045)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (8 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0942967</b>	WC0915264	WC0863718
Sample Date	Client Info		<b>19 Jun 2024</b>	27 Mar 2024	07 Dec 2023
Machine Age	hrs	Client Info	<b>81212</b>	79201	76595
Oil Age	hrs	Client Info	<b>76595</b>	1000	7000
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	1	1
Lead	ppm	ASTM D5185m >10	<b>0</b>	1	0
Copper	ppm	ASTM D5185m >50	<b>13</b>	4	7
Tin	ppm	ASTM D5185m >10	<b>0</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>6</b>	3	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	5	0
Calcium	ppm	ASTM D5185m 2	<b>0</b>	3	0
Phosphorus	ppm	ASTM D5185m	<b>2</b>	4	35
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	0
Sulfur	ppm	ASTM D5185m	<b>18098</b>	17498	14611

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>2</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.47</b>	0.43	0.39




# OIL ANALYSIS REPORT

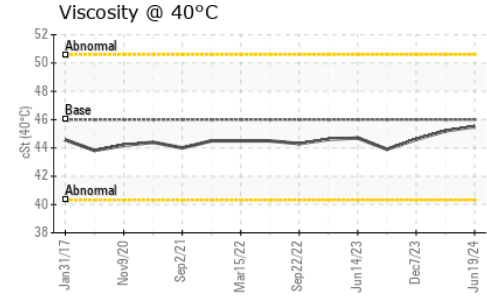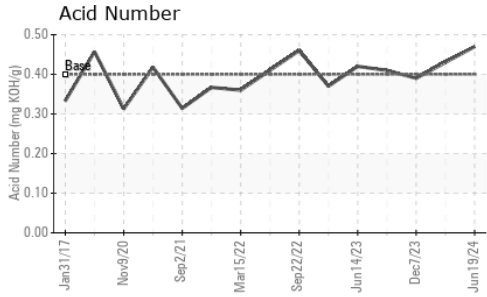





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>45.5</b>	45.2	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

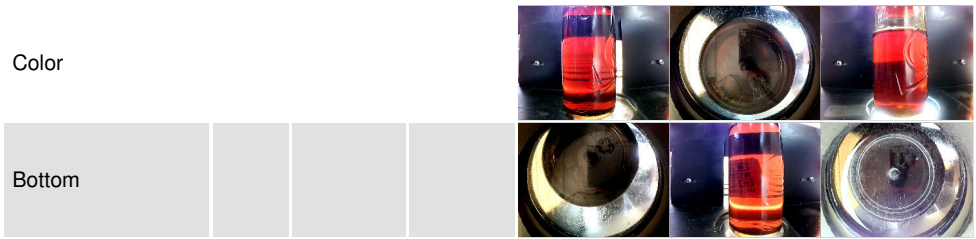

## GRAPHS

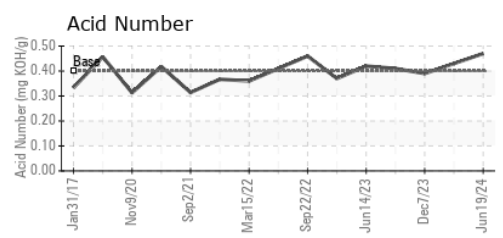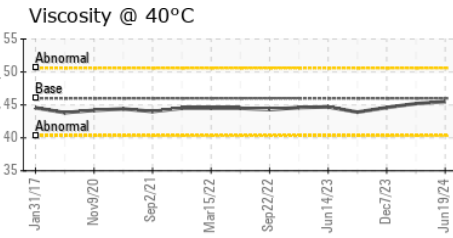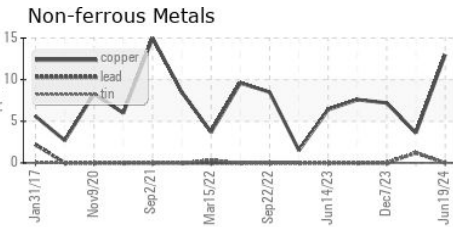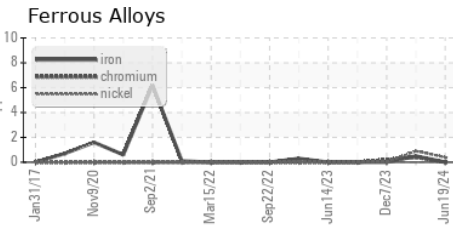

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0942967      **Received** : 25 Jun 2024  
**Lab Number** : **06219844**      **Tested** : 26 Jun 2024  
**Unique Number** : 11098041      **Diagnosed** : 26 Jun 2024 - Sean Felton  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS - IIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com  
 T:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      F: (864)862-7653