




# OIL ANALYSIS REPORT

Sample Rating Trend

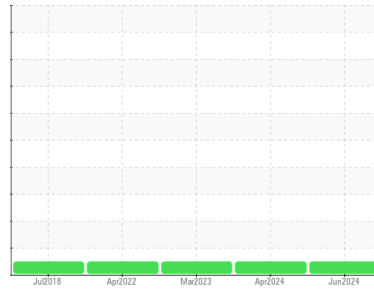

**NORMAL**



Machine Id  
**KAESER 1.7828.00010 - DW FINE PACK (S/N 1211133)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (8 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Top Up Amount: 2 GAL )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0705604</b>	WC0915275	WC0795223
Sample Date	Client Info			<b>18 Jun 2024</b>	17 Apr 2024	14 Mar 2023
Machine Age	hrs	Client Info		<b>101079</b>	101079	75817
Oil Age	hrs	Client Info		<b>101079</b>	1000	6000
Oil Changed	Client Info			<b>Oil Added</b>	Not Changd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	0	1
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>208</b>	265	309
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>89</b>	54	151

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	1	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.26</b>	0.19	0.14




# OIL ANALYSIS REPORT

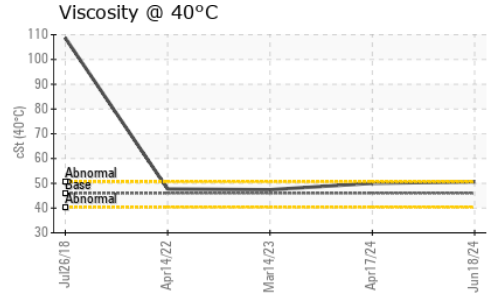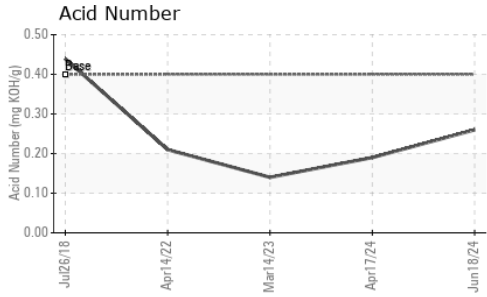





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	50.6	50.0	47.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

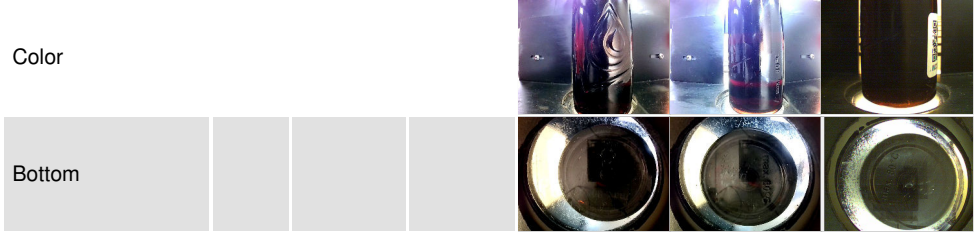

## GRAPHS

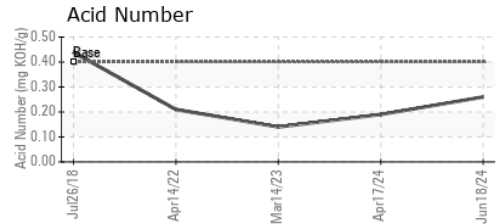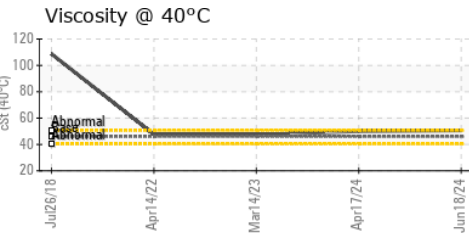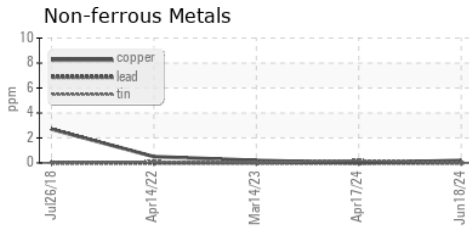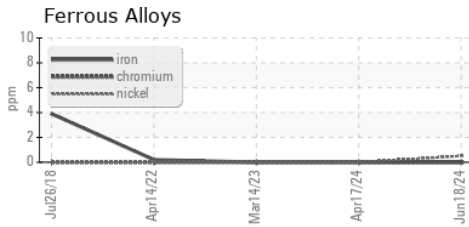

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0705604      **Received** : 25 Jun 2024  
**Lab Number** : 06219845      **Tested** : 26 Jun 2024  
**Unique Number** : 11098042      **Diagnosed** : 26 Jun 2024 - Sean Felton  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS - IIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653