




OIL ANALYSIS REPORT



Machine Id
BRCM01BE (S/N GZJ00658)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

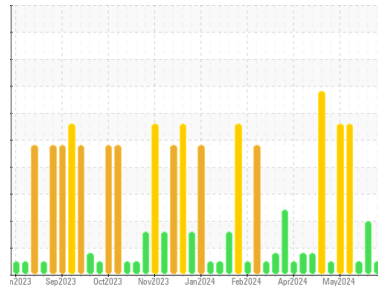

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0938416	WC0938381	WC0938382
Sample Date	Client Info		21 Jun 2024	14 Jun 2024	07 Jun 2024
Machine Age	hrs	Client Info	77489	77322	77233
Oil Age	hrs	Client Info	279	112	23
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			NORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		18	▲ 21	15
Iron	ppm	ASTM D5185m >14	2	1	2
Chromium	ppm	ASTM D5185m >3	0	0	<1
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	3	1	2
Lead	ppm	ASTM D5185m >8	0	0	1
Copper	ppm	ASTM D5185m >5	1	1	<1
Tin	ppm	ASTM D5185m >3	2	0	<1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	13	18	18
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	11	11	11
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	42	38	34
Calcium	ppm	ASTM D5185m	1774	1800	1769
Phosphorus	ppm	ASTM D5185m	301	284	288
Zinc	ppm	ASTM D5185m	368	345	346
Sulfur	ppm	ASTM D5185m	2383	2048	2185

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	172	92	41
Sodium	ppm	ASTM D5185m >20	3	2	2
Potassium	ppm	ASTM D5185m >20	3	2	2


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624	5.7	5.5	5.2
Sulfation	Abs/.1mm	*ASTM D7415	17.4	16.1	15.0




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

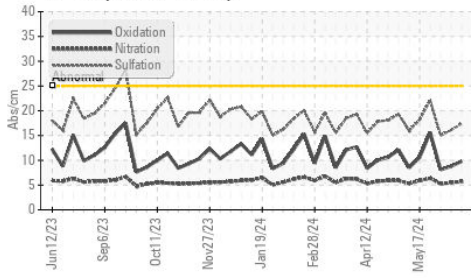


Acid Number

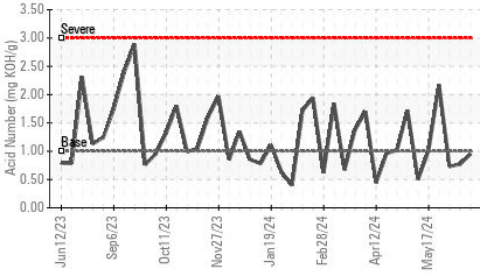


PQ

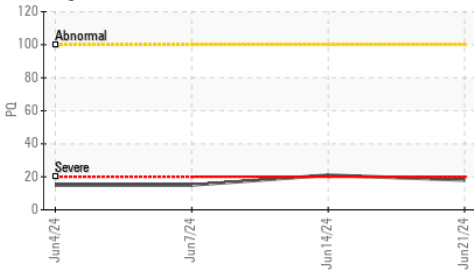

Viscosity @ 100°C

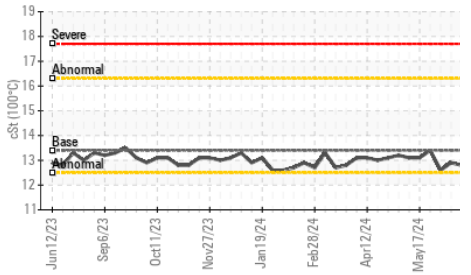

PQ

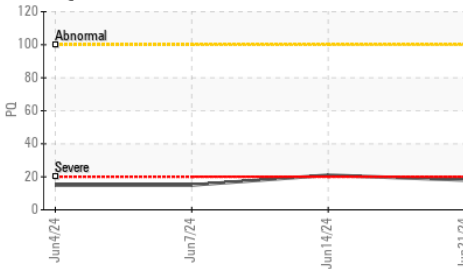

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414	9.8	8.8	8.1
Acid Number (AN)	mg KOH/g	ASTM D8045	0.95	0.77	0.73
Base Number (BN)	mg KOH/g	ASTM D2896	4.66	5.03	5.29

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	12.9	12.6

GRAPHS


Iron (ppm)

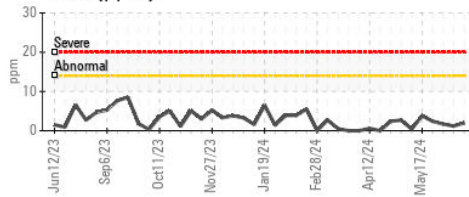


Lead (ppm)

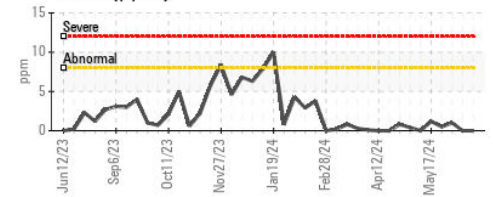


Aluminum (ppm)

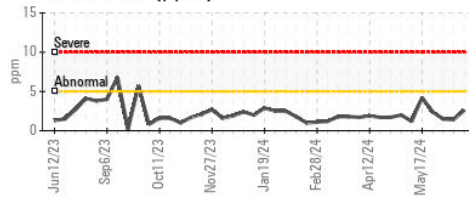


Chromium (ppm)

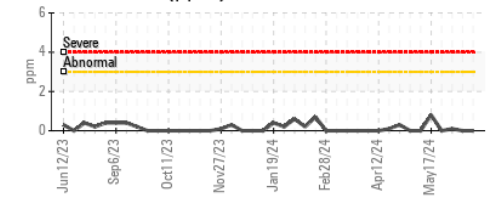


Copper (ppm)

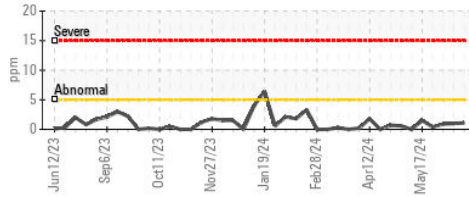


Silicon (ppm)

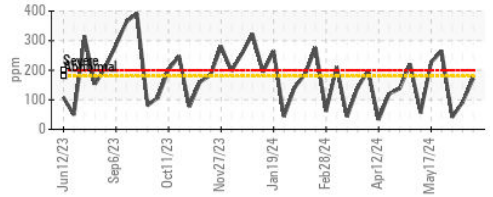

Viscosity @ 100°C

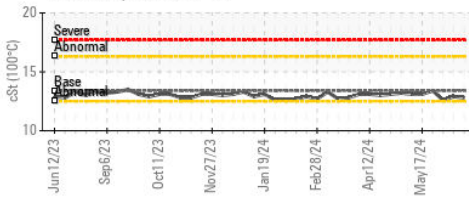

Base Number

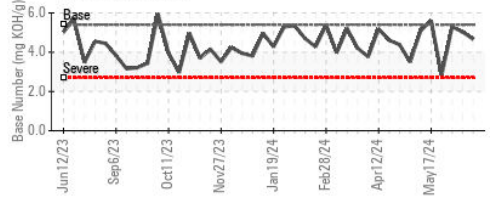

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0938416

Lab Number : 06219898

Unique Number : 11098095

Test Package : MOB 2 (Additional Tests: PQ)

Received : 25 Jun 2024

Tested : 26 Jun 2024

Diagnosed : 26 Jun 2024 - Sean Felton

EDL NA Recips-Brown County

BROWN COUNTY POWER STATION, 9427 BEYERS RD

GEORGETOWN, OH

US 45121

Contact: MITCHELL BUTLER

Mitchell.Butler@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)