




# OIL ANALYSIS REPORT



Machine Id  
**HBKM01BE**  
 Component  
**Biogas Engine**  
 Fluid  
**SHELL MYSELLA S5 S (--- GAL)**

Sample Rating Trend

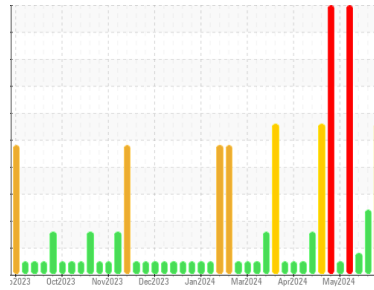

## DIAGNOSIS

### ▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition. ( Customer Sample Comment: Top Up Amount: 30 GAL )

### ▲ Wear

The tin level is abnormal.

### ▲ Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0775490</b>	WC0775493	WC0775165
Sample Date	Client Info		<b>20 Jun 2024</b>	10 Jun 2024	06 Jun 2024
Machine Age	hrs	Client Info	<b>110831</b>	110591	110498
Oil Age	hrs	Client Info	<b>729</b>	489	393
Oil Changed	Client Info		<b>Oil Added</b>	Oil Added	Oil Added
Sample Status			<b>SEVERE</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method		<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>18</b>	19	17
Iron	ppm	ASTM D5185m >14	<b>7</b>	7	7
Chromium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >5	<b>4</b>	3	3
Lead	ppm	ASTM D5185m >8	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >5	<b>2</b>	2	2
Tin	ppm	ASTM D5185m >3	<b>▲ 3</b>	▲ 4	▲ 4
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>41</b>	32	30
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>2</b>	3	4
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>26</b>	22	19
Calcium	ppm	ASTM D5185m	<b>1741</b>	1789	1683
Phosphorus	ppm	ASTM D5185m 300	<b>414</b>	400	373
Zinc	ppm	ASTM D5185m	<b>550</b>	520	479
Sulfur	ppm	ASTM D5185m	<b>4083</b>	4118	3856

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	<b>▲ 222</b>	▲ 185	174
Sodium	ppm	ASTM D5185m >20	<b>5</b>	2	3
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	<1


## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	<b>5.3</b>	4.7	4.4
Sulfation	Abs/.1mm	*ASTM D7415	<b>21.7</b>	20.6	20.2




# OIL ANALYSIS REPORT


## Non-ferrous Metals

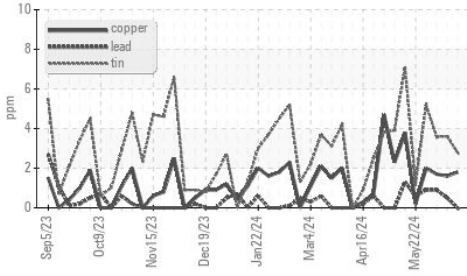


## FT-IR (Direct Trend)

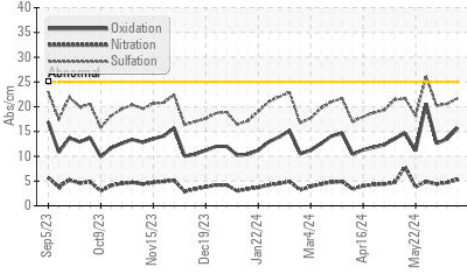


## Acid Number

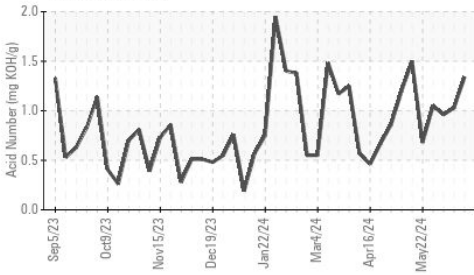

## PQ

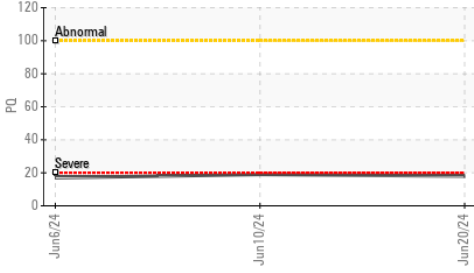

## Base Number

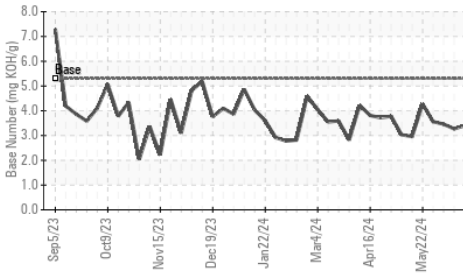

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414	<b>15.7</b>	13.5	12.6
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.34</b>	1.03	0.96
Base Number (BN)	mg KOH/g	ASTM D2896	<b>3.40</b>	3.27	3.46

## VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

## FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.5</b>	13.8	13.4

## GRAPHS


### Iron (ppm)

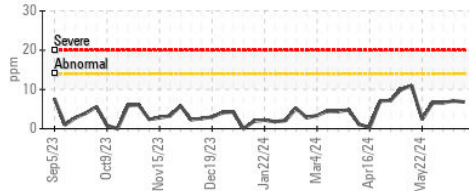


### Lead (ppm)

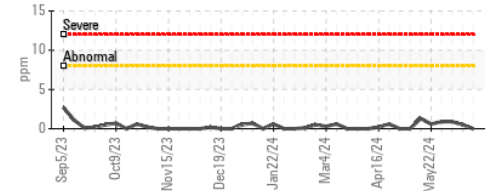


### Aluminum (ppm)

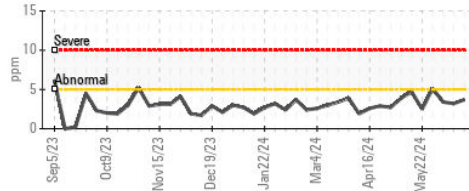


### Chromium (ppm)

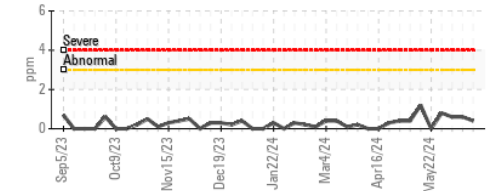


### Copper (ppm)

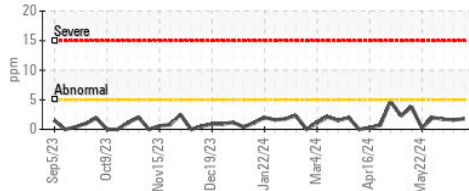


### Silicon (ppm)

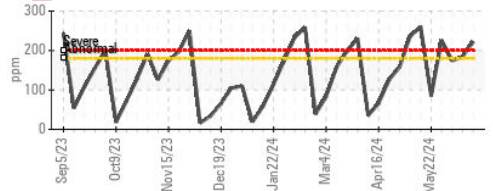

### Viscosity @ 100°C

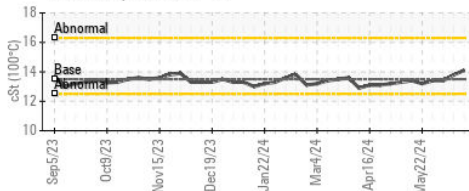

### Base Number

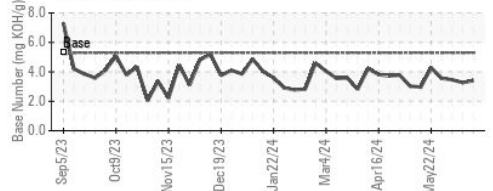

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0775490

Lab Number : 06219900

Unique Number : 11098097

Test Package : MOB 2 ( Additional Tests: PQ )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 25 Jun 2024

Tested : 26 Jun 2024

Diagnosed : 26 Jun 2024 - Sean Felton

EDL NA Recips-Honeybrook

Honey Brook Powerstation, 481 S. Churchtown Road

Narvon, PA

US 17555-9574

Contact: Christian Adames

Christian.Adames@edlenergy.com

T:

F: