




# OIL ANALYSIS REPORT

Sample Rating Trend

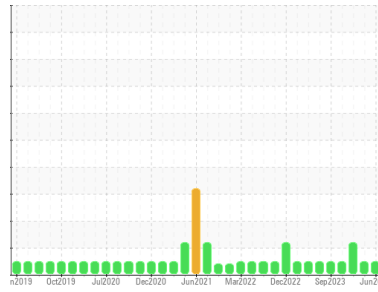

**NORMAL**



Area  
**Mt. Vernon**  
 Machine Id  
**[Mt. Vernon] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (6 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: Ronnie Wilbanks)

### Wear

All component wear rates are normal for time on oil.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0859775</b>	WC0769044	WC0769040
Sample Date	Client Info		<b>14 Jun 2024</b>	18 May 2024	17 Apr 2024
Machine Age	hrs	Client Info	<b>0</b>	16757	16237
Oil Age	hrs	Client Info	<b>564</b>	3928	3493
Oil Changed	Client Info		<b>Not Chngd</b>	Changed	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>13</b>	12	16
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>12</b>	10	13
Silver	ppm	ASTM D5185m	>5	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	1	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	2	2
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	1	3
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	250	<b>46</b>	57	56
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>36</b>	25	30
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>666</b>	559	623
Calcium	ppm	ASTM D5185m	3000	<b>1849</b>	1965	1750
Phosphorus	ppm	ASTM D5185m	1150	<b>796</b>	814	805
Zinc	ppm	ASTM D5185m	1350	<b>964</b>	963	906
Sulfur	ppm	ASTM D5185m	4250	<b>3742</b>	3779	3479

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	4	5
Sodium	ppm	ASTM D5185m	>158	<b>8</b>	5	5
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	3	4
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.2</b>	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>10.6</b>	10.2	10.8
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.7</b>	20.2	20.9


## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>18.7</b>	18.1	19.8
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>8.85</b>	9.07	8.11




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

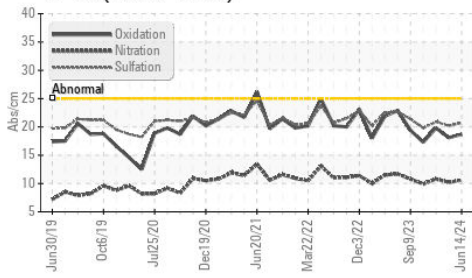


Water (KF)

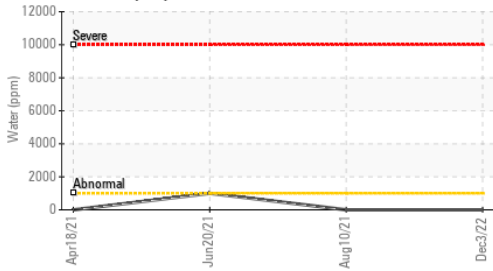

Viscosity @ 100°C

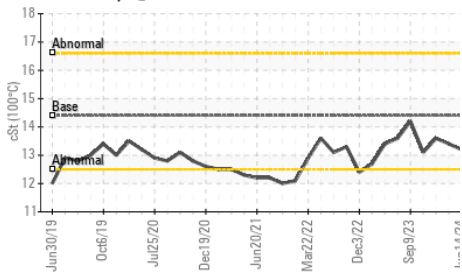

Water (KF)

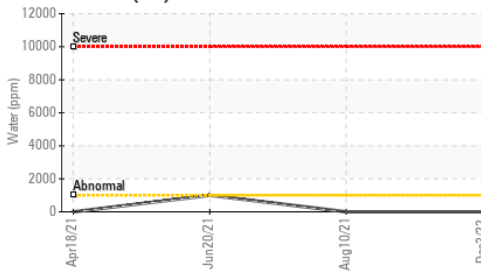


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	▲ MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.2	13.4

## GRAPHS


Ferrous Alloys

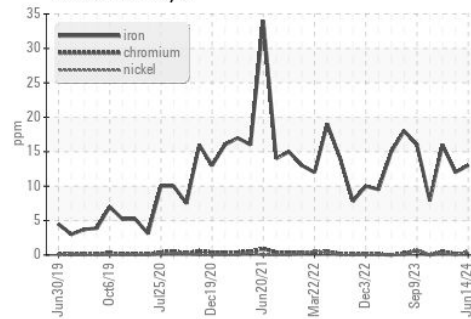


Non-ferrous Metals

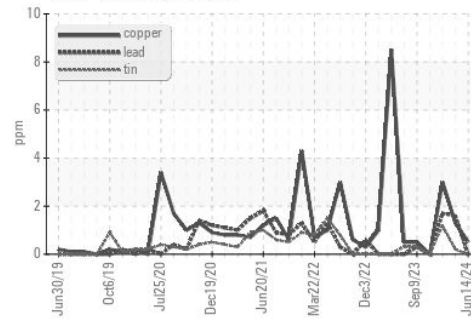

Viscosity @ 100°C

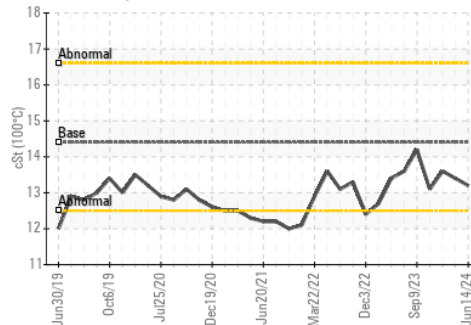

Base Number

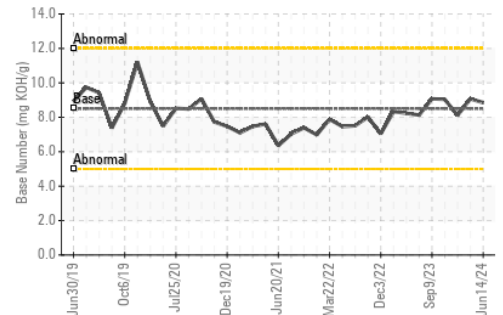

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : WC0859775

**Lab Number** : 06219908

**Unique Number** : 11098105

**Test Package** : IND 2 ( Additional Tests: KF )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Received** : 25 Jun 2024

**Tested** : 26 Jun 2024

**Diagnosed** : 26 Jun 2024 - Sean Felton

**MARATHON PETROLEUM CO.**

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x: