




# OIL ANALYSIS REPORT

Sample Rating Trend

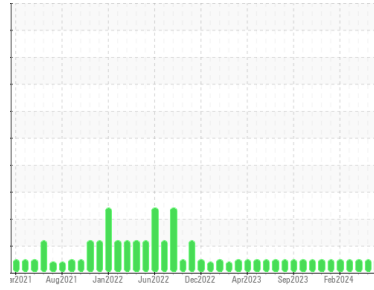

**NORMAL**



Area

**Detroit**

Machine Id

**[Detroit] Oil - Port Genset**

Component

**Port Genset**

Fluid

**MOBIL 15W40 (7 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal for time on oil.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0859858</b>	WC0804767	WC0804788
Sample Date	Client Info			<b>03 Jun 2024</b>	20 May 2024	22 Apr 2024
Machine Age	hrs	Client Info		<b>23178</b>	22962	22599
Oil Age	hrs	Client Info		<b>215</b>	535	172
Oil Changed	Client Info			<b>Diff Oil</b>	Not Changd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>9</b>	8	4
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>2</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>12	<b>4</b>	3	4
Lead	ppm	ASTM D5185m	>17	<b>0</b>	<1	2
Copper	ppm	ASTM D5185m	>70	<b>6</b>	4	6
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>70</b>	78	93
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>27</b>	24	27
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>332</b>	291	318
Calcium	ppm	ASTM D5185m		<b>2847</b>	2414	2546
Phosphorus	ppm	ASTM D5185m		<b>543</b>	443	530
Zinc	ppm	ASTM D5185m		<b>671</b>	557	602
Sulfur	ppm	ASTM D5185m		<b>5200</b>	4386	4186

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	4	7
Sodium	ppm	ASTM D5185m	>118	<b>4</b>	2	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	4
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.3</b>	0.3	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>10.5</b>	10.2	7.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.5</b>	20.2	20.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>18.2</b>	17.4	15.2
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.23</b>	8.86	9.80




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

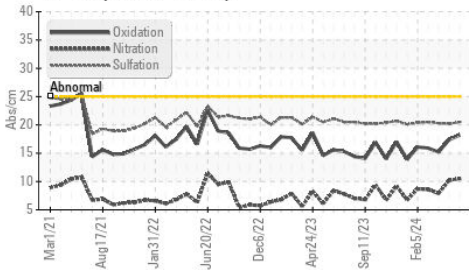


Water (KF)

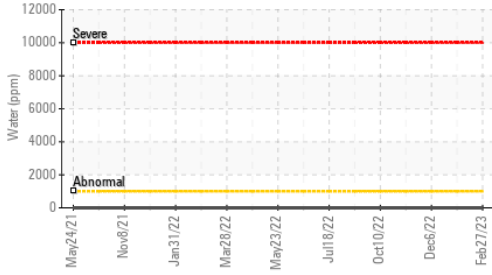

Base Number

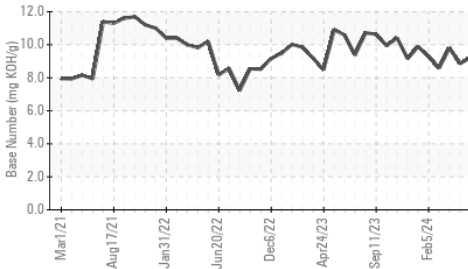

Water (KF)

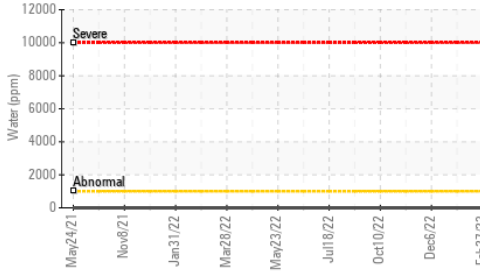


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.1	13.9	13.4

## GRAPHS


Ferrous Alloys

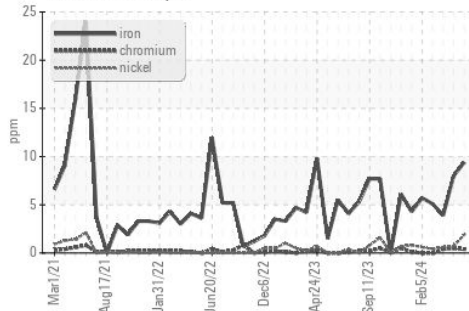


Non-ferrous Metals

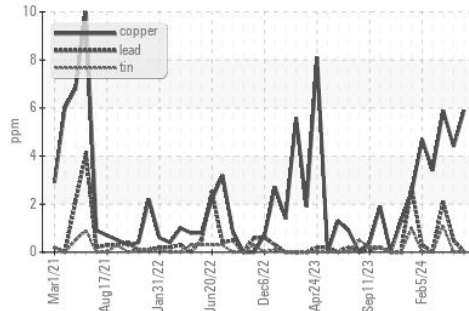

Viscosity @ 100°C

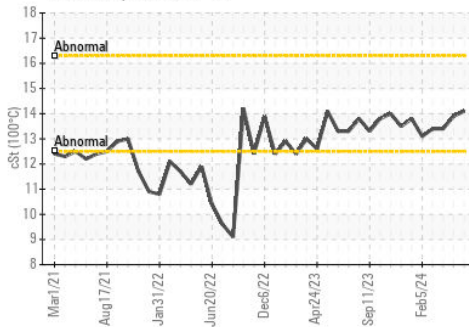

Base Number

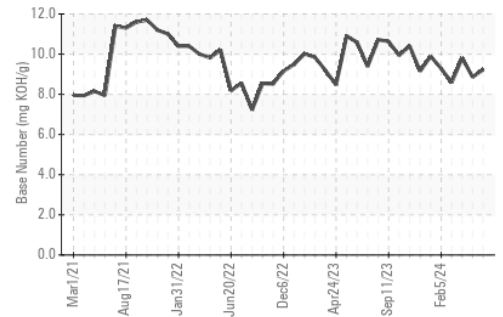

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0859858

Lab Number : 06219912

Unique Number : 11098109

Test Package : IND 2 ( Additional Tests: KF )

Received : 25 Jun 2024

Tested : 26 Jun 2024

Diagnosed : 26 Jun 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)