

COOLANT REPORT

Area [PMOAS3507464] GENERAC SD0015 EBENEZER RD (S/N 3000701630)

Component Coolant Fluid

{not provided} (--- GAL)

DIAGNOSIS


Recommendation The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.



Sample Rating Trend




NORMAL

SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		DC0035272		
Sample Date		Client Info		30 May 2024		
Machine Age	hrs	Client Info		224		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR				
Specific Gravity		*ASTM D1298		1.066		
рН	Scale 0-14	ASTM D1287		8.06		
Nitrites	ppm	AP-053:2009		560		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		49.0		
Freezing Point	°F	ASTM D3321		-33		
Total Dissolved Solids				488.5		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Yllow		
Coolant Appearance		*Visual	Clear	normal		
Color					no image	no image
Bottom					no image	no image



COOLANT REPORT

Nitrites 3000 Abnor 2500 200 1500 1000 Abno 500 0 Mav30/24

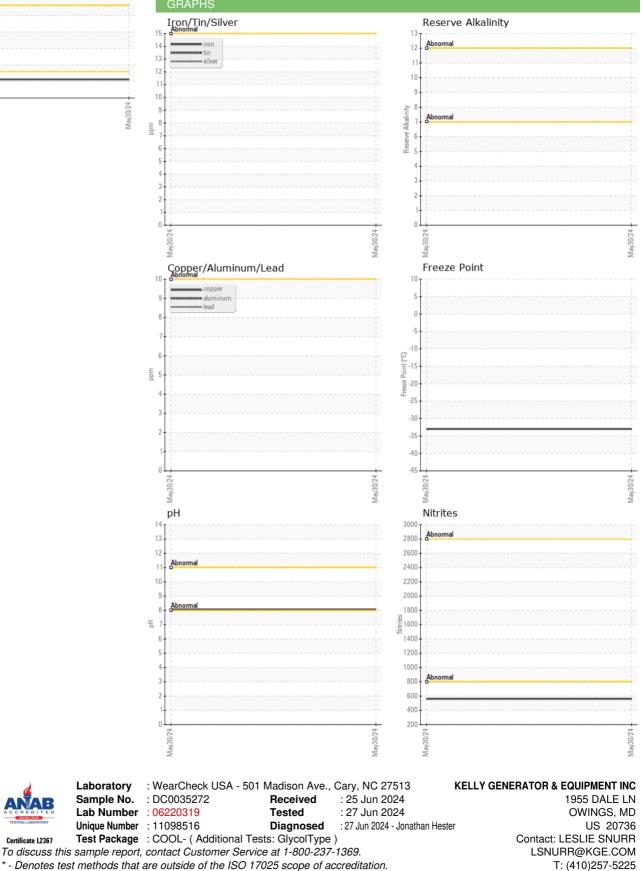

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Contact/Location: LESLIE SNURR - KELOWI

F: (410)257-5227