




COOLANT REPORT

Sample Rating Trend

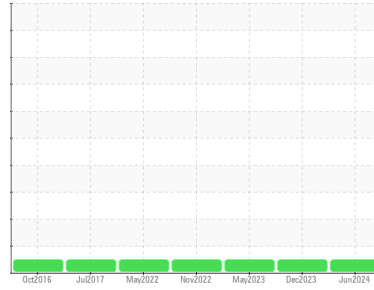

NORMAL



Area

[PMOAS3429612]

Machine Id

GENERAC SD0200GG1727 21300740100 (S/N 10027644)

Component

Coolant

Fluid

50/50 (--- QTS)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION


	method	limit/base	current	history1	history2
Sample Number	Client Info		DC0035434	DC0032086	DC0026397
Sample Date	Client Info		14 Jun 2024	06 Dec 2023	22 May 2023
Machine Age	hrs	Client Info	160	0	141
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	Not Changed	N/A
Sample Status			NORMAL	NORMAL	NORMAL

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.067	1.071	1.071
pH	Scale 0-14 ASTM D1287		7.90	7.87	7.82
Nitrites	ppm AP-053:2009		788	560	560
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		49.7	53.1	53.0
Freezing Point	°F ASTM D3321		-33	-43	-43
Total Dissolved Solids			528.0	374.0	398.5
Carboxylate			n/a	n/a	n/a








VISUAL

	method	limit/base	current	history1	history2
Coolant Color	*Visual		Yellow	Yellow	Yellow
Coolant Appearance	*Visual	Clear	normal	normal	normal

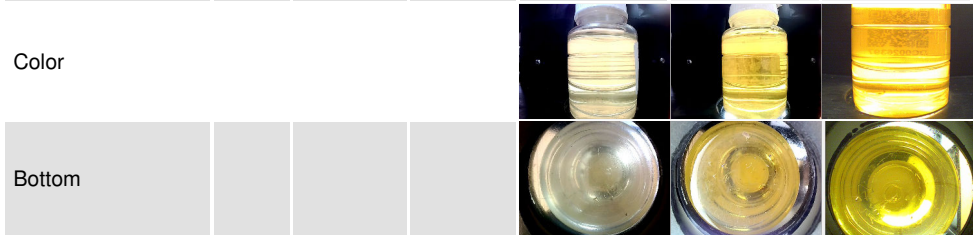



COOLANT REPORT

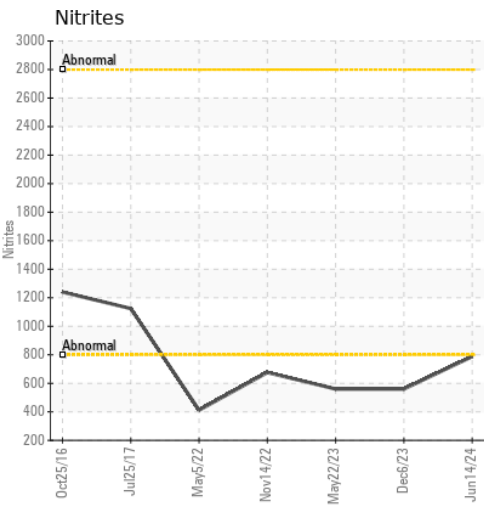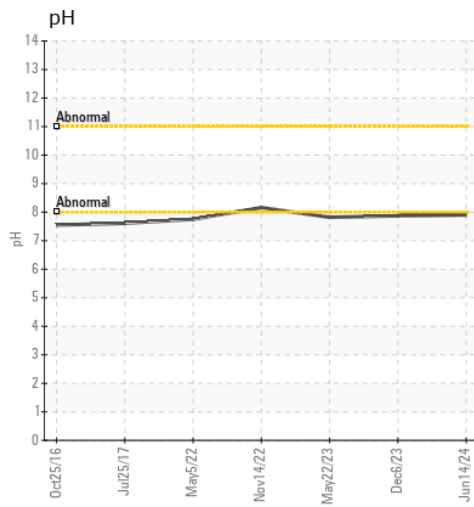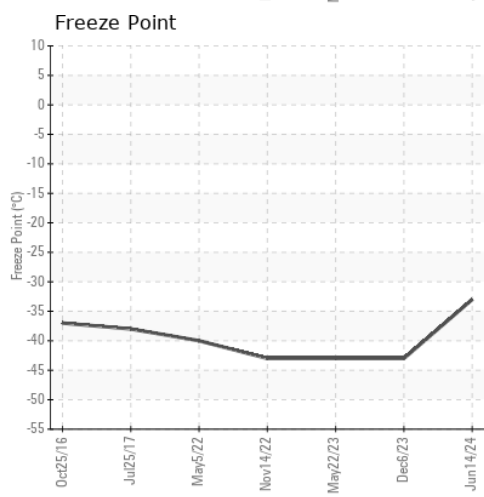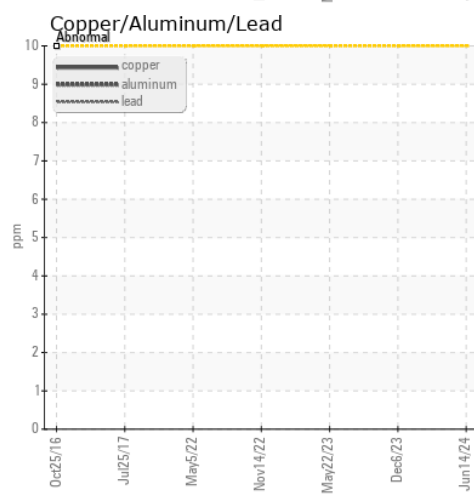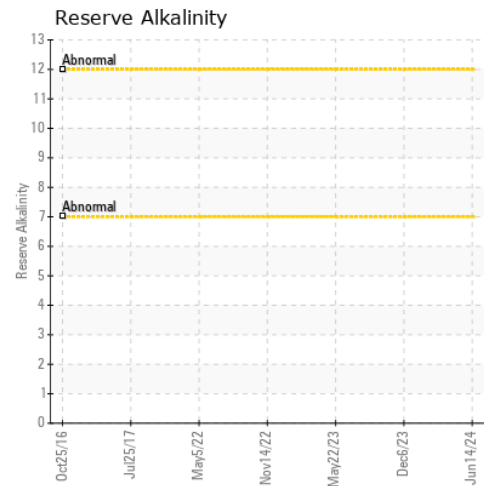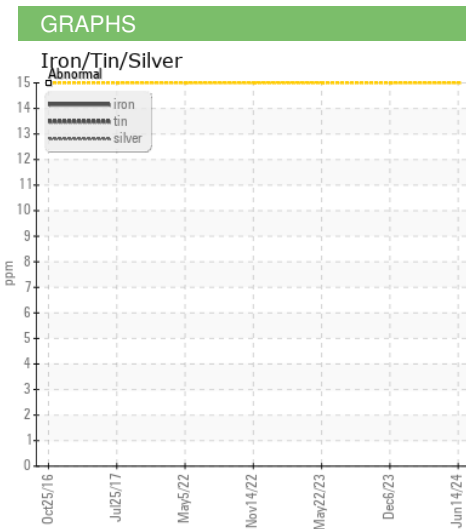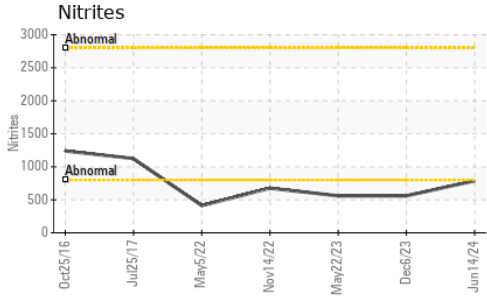

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0035434
Lab Number : 06220321
Unique Number : 11098518
Test Package : COOL- (Additional Tests: GlycolType)

Received : 25 Jun 2024
Tested : 27 Jun 2024
Diagnosed : 27 Jun 2024 - Jonathan Hester

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)