




COOLANT REPORT

Sample Rating Trend

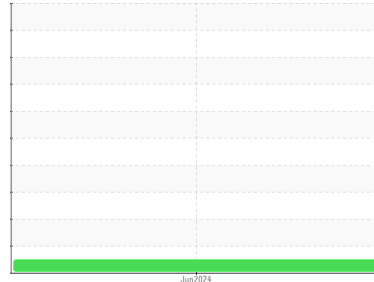

NORMAL



Area
[PMOAS3429611]
 Machine Id
2068816
 Component
Coolant
 Fluid
FLEETCHARGE (--- QTS)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.



SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		DC0037044	---	---
Sample Date	Client Info		14 Jun 2024	---	---
Machine Age	hrs	Client Info	410	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			NORMAL	---	---

PHYSICAL TEST RESULTS








	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.076	---	---
pH	Scale 0-14 ASTM D1287		8.57	---	---
Nitrites	ppm AP-053:2009		1352	---	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		56.6	---	---
Freezing Point	°F ASTM D3321		-50	---	---
Total Dissolved Solids			239.0	---	---
Carboxylate			n/a	---	---

VISUAL

	method	limit/base	current	history1	history2
Coolant Color	*Visual		Red	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image



COOLANT REPORT

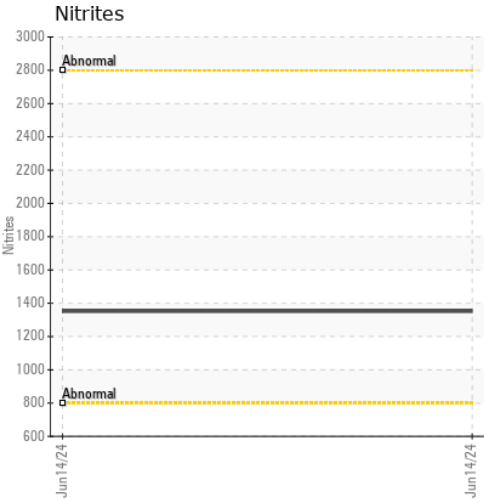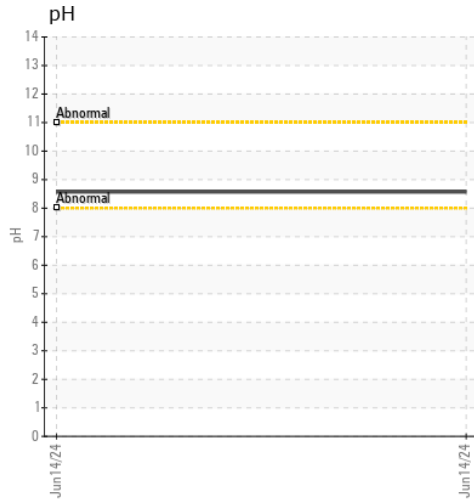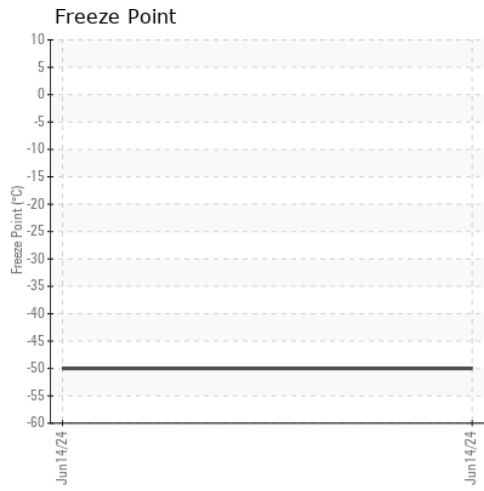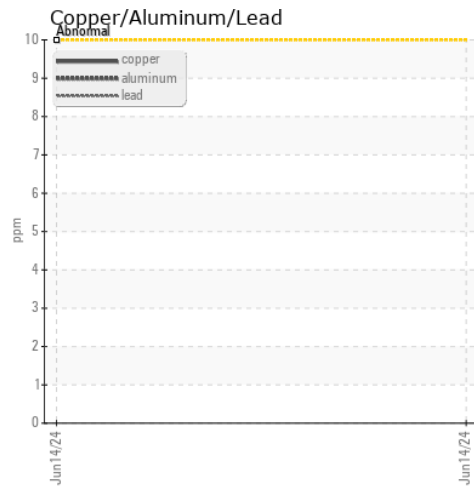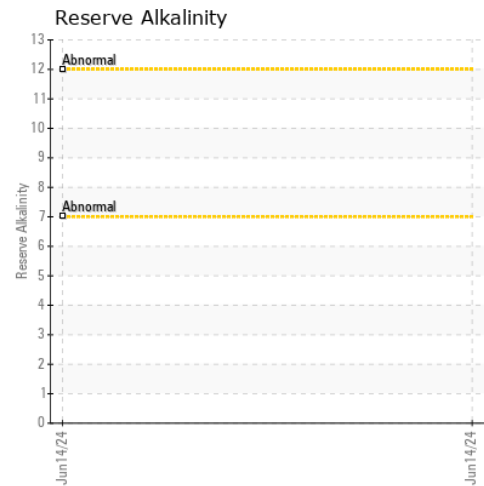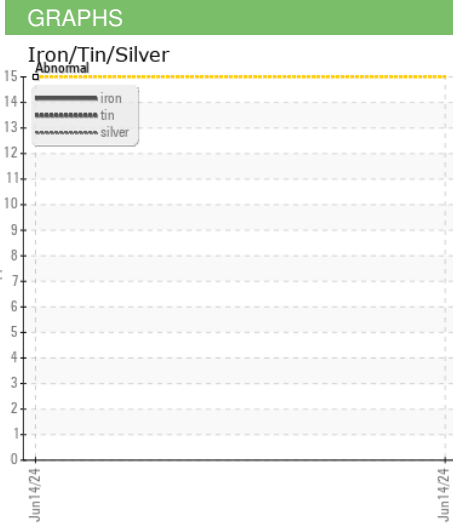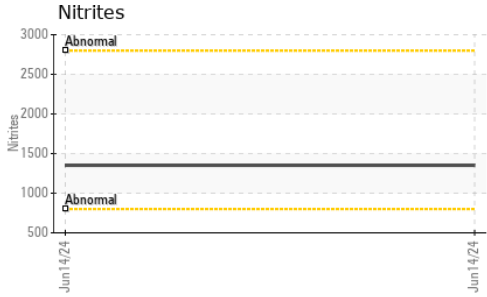

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0037044
Lab Number : 06220327
Unique Number : 11098524
Test Package : COOL- (Additional Tests: GlycolType)

Received : 25 Jun 2024
Tested : 27 Jun 2024
Diagnosed : 27 Jun 2024 - Jonathan Hester

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736

Contact: LESLIE SNURR
 LSNURR@KGE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (410)257-5225

F: (410)257-5227