


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER BSD 50T 8253010 (S/N 1230)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Felt	2023	Nov2023 Jun203	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018743	KCPA011200	KCP54907
Sample Date		Client Info		19 Jun 2024	27 Nov 2023	07 Feb 2023
Machine Age	hrs	Client Info		19355	14947	8033
Oil Age	hrs	Client Info		4500	0	8033
Oil Changed	1113	Client Info		Changed	N/A	Changed
Sample Status		Ciletit iiilo		NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	10	10
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m	>10	<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	ррпп		limit/base			
		method	iiiiii/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	0	<1	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		1	40	6
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		19095	25314	16726
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.05	0.007	0.005	0.007
ppm Water	ppm	ASTM D6304	>500	80	59	72.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		780	1010	3342
Particles >6μm		ASTM D7647	>1300	247	256	1057
Particles >14μm		ASTM D7647	>80	18	17	91
Particles >21μm		ASTM D7647	>20	4	4	<u>21</u>
Particles >38μm		ASTM D7647	>4	0	0	1
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	17/15/11	19/17/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.46	0.45	0.41



OIL ANALYSIS REPORT

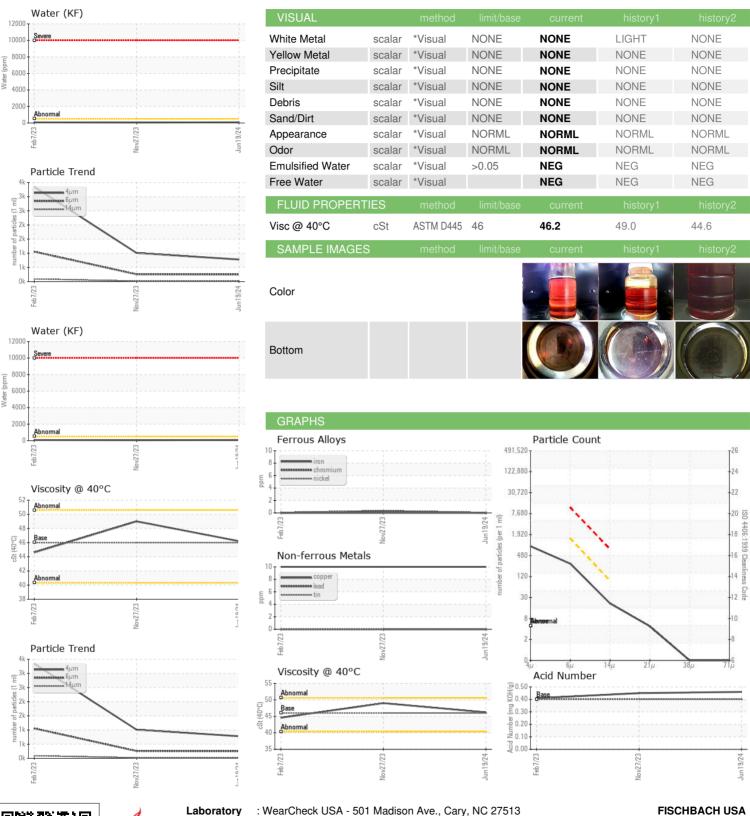





Certificate 12367

Laboratory

Sample No. Lab Number Unique Number : 11098563

: KCPA018743 : 06220366

Received : 25 Jun 2024 **Tested** Diagnosed

: 26 Jun 2024 Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 27 Jun 2024 - Don Baldridge

ELIZABETHTOWN, KY US 42701 Contact: GARY CAMPBELL gary.campbell@fi-usa.com T:

900 PETERSON DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: