


OIL ANALYSIS REPORT

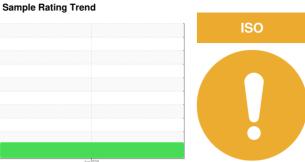

Machine Id

KAESER SM 11 7843375 (S/N 1158)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
CAMPLE INCORN	AATIONI	and the section of	Page 18 /fe and a	a company	la fact a consider	history O
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018745		
Sample Date		Client Info		18 Jun 2024		
Machine Age	hrs	Client Info		20687		
Oil Age	hrs	Client Info		35		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	-	<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	РРШ	method	limit/base	current	history1	history2
		ASTM D5185m	IIIIIIIIIIII		,	
Boron	ppm		00	0		
Barium	ppm	ASTM D5185m	90	31		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	70		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		13		
Zinc	ppm	ASTM D5185m		4		
Sulfur	ppm	ASTM D5185m		21770		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.034		
ppm Water	ppm	ASTM D6304	>500	346		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		3540		
Particles >6µm		ASTM D7647	>1300	732		
Particles >14µm		ASTM D7647	>80	92		
Particles >21µm		ASTM D7647	>20	30		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34		



OIL ANALYSIS REPORT

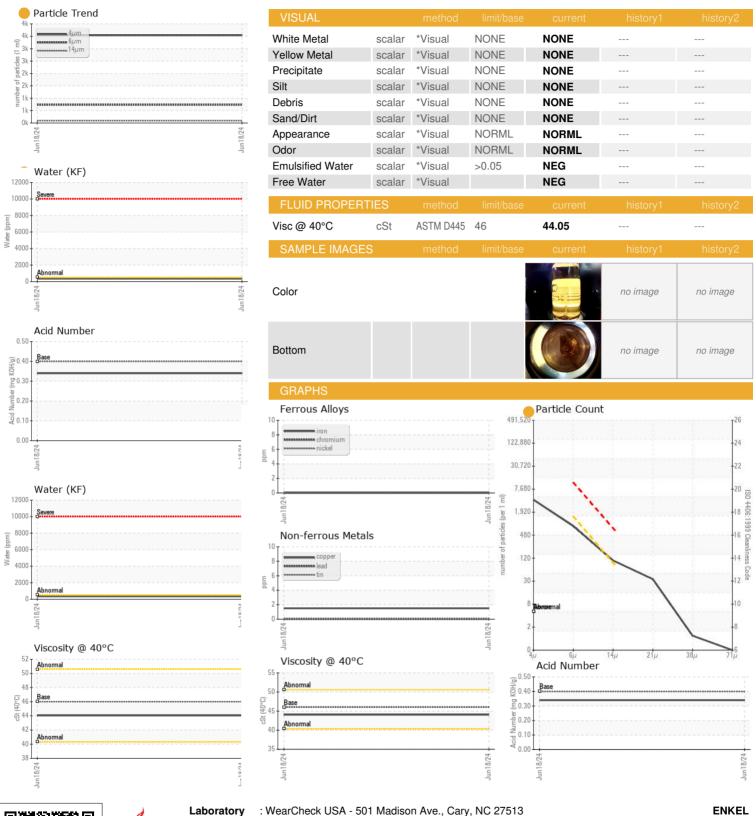



Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA018745 : 06220376 Unique Number : 11098573

Received : 25 Jun 2024 **Tested** : 28 Jun 2024 Diagnosed : 28 Jun 2024 - Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

2900 W. INWOOD DR. COLUMBUS, IN US 47201 Contact: S. GRUBE

sgrube@enkelamerica.com T:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: