

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# 7872848 (S/N 1213)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

וט	$\Delta$		VI -		-
וטו	$\sim$	uі.	$\sim$	$\sim$	$\cdot$

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jur	2022	Nov2022 Jun202	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017814	KCP47623D	KCP49633
Sample Date		Client Info		18 Jun 2024	01 Nov 2022	23 Jun 2022
Machine Age	hrs	Client Info		12954	3978	1950
Oil Age	hrs	Client Info		4000	3000	1950
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	12	1
Tin	ppm	ASTM D5185m	>10	0	2	2
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	2
Barium	ppm	ASTM D5185m	90	2	0	8
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	2	24	59
Calcium	ppm	ASTM D5185m	0	0	0	1
Phosphorus	ppm	ASTM D5185m	0	7	18	5
Zinc	ppm	ASTM D5185m	0	39	35	7
Sulfur	ppm	ASTM D5185m	23500	20669	21444	18017
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		3	9	10
Potassium	ppm	ASTM D5185m	>20	2	7	6
Water	%	ASTM D6304	>0.05	0.008	0.018	0.043
ppm Water	ppm	ASTM D6304	>500	87	186.3	438.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2167	2918	4662
Particles >6µm		ASTM D7647	>1300	556	709	1135
Particles >14μm		ASTM D7647	>80	48	55	45
Particles >21µm		ASTM D7647	>20	14	11	13
Particles >38μm		ASTM D7647	>4	1	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	19/17/13	19/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41	0.43	0.43



## **OIL ANALYSIS REPORT**

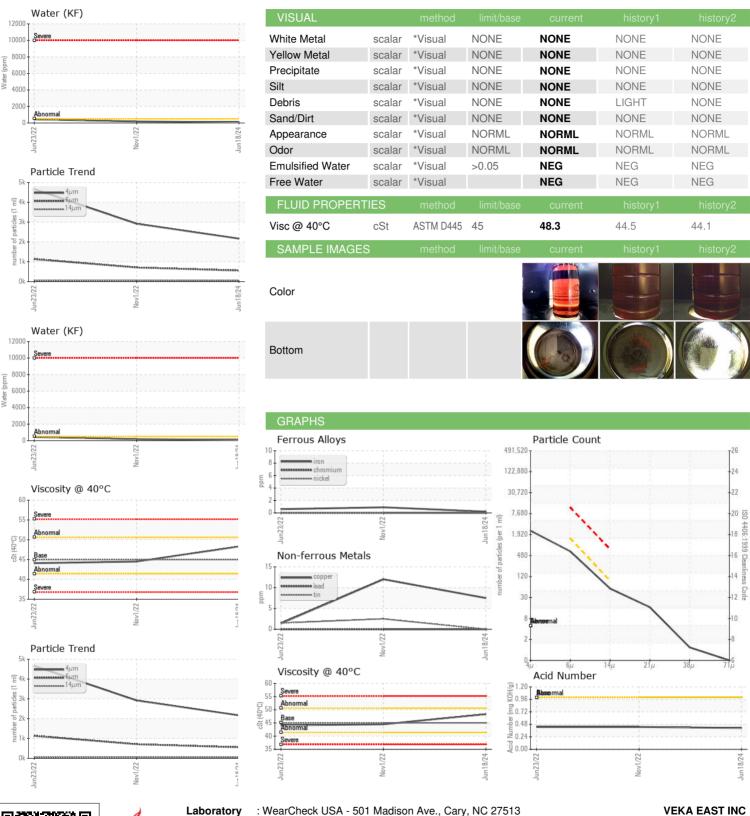





Laboratory Sample No.

Lab Number : 06220379 Unique Number : 11098576

: KCPA017814

Received : 25 Jun 2024 **Tested** Diagnosed

: 26 Jun 2024 : 27 Jun 2024 - Don Baldridge 90 CERAMIC TILE DR MORGANTON, NC US 28655

Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - VEKMOR

T:

F: