




# FUEL REPORT

Sample Rating Trend

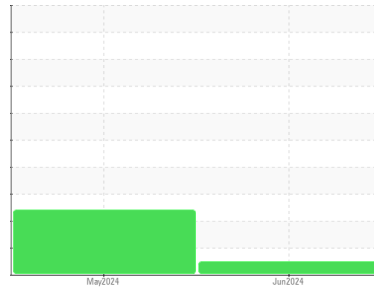

NORMAL



Area  
**MUSC Columbia - Downtown [18597]**  
 Machine Id  
**[MUSC Columbia - Downtown] TANK 2 MAIN 1**  
 Component  
**Right Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (15000 GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number      | Client Info |             |            | <b>WC06220595</b>  | WC06179665  | ---      |
| Sample Date        | Client Info |             |            | <b>25 Jun 2024</b> | 08 May 2024 | ---      |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 0           | ---      |
| Sample Status      |             |             |            | <b>NORMAL</b>      | ABNORMAL    | ---      |

| PHYSICAL PROPERTIES        |        | method           | limit/base | current     | history1 | history2 |
|----------------------------|--------|------------------|------------|-------------|----------|----------|
| Fuel Color                 | text   | *Visual Screen   | Yllow      | ---         | Red      | ---      |
| ASTM Color                 | scalar | *ASTM D1500      |            | <b>L4.0</b> | L4.0     | ---      |
| Visc @ 40°C                | cSt    | ASTM D445        | 3.0        | <b>2.2</b>  | 2.46     | ---      |
| Pensky-Martens Flash Point | °C     | *PMCC Calculated | 52         | <b>55.7</b> | 62.3     | ---      |

| SULFUR CONTENT |     | method      | limit/base | current   | history1 | history2 |
|----------------|-----|-------------|------------|-----------|----------|----------|
| Sulfur         | ppm | ASTM D5185m | 10         | <b>0</b>  | 31       | ---      |
| Sulfur (UVF)   | ppm | ASTM D5453  |            | <b>52</b> | 35       | ---      |






| DISTILLATION           |    | method   | limit/base | current    | history1 | history2 |
|------------------------|----|----------|------------|------------|----------|----------|
| Initial Boiling Point  | °C | ASTM D86 | 165        | <b>163</b> | 174      | ---      |
| 5% Distillation Point  | °C | ASTM D86 |            | <b>182</b> | 196      | ---      |
| 10% Distill Point      | °C | ASTM D86 | 201        | <b>192</b> | 206      | ---      |
| 15% Distillation Point | °C | ASTM D86 |            | <b>200</b> | 214      | ---      |
| 20% Distill Point      | °C | ASTM D86 | 216        | <b>208</b> | 222      | ---      |
| 30% Distill Point      | °C | ASTM D86 | 230        | <b>223</b> | 236      | ---      |
| 40% Distill Point      | °C | ASTM D86 | 243        | <b>236</b> | 249      | ---      |
| 50% Distill Point      | °C | ASTM D86 | 255        | <b>250</b> | 262      | ---      |
| 60% Distill Point      | °C | ASTM D86 | 267        | <b>264</b> | 275      | ---      |
| 70% Distill Point      | °C | ASTM D86 | 280        | <b>279</b> | 288      | ---      |
| 80% Distill Point      | °C | ASTM D86 | 295        | <b>296</b> | 303      | ---      |
| 85% Distillation Point | °C | ASTM D86 |            | <b>308</b> | 314      | ---      |
| 90% Distill Point      | °C | ASTM D86 | 310        | <b>320</b> | 325      | ---      |
| 95% Distillation Point | °C | ASTM D86 |            | <b>340</b> | 343      | ---      |
| Final Boiling Point    | °C | ASTM D86 | 341        | <b>355</b> | 357      | ---      |

| IGNITION QUALITY |  | method     | limit/base | current   | history1 | history2 |
|------------------|--|------------|------------|-----------|----------|----------|
| API Gravity      |  | ASTM D7777 | 37.7       | <b>36</b> | 36       | ---      |
| Cetane Index     |  | ASTM D4737 | <40.0      | <b>45</b> | 48       | ---      |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | <1.0       | <b>0</b>     | 0        | ---      |
| Sodium       | ppm | ASTM D5185m | <0.1       | <b>&lt;1</b> | <1       | ---      |
| Potassium    | ppm | ASTM D5185m | <0.1       | <b>0</b>     | 0        | ---      |
| Water        | %   | ASTM D6304  | <0.05      | <b>0.004</b> | 0.004    | ---      |
| ppm Water    | ppm | ASTM D6304  | <500       | <b>42</b>    | 46       | ---      |
| % Gasoline   | %   | *In-House   | <0.50      | <b>2.1</b>   | 0.0      | ---      |
| % Biodiesel  | %   | *In-House   | <20.0      | <b>0.0</b>   | 0.0      | ---      |




# FUEL REPORT

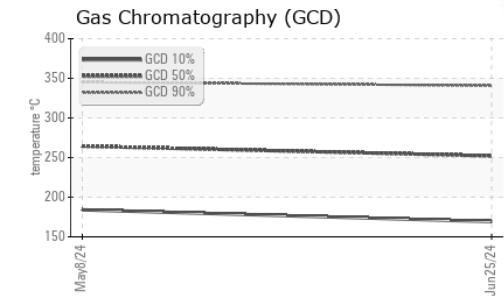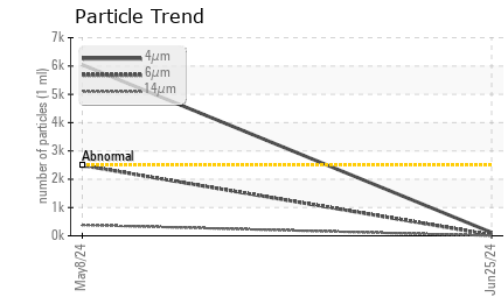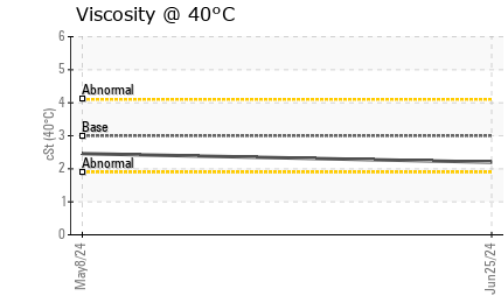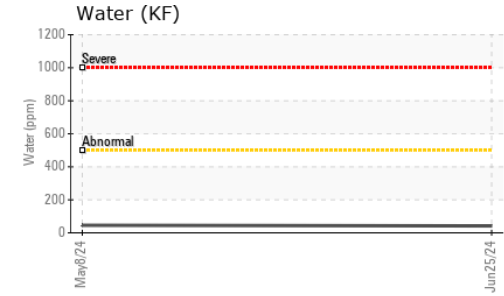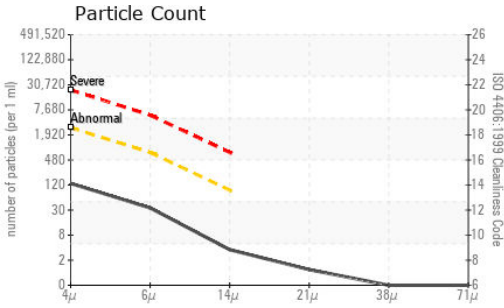




| FLUID CLEANLINESS | method       | limit/base | current        | history1   | history2 |
|-------------------|--------------|------------|----------------|------------|----------|
| Particles >4µm    | ASTM D7647   | >2500      | <b>116</b>     | ▲ 6045     | ---      |
| Particles >6µm    | ASTM D7647   | >640       | <b>30</b>      | ▲ 2487     | ---      |
| Particles >14µm   | ASTM D7647   | >80        | <b>3</b>       | ▲ 384      | ---      |
| Particles >21µm   | ASTM D7647   | >20        | <b>1</b>       | ▲ 117      | ---      |
| Particles >38µm   | ASTM D7647   | >4         | <b>0</b>       | 5          | ---      |
| Particles >71µm   | ASTM D7647   | >3         | <b>0</b>       | 0          | ---      |
| Oil Cleanliness   | ISO 4406 (c) | >18/16/13  | <b>14/12/9</b> | ▲ 20/18/16 | ---      |

| HEAVY METALS | method | limit/base       | current  | history1 | history2 |
|--------------|--------|------------------|----------|----------|----------|
| Aluminum     | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Nickel       | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Lead         | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Vanadium     | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Iron         | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Calcium      | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Magnesium    | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Phosphorus   | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |
| Zinc         | ppm    | ASTM D5185m <0.1 | <b>0</b> | 0        | ---      |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color         |        |            |         |          |          |
| Bottom        |        |            |         |          |          |

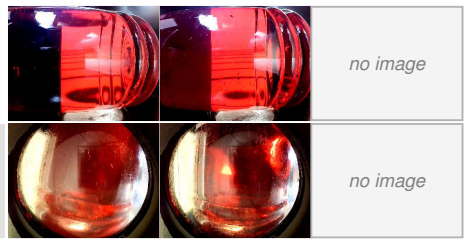

## GRAPHS

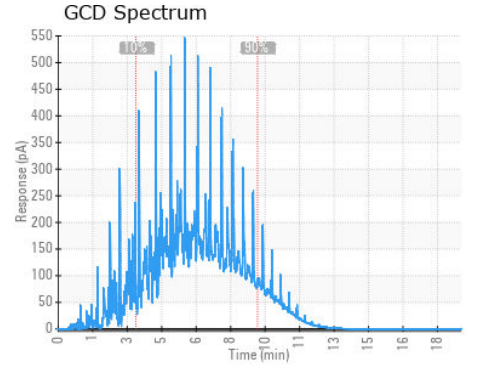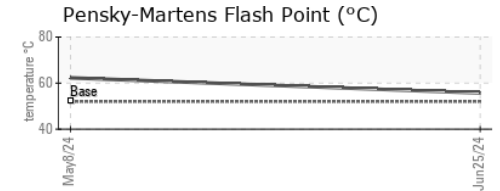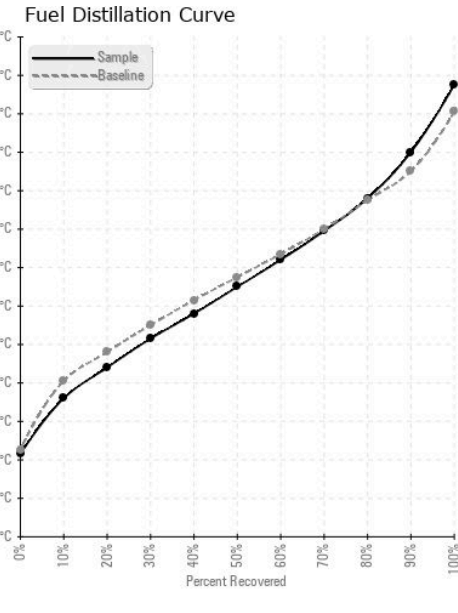

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06220595 **Received** : 25 Jun 2024  
**Lab Number** : **06220595** **Tested** : 01 Jul 2024  
**Unique Number** : 11098792 **Diagnosed** : 01 Jul 2024 - Elizabeth Valachovic  
**Test Package** : DF-2 ( Additional Tests: Fuel, Screen )

**PETROLEUM RECOVERY SERVICES**  
 210 POWELL DR  
 SUMMERVILLE, SC  
 US 29483  
 Contact: AJAY EL  
 Ajay@prsfuel.com  
 T: (843)225-1777  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)