



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**HTF CIRC PUMP (S/N 168366)**  
 Component  
**Pump**  
 Fluid  
**MOBIL SHC 627 (1 LTR)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0943767</b>	---	---
Sample Date	Client Info		<b>25 Jun 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>14</b>	---	---
Iron	ppm	ASTM D5185m >90	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >5	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >12	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >30	<b>1</b>	---	---
Tin	ppm	ASTM D5185m >9	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>448</b>	---	---
Zinc	ppm	ASTM D5185m	<b>16</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>122</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m	<b>8</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	---	---
Water	%	ASTM D6304 >.1	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>35</b>	---	---

## FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>61</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>22</b>	---	---
Particles >14µm	ASTM D7647	>160	<b>2</b>	---	---
Particles >21µm	ASTM D7647	>40	<b>1</b>	---	---
Particles >38µm	ASTM D7647	>10	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>13/12/9</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.46</b>	---	---



# OIL ANALYSIS REPORT

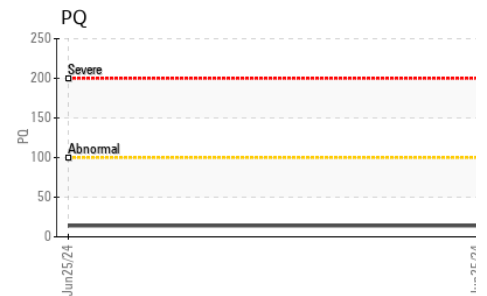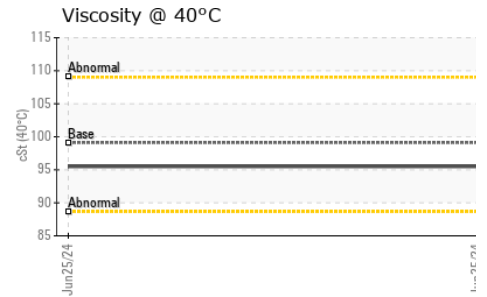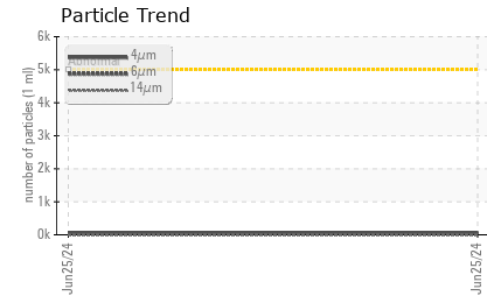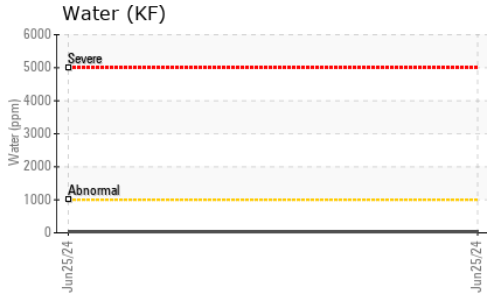





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	99.1	<b>95.5</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

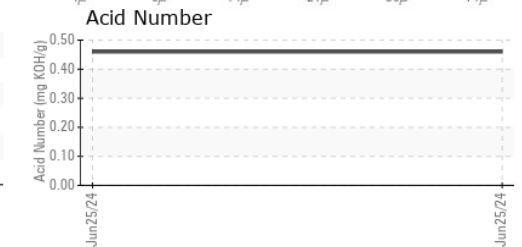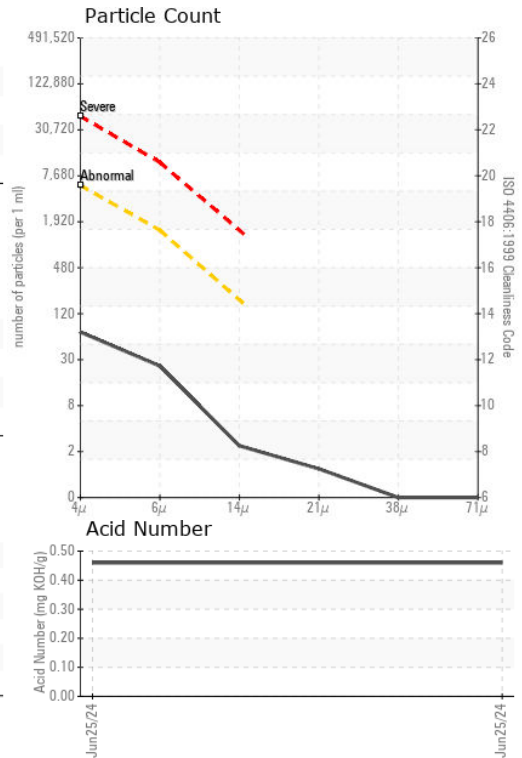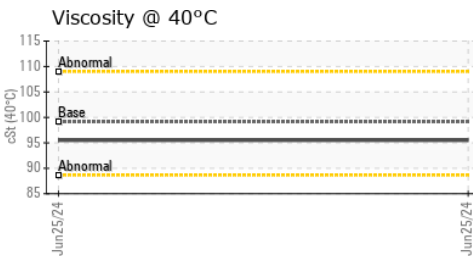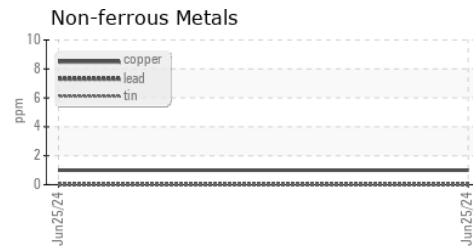

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0943767  
**Lab Number** : 06221181  
**Unique Number** : 11099378  
**Test Package** : PLANT

**Received** : 26 Jun 2024  
**Tested** : 27 Jun 2024  
**Diagnosed** : 27 Jun 2024 - Angela Borella

**BAKELITE CHEMICALS - BEAVER CREEK**  
 4113 W 4 MILE RD  
 GRAYLING, MI  
 US 49738

Contact: Nick Swiercz  
 nick.swiercz@bakelite.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: