




OIL ANALYSIS REPORT

Sample Rating Trend

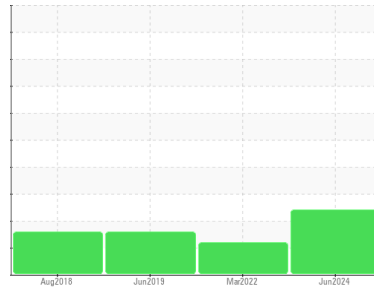

VISCOSITY



Machine Id

KAESER BS 61 1174357 (S/N 1040)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

● Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA019247	KCP44288	KCP18942
Sample Date	Client Info		19 Jun 2024	18 Mar 2022	06 Jun 2019
Machine Age	hrs	Client Info	37865	35250	34846
Oil Age	hrs	Client Info	0	0	458
Oil Changed	Client Info		Changed	Changed	Not Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	2	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	9	4	8
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	2
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	<1	0	4
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	1	<1
Magnesium	ppm	ASTM D5185m 100	14	30	58
Calcium	ppm	ASTM D5185m 0	0	0	1
Phosphorus	ppm	ASTM D5185m 0	6	42	<1
Zinc	ppm	ASTM D5185m 0	32	42	36
Sulfur	ppm	ASTM D5185m 23500	23265	16209	15828

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	1	7
Sodium	ppm	ASTM D5185m	6	28	26
Potassium	ppm	ASTM D5185m >20	1	0	2
Water	%	ASTM D6304 >0.05	0.012	0.021	0.028
ppm Water	ppm	ASTM D6304 >500	123	217.1	280






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		13223	11927	38809
Particles >6µm	ASTM D7647	>1300	▲ 3977	● 2251	▲ 12862
Particles >14µm	ASTM D7647	>80	▲ 381	▲ 200	▲ 822
Particles >21µm	ASTM D7647	>20	▲ 97	▲ 50	▲ 163
Particles >38µm	ASTM D7647	>4	▲ 5	3	▲ 7
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/16	▲ 18/15	▲ 21/17

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.47	0.32	0.313

OIL ANALYSIS REPORT

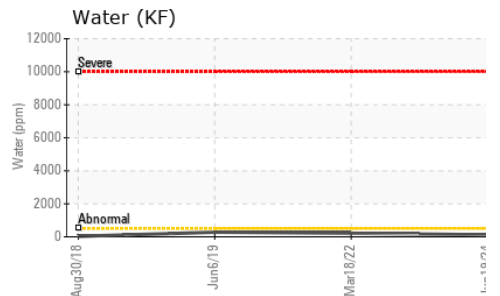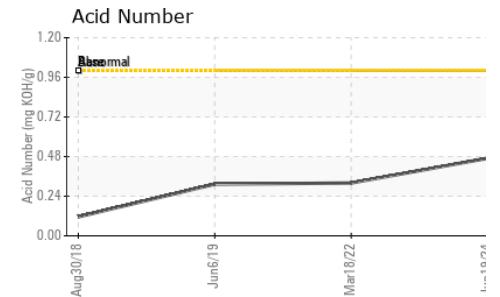
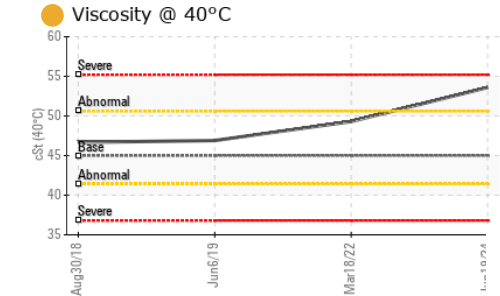
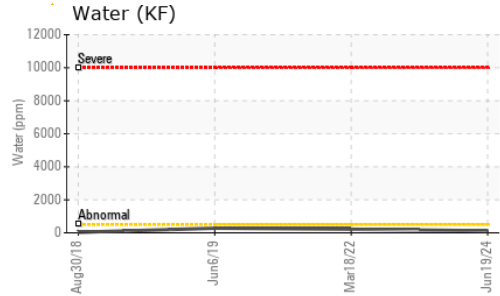
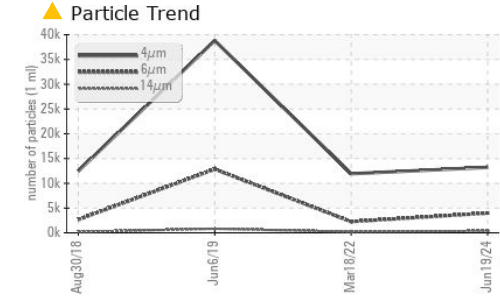


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	53.6	49.3	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

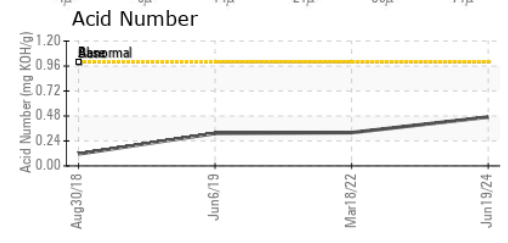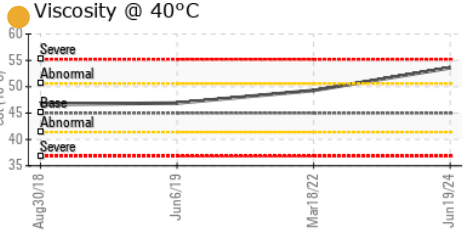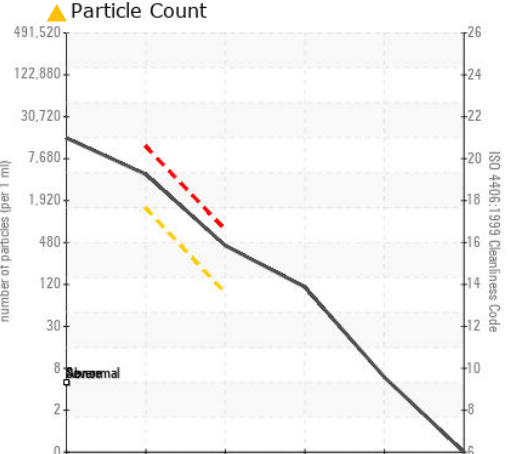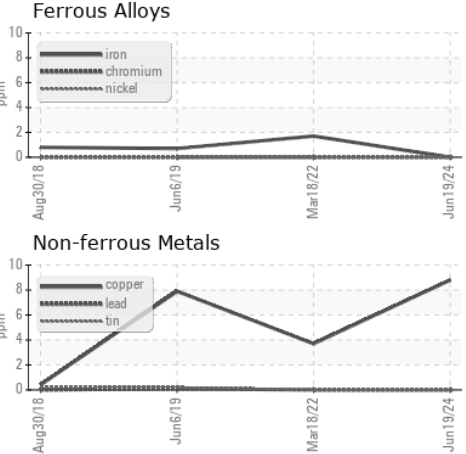

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA019247 **Received** : 26 Jun 2024
Lab Number : 06221204 **Tested** : 27 Jun 2024
Unique Number : 11099401 **Diagnosed** : 27 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ROCKETT INC
 3640 4TH ST
 FLOWOOD, MS
 US 39232
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)