


# **OIL ANALYSIS REPORT**

Sample Rating Trend

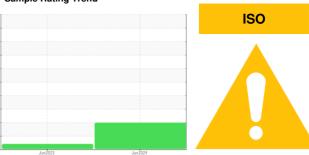

Machine Id

# 1666550 (S/N 1428)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

			Jun2023	Jun 2024		
SAMPLE INFORM	MATION	method	limit/base	ourront	historya	hiotory
	MATION		IIIIIIIIIIIIIII	current	history1	history2
Sample Number		Client Info		KCPA017352	KCP31545	
Sample Date		Client Info		18 Jun 2024	23 Jun 2023	
Machine Age	hrs	Client Info		42406	39997	
Oil Age	hrs	Client Info		2409	3056	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	4	7	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	<1	<1	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	3	2	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		1	3	
Zinc	ppm	ASTM D5185m		30	7	
Sulfur	ppm	ASTM D5185m		21180	18106	
CONTAMINANTS	<b>,</b>	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		2	0	
Potassium	ppm	ASTM D5185m	>20	2	1	
Water	%	ASTM D6304	>0.05	0.009	0.008	
ppm Water	ppm	ASTM D6304	>500	93	89.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		37073		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 20742		
Particles >14µm		ASTM D7647	>80	<b>2250</b>		
Particles >21µm		ASTM D7647	>20	<b>4</b> 333		
Particles >38µm		ASTM D7647	>4	<u>^</u> 6		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	<u>^</u> 22/18		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -1-I NII (ANI)		AOTA DOO45	0.4	0.50	0.54	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.51

0.50



## **OIL ANALYSIS REPORT**

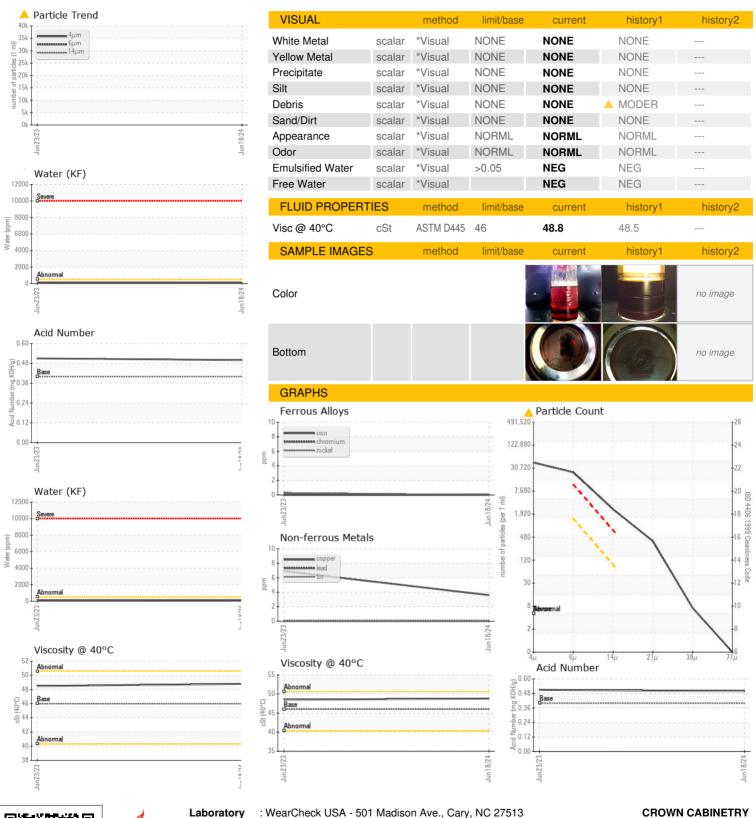





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017352 : 06221223 Unique Number : 11099420

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Jun 2024 **Tested** 

Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 27 Jun 2024 : 27 Jun 2024 - Don Baldridge

210 N BRADY ST ABILENE, KS US 67410 Contact: JERRY jerry@cabinetsbycrown.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: