

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

8720875 (S/N 1934) Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination


There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011161		
Sample Date		Client Info		22 Dec 2023		
Machine Age	hrs	Client Info		4652		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	17		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm		23500	16598		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.007		
ppm Water	ppm	ASTM D6304	>500	76		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9856		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/20/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34		



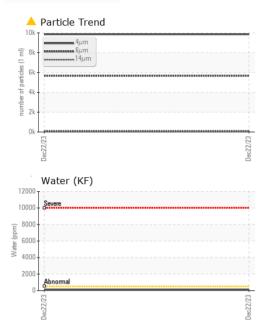

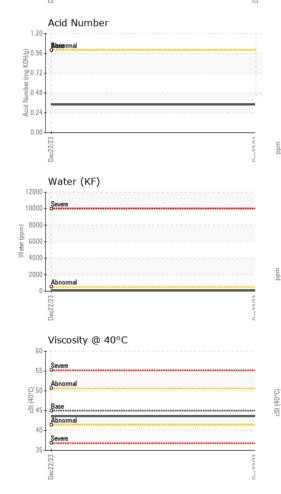

Ē

9

P

D

OIL ANALYSIS REPORT

VISUAL		method	limit/base	current	history1	histor
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Wa	ter scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PRO	PERTIES	method	limit/base	current	history1	histor
Visc @ 40°C	cSt	ASTM D445	45	43.6		
SAMPLE IM	AGES	method	limit/base	current	history1	histor
Color					no image	no ima
Bottom					no image	no imag
GRAPHS Ferrous Alloy	16			Particle Coun	+	5
¹⁰ T	/5		491,520			
8 - iron chromiur	n		122,880			
E 6- nickel			122,000			
			30,720	+		
2 -			7,680	· ·		
u				1.		
Dec22/23			Dec22/23. s (per 1 ml)	· · · ·	<u>, </u>	
 Non-ferrous	Metals					
²⁰ T	Fietdis		of pa		\mathbf{i}	
15 - copper			Dec222/23 0561 mll 1200 particles (per 1 mll		1	
<u>ا</u> ال الم			30			
5			8	Biorene mal		
	***********************	*********************	£2 2			
Dec22/23			Dec22/23			
 Viscosity @ 4	40°C		ē 0	μ <u>6</u> μ	14µ 21µ	38µ
⁶⁰ T				Acid Number		
55 Severe	*****	*****	(BHO 96	Bbsormal		
S 50 - Abnormal			Ē0.72			
(2, 50 - Base 5 45 - Base	*****	*****	a 0.48			
40 - Severe			(b)/HO 30 (b)/HO 30 (c)/HO 30 (c) 30 (c) 4 (c) 4	-		
35						
Dec22/23			Dec22/23	Dec22/23		
ē			Dei	Ъ.		
: WearCheck US/ : KCPA011161	A - 501 Madiso Rece		r, NC 27513 6 Jun 2024		NUCOR H	ARRIS RE 150 TYLE
	nece	iveu .20	2000/024			JOU ITLE
: 06221224	Teste		7 Jun 2024			ST LOUIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: Service Manager - NUCSTL Page 2 of 2

Т:

F: