




OIL ANALYSIS REPORT

Sample Rating Trend

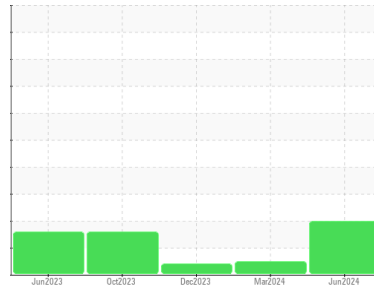

WATER



Area

[2405-0547]

Machine Id

KAESER SK 15T 8687556 (S/N 1513)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06221235	KC125378	KC121977
Sample Date	Client Info	10 Jun 2024	13 Mar 2024	28 Dec 2023
Machine Age	hrs	5409	4651	4090
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	<1	<1
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	<1	<1
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	3	2
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	8	6	4
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	6	15
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 90	25	44	72
Calcium	ppm	ASTM D5185m 2	0	4	<1
Phosphorus	ppm	ASTM D5185m	<1	<1	21
Zinc	ppm	ASTM D5185m	15	11	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	6	14	15
Potassium	ppm	ASTM D5185m >20	4	7	10
Water	%	ASTM D6304 >0.05	▲ 0.226	0.021	0.028
ppm Water	ppm	ASTM D6304 >500	▲ 2260	218	286




FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	464	1528
Particles >6µm	ASTM D7647 >1300	---	137	408
Particles >14µm	ASTM D7647 >80	---	16	28
Particles >21µm	ASTM D7647 >20	---	3	9
Particles >38µm	ASTM D7647 >4	---	0	0
Particles >71µm	ASTM D7647 >3	---	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	---	16/14/11	18/16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.34	0.32


OIL ANALYSIS REPORT

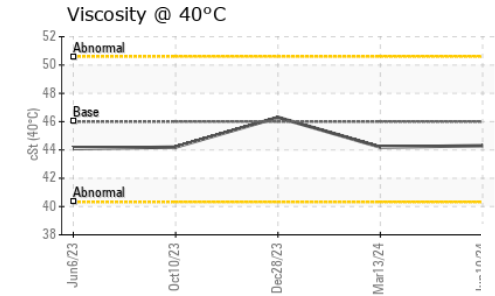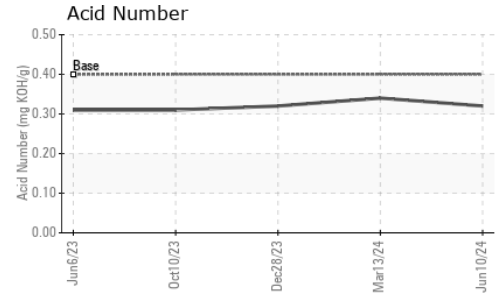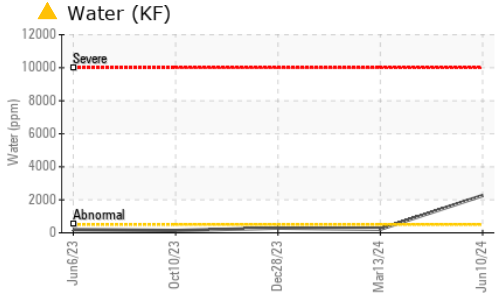





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

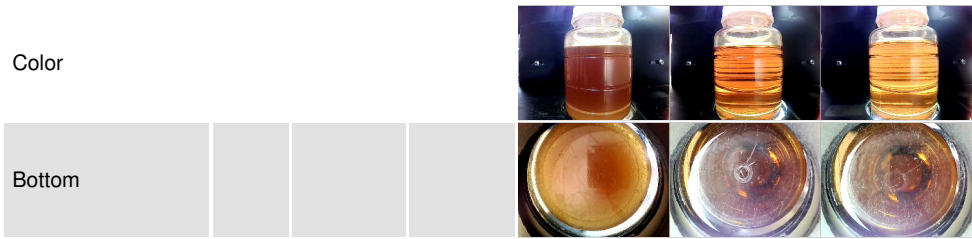

GRAPHS

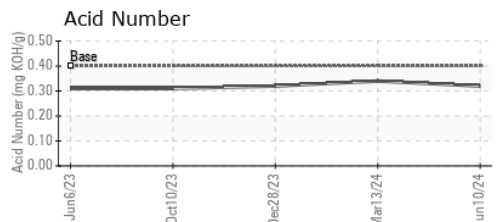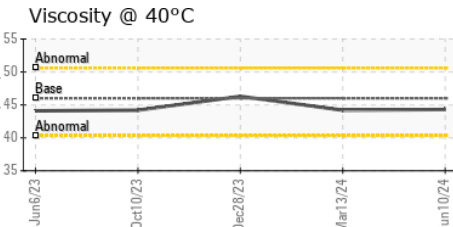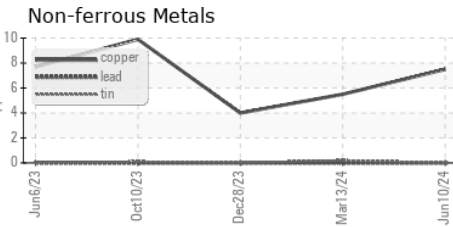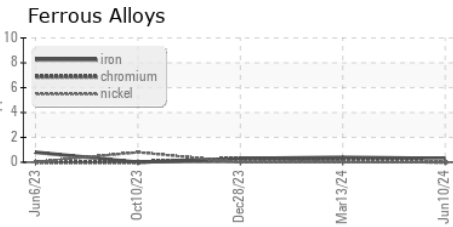

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06221235
Lab Number : 06221235
Unique Number : 11099432
Test Package : IND 2
Received : 26 Jun 2024
Tested : 27 Jun 2024
Diagnosed : 27 Jun 2024 - Don Baldrige

SAWSTREET
 6450 KINGSPORTE PKWY
 ORLANDO, FL
 US 32819
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)