

OIL ANALYSIS REPORT





Area [SV2405290435] **CARRIER 3211092161**

Component Compressor

{not provided} (--- GAL)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

,						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0814441		
Sample Date		Client Info		18 Jun 2024		
Machine Age	hrs	Client Info		57930		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		46		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.1	0.024		
ppm Water	ppm	ASTM D6304	>1000	246		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045

0.014



OIL ANALYSIS REPORT

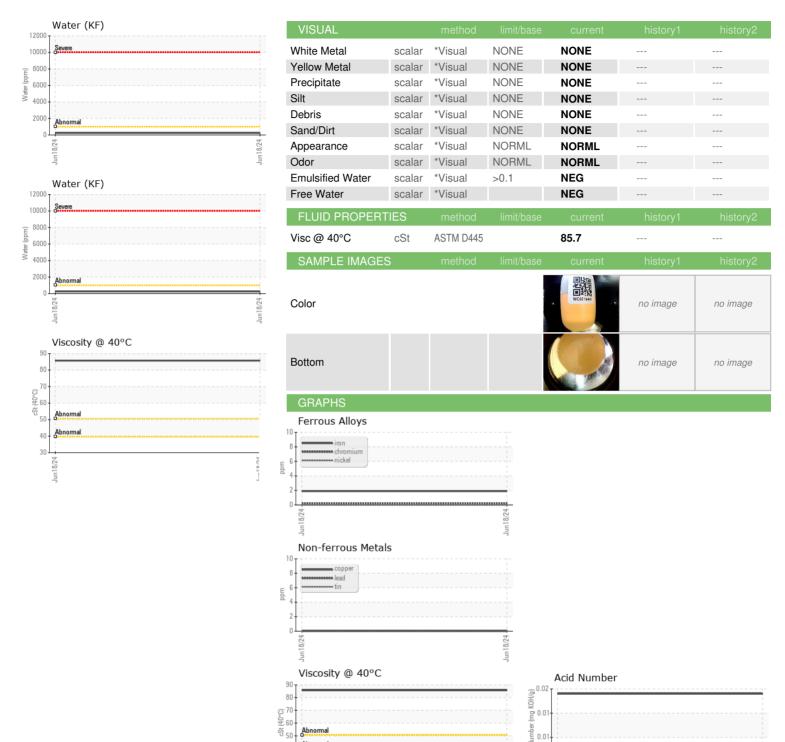





Certificate 12367

Laboratory

Sample No. Lab Number : 06221310

: WC0814441

Unique Number : 11099507

Abnon 40

30

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received **Tested** Diagnosed

: 26 Jun 2024 : 27 Jun 2024 : 28 Jun 2024 - Jonathan Hester

0.01

Acid

DAIKIN APPLIED 5021 HOWERTON WAY SUITE P BOWIE, MD US 20715

Test Package : IND 2 (Additional Tests: KF) Contact: ANDREW TURLINGTON To discuss this sample report, contact Customer Service at 1-800-237-1369. andrew.turlington@daikinapplied.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ANDREW TURLINGTON - MCQUPP

T: (301)735-1440

F: (301)735-1838