




# OIL ANALYSIS REPORT

## Sample Rating Trend

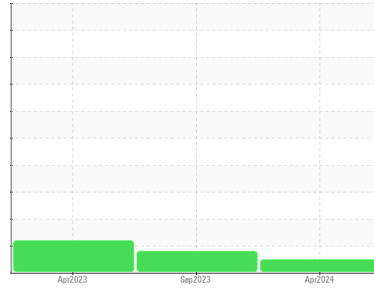

**NORMAL**



Area

**[2402190138/1]**

Machine Id

**TRANE Y & S CANDY CHILLER 4 (S/N L93H08342)**

Component

**Refrigeration Compressor**

Fluid

**TRANE 0022 (8 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0798543</b>	WC0664532	WC0664531
Sample Date	Client Info		<b>10 Apr 2024</b>	22 Sep 2023	27 Apr 2023
Machine Age	hrs	Client Info	<b>108658</b>	108500	107293
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	ABNORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	5	10
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m >4	<b>10</b>	13	12
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	3	0
Phosphorus	ppm	ASTM D5185m	<b>15</b>	8	1
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	<1
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	12

### CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	4	8
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	<1
Water	%	ASTM D6304 >0.005	<b>0.002</b>	0.00	0.001
ppm Water	ppm	ASTM D6304 >50	<b>18</b>	0.00	8.5

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.05</b>	0.042	▲ 0.119




# OIL ANALYSIS REPORT

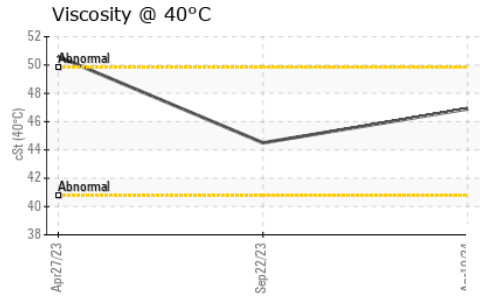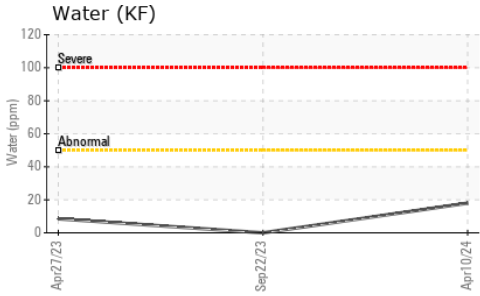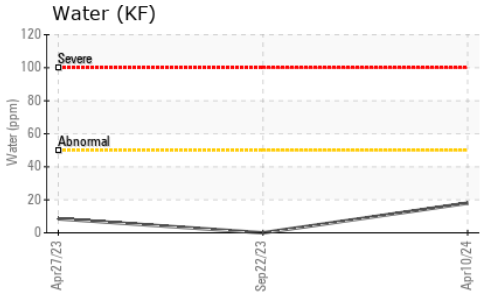





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.005	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.9	44.5	50.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

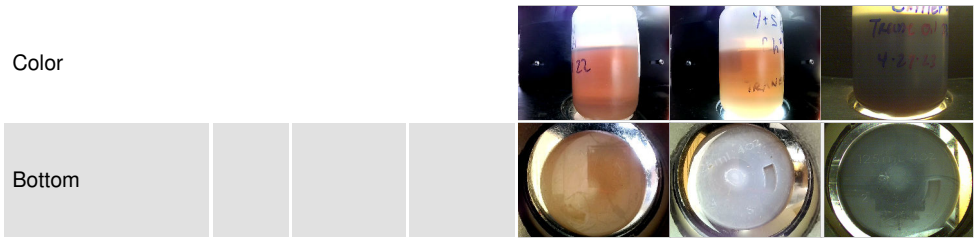

## GRAPHS

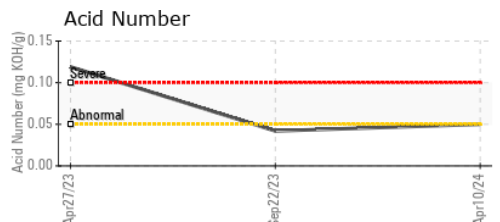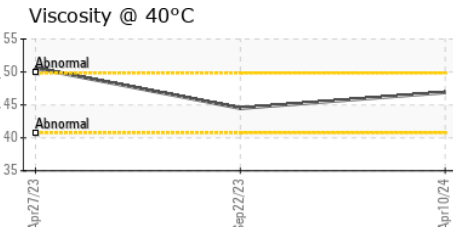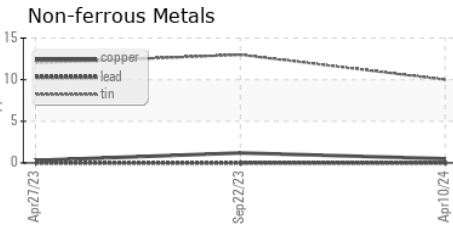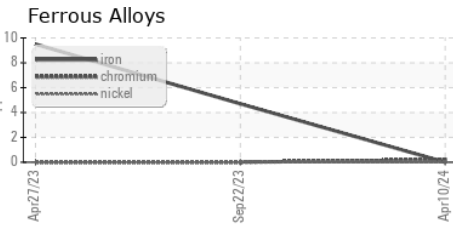

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0798543  
**Lab Number** : 06221314  
**Unique Number** : 11099511  
**Test Package** : IND 2  
**Received** : 26 Jun 2024  
**Tested** : 27 Jun 2024  
**Diagnosed** : 28 Jun 2024 - Angela Borella

**DAIKIN APPLIED**  
 5021 HOWERTON WAY SUITE P  
 BOWIE, MD  
 US 20715  
 Contact: ANDREW TURLINGTON  
 andrew.turlington@daikinapplied.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (301)735-1440  
 F: (301)735-1838