

**NORMAL**



Area

**TRIDEN SYNLUBE 669**

Machine Id

**SULLAIR 201311150107 - US STEEL-COLD MILL**

Component

**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) COMPRESSOR OIL (PAG) ISO 46. Please confirm.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>JHF0000022</b>	UCH06123821	UCH05936198
Sample Date	Client Info		<b>10 Jun 2024</b>	21 Feb 2024	20 Aug 2023
Machine Age	hrs	Client Info	<b>30223</b>	30129	26656
Oil Age	hrs	Client Info	<b>94</b>	3767	296
Oil Changed	Client Info		<b>Not Chngd</b>	Changed	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

**CONTAMINATION**

	method	limit/base	current	history1	history2
Water	WC Method	>0.8	<b>NEG</b>	NEG	NEG

**WEAR METALS**

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	2	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 525	<b>252</b>	191	183
Molybdenum	ppm	ASTM D5185m 10	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m 10	<b>0</b>	3	8
Phosphorus	ppm	ASTM D5185m 250	<b>0</b>	2	11
Zinc	ppm	ASTM D5185m 100	<b>4</b>	23	11
Sulfur	ppm	ASTM D5185m 400	<b>403</b>	444	478



**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>33</b>	28	34
Potassium	ppm	ASTM D5185m >20	<b>4</b>	3	4

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.19</b>	0.42	0.14


# OIL ANALYSIS REPORT

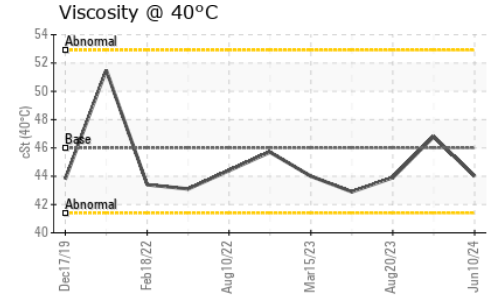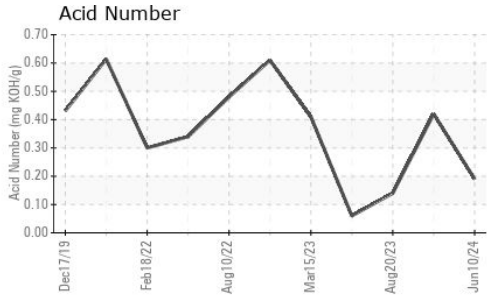





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.8	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>44.0</b>	46.8	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

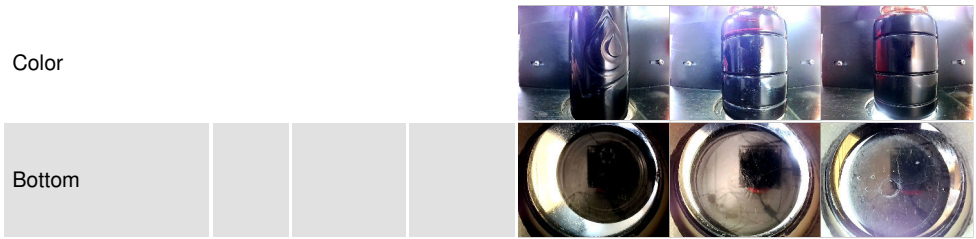

## GRAPHS

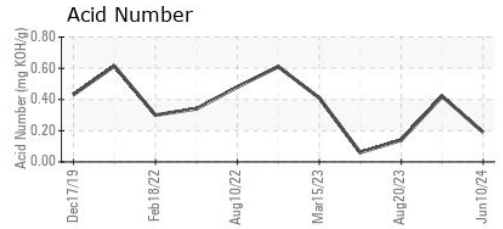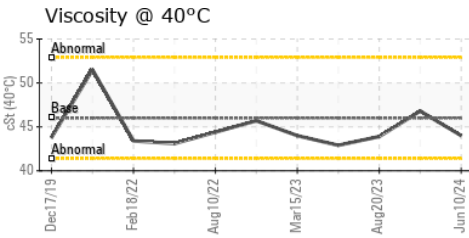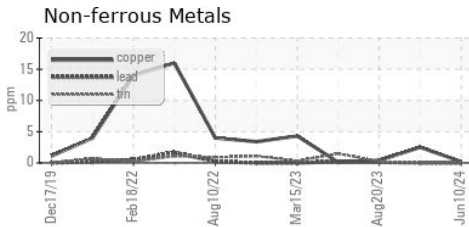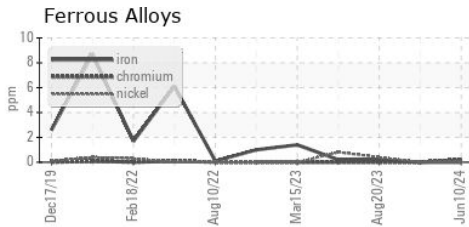

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JHF0000022  
**Lab Number** : 06221370  
**Unique Number** : 11099567  
**Test Package** : IND 2

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhf.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (314)593-1267  
 F: (314)874-0965