




FUEL REPORT

Sample Rating Trend

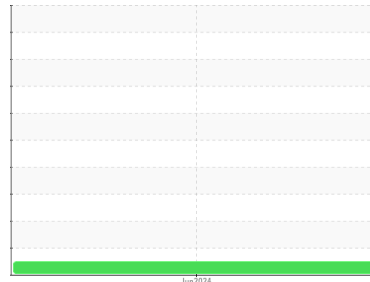

NORMAL



Machine Id
PALM BEACH CO BOCC CRIMINAL JUSTICE COMPLEX B
 Component
Bulk Tank Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

Light concentration of visible dirt/debris present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.



| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | WCDF4635 | --- | --- |
| Sample Date | Client Info | | | 20 Jun 2024 | --- | --- |
| Machine Age | mls | Client Info | | 0 | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|--------|-------------|------------|-------------|----------|----------|
| ASTM Color | scalar | *ASTM D1500 | | L3.5 | --- | --- |
| Visc @ 40°C | cSt | ASTM D445 | 3.0 | 2.57 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|-----------|----------|----------|
| Sulfur | ppm | ASTM D5185m | 10 | 0 | --- | --- |
| Sulfur (UVF) | ppm | ASTM D5453 | | 10 | --- | --- |



| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.007 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 75 | --- | --- |
| % Gasoline | % | *In-House | <0.50 | 0.0 | --- | --- |
| % Biodiesel | % | *In-House | <20.0 | 0.0 | --- | --- |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|----------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |


| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---|----------|----------|
| Color | | | |  | no image | no image |
| Bottom | | | |  | no image | no image |



FUEL REPORT

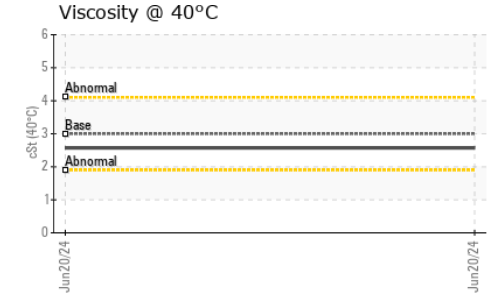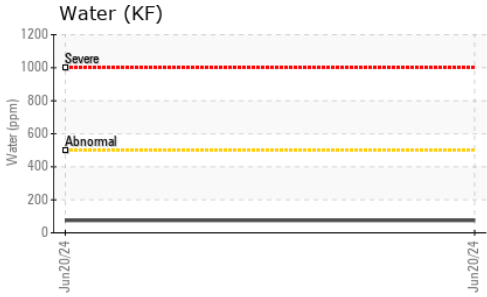

GRAPHS

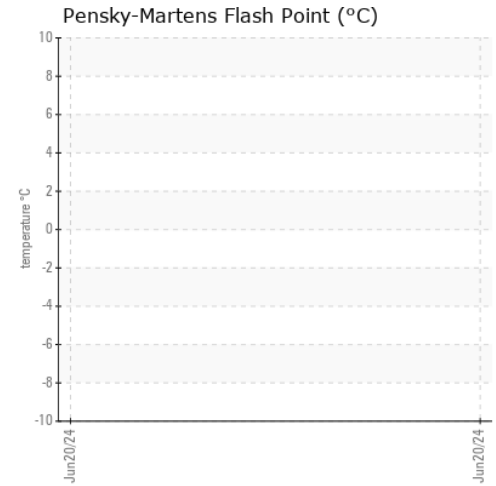

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WCDF4635 **Received** : 26 Jun 2024
Lab Number : 06221763 **Tested** : 03 Jul 2024
Unique Number : 11099960 **Diagnosed** : 03 Jul 2024 - Elizabeth Valachovic
Test Package : DF-5 (Additional Tests: PriCount, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TANK WIZARDS
 1511 MASTERS RD NW
 PALM BAY, FL
 US 32907

Contact: WENDALL STRODERD
 wendall@tankwizards.com

T: (321)427-5149

F: (321)574-4131