


# **OIL ANALYSIS REPORT**

Sample Rating Trend

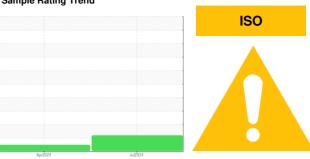

Machine Id

# **KAESER 8139464**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2024	Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130679	KC130884	
Sample Date		Client Info		08 Jul 2024	05 Apr 2024	
Machine Age	hrs	Client Info		4816	4448	
Oil Age	hrs	Client Info		5425	207	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	0	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	40	71	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	71	77	
Calcium	ppm	ASTM D5185m	0	4	1	
Phosphorus	ppm	ASTM D5185m	0	4	0	
Zinc	ppm	ASTM D5185m	0	15	0	
CONTAMINANTS	)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		16	11	
Potassium	ppm	ASTM D5185m	>20	3	0	
Water	%	ASTM D6304	>0.05	0.012	0.019	
ppm Water	ppm	ASTM D6304	>500	127	192	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7157	1805	
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2792	440	
Particles >14µm		ASTM D7647	>80	<u> </u>	33	
Particles >21µm		ASTM D7647	>20	6	7	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/14	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.38	0.36	



## **OIL ANALYSIS REPORT**







Laboratory Sample No. Lab Number

: KC130679 : 06233842 Unique Number : 11122676 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jul 2024 **Tested** : 12 Jul 2024

Diagnosed : 13 Jul 2024 - Don Baldridge

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ROBERT BANE - HORBURKC

US 15021

T:

F:

**HORMANN FLEXON** 

117 STARPOINT BLVD

BURGETTSTOWN, PA

Contact: ROBERT BANE

R.BANE@HORMANN.US