


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 8125910

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2024	Jul2024		
			Apizoza	00E027		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130663	KC130887	
Sample Date		Client Info		08 Jul 2024	05 Apr 2024	
Machine Age	hrs	Client Info		5746	5173	
Oil Age	hrs	Client Info		5119	308	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	0	0	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m	>10	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES	1-1-		limit/base	ou we ont	historia	history2
		method		current	history1	
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	49	76	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	71	76	
Calcium	ppm	ASTM D5185m	0	2	1	
Phosphorus	ppm	ASTM D5185m	0	<1	<1	
Zinc	ppm	ASTM D5185m	0	11	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		18	12	
Potassium	ppm	ASTM D5185m	>20	2	<1	
Water	%	ASTM D6304	>0.05	0.039	0.016	
ppm Water	ppm	ASTM D6304	>500	394	166	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1217	1743	
Particles >6µm		ASTM D7647	>1300	319	422	
Particles >14μm		ASTM D7647	>80	14	29	
Particles >21µm		ASTM D7647	>20	1	7	
Particles >38μm		ASTM D7647	>4	0	1	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	18/16/12	
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2
A atal Nicosale and (AND	1/011/	AOTH Doors	1.0		0.00	

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.36

0.35



OIL ANALYSIS REPORT

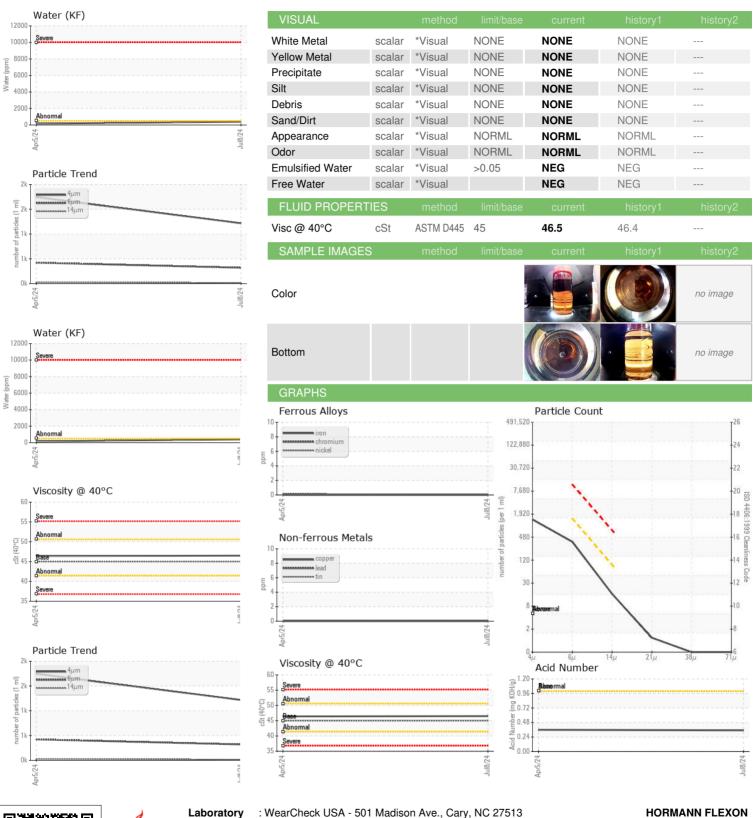



Laboratory Sample No. : KC130663 Lab Number : 06233848 Unique Number : 11122682

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jul 2024 **Tested** : 12 Jul 2024

Diagnosed : 13 Jul 2024 - Don Baldridge

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: ROBERT BANE R.BANE@HORMANN.US T:

117 STARPOINT BLVD

BURGETTSTOWN, PA

US 15021

F: