


OIL ANALYSIS REPORT

Sample Rating Trend

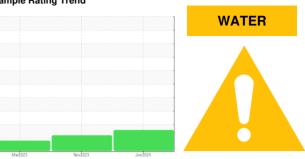

Machine Id

KAESER DSG290-2W 7720216 (S/N 1293)

Compressor

KAESER G-680 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	VIATION		IIIIII Dase			
Sample Number		Client Info		KCPA018635	KCPA004559	KC91008
Sample Date		Client Info		05 Jun 2024	06 Nov 2023	29 Mar 2023
Machine Age	hrs	Client Info		17413	14020	10236
Oil Age	hrs	Client Info		3394	0	1864
Oil Changed		Client Info		Changed	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	1	<u> </u>
Copper	ppm	ASTM D5185m	>50	0	0	8
Tin	ppm	ASTM D5185m	>10	0	1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	11
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		3	1	0
Calcium	ppm	ASTM D5185m		0	2	0
Phosphorus	ppm	ASTM D5185m		1655	1452	1095
Zinc	ppm	ASTM D5185m		2	0	14
Sulfur	ppm	ASTM D5185m		118	49	145
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	2
Sodium	ppm	ASTM D5185m	00	0	0	2
Potassium	ppm	ASTM D5185m	>20	0	1	0
Water ppm Water	% ppm	ASTM D6304 ASTM D6304	>0.05	△ 0.062 △ 629	0.047 473	0.028 285.3
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm Particles >6µm		ASTM D7647 ASTM D7647	>1300	662 198	619 112	
Particles >6µm		ASTM D7647	>80	13		
Particles >14µm Particles >21µm				3	8	
•		ASTM D7647				
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm Oil Cleanliness		ASTM D7647 ISO 4406 (c)		17/15/11	16/14/10	
			>/17/13	17/15/11	16/14/10	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.52	<u>2.42</u>	0.28



OIL ANALYSIS REPORT

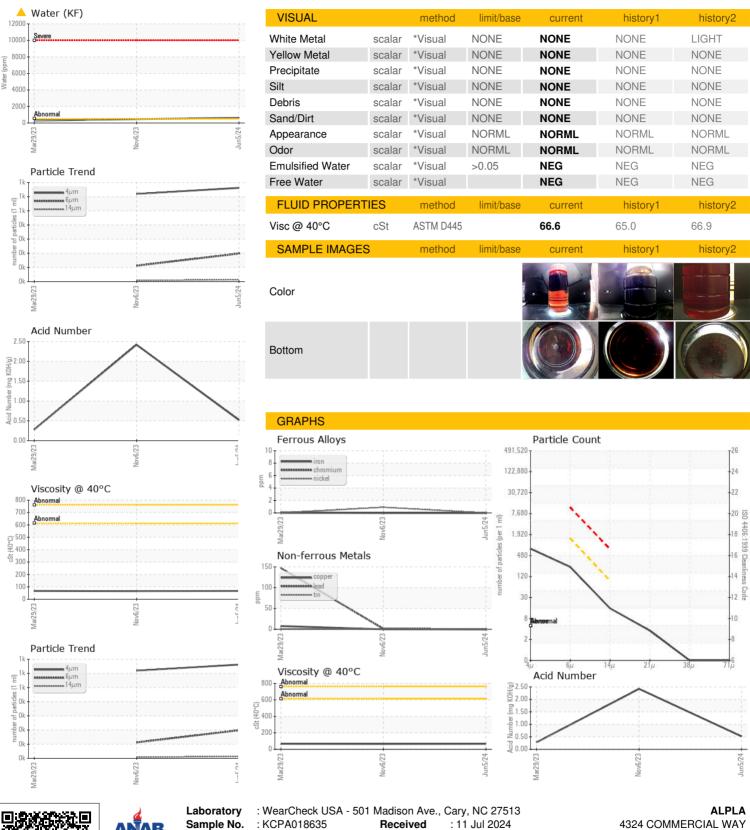



Certificate 12367

Sample No.

Lab Number

: 06233852

: KCPA018635 Unique Number : 11122686

Tested Diagnosed

: 13 Jul 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 12 Jul 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - ALPSALUT

US 84104

T:

F:

SALT LAKE CITY, UT

Contact: Service Manager