


OIL ANALYSIS REPORT

Sample Rating Trend

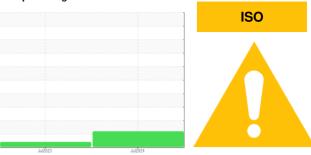

Machine Id

8782485 (S/N 1187) Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | L | Jul2023 | Jul2024 | | |
|---------------------|------------------|---------------|---|---------------------------|------------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| 0 22 0 | <i>I</i> /(1101) | | IIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIII | | • | |
| Sample Number | | Client Info | | KCPA020067 01 Jul 2024 | KCPA004045 | |
| Sample Date | hvo | Client Info | | 8468 | 3429 | |
| Machine Age Oil Age | hrs hrs | Client Info | | 8468 | 0 | |
| Oil Changed | 1115 | Client Info | | Changed | N/A | |
| Sample Status | | Ciletit IIIIO | | ABNORMAL | ABNORMAL | |
| | | | | ABNORWAL | ABNORWAL | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | <1 | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | 1 | |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Copper | ppm | ASTM D5185m | >50 | 2 | 15 | |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | |
| Manganese | ppm | ASTM D5185m | | 0 | <1 | |
| Magnesium | ppm | ASTM D5185m | 90 | 3 | <1 | |
| Calcium | ppm | ASTM D5185m | 2 | 0 | 0 | |
| Phosphorus | ppm | ASTM D5185m | | <1 | <1 | |
| Zinc | ppm | ASTM D5185m | | 1 | 0 | |
| Sulfur | ppm | ASTM D5185m | | 15604 | 19042 | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | <1 | |
| Sodium | ppm | ASTM D5185m | | 1 | 1 | |
| Potassium | ppm | | >20 | 0 | 0 | |
| Water | % | ASTM D6304 | >0.05 | 0.004 | 0.004 | |
| ppm Water | ppm | ASTM D6304 | >500 | 50 | 49.1 | |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 26290 | | |
| Particles >6µm | | ASTM D7647 | >1300 | <u> </u> | | |
| Particles >14µm | | ASTM D7647 | >80 | A 300 | | |
| Particles >21µm | | ASTM D7647 | | 5 | | |
| Particles >38µm | | ASTM D7647 | >4 | 0 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u>^</u> 22/21/15 | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.43 | 0.44 | |
| AUGU MUNDER (AN) | my NOH/y | 70 LINI D0049 | J.T | 0.70 | 0.77 | |



OIL ANALYSIS REPORT





Laboratory Sample No.

Lab Number : 06233854 Unique Number : 11122688

: KCPA020067 Received **Tested**

: 12 Jul 2024 Diagnosed

: 13 Jul 2024 - Don Baldridge

: 11 Jul 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 42410 Contact: Service Manager

880 N SANDCUT RD

EARLINGTON, KY

T:

F: