


OIL ANALYSIS REPORT

Sample Rating Trend

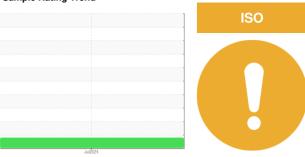

Machine Id

6685799 (S/N 1271)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA014199		
Sample Date		Client Info		05 Jul 2024		
Machine Age	hrs	Client Info		1601		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum		ASTM D5185m		0		
Lead	ppm	ASTM D5185m	>10	0		
	ppm			0		
Copper Tin	ppm	ASTM D5185m		-		
	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	21		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	85		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	7		
Sulfur	ppm	ASTM D5185m	23500	24912		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	720	22		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D5103111	>0.05	0.025		
ppm Water	ppm	ASTM D6304	>500	256		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4511		
Particles >4µm		ASTM D7647	>1300	1382		
•						
Particles >14µm		ASTM D7647	>80	33		
Particles >21µm		ASTM D7647	>20	5		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39		



OIL ANALYSIS REPORT

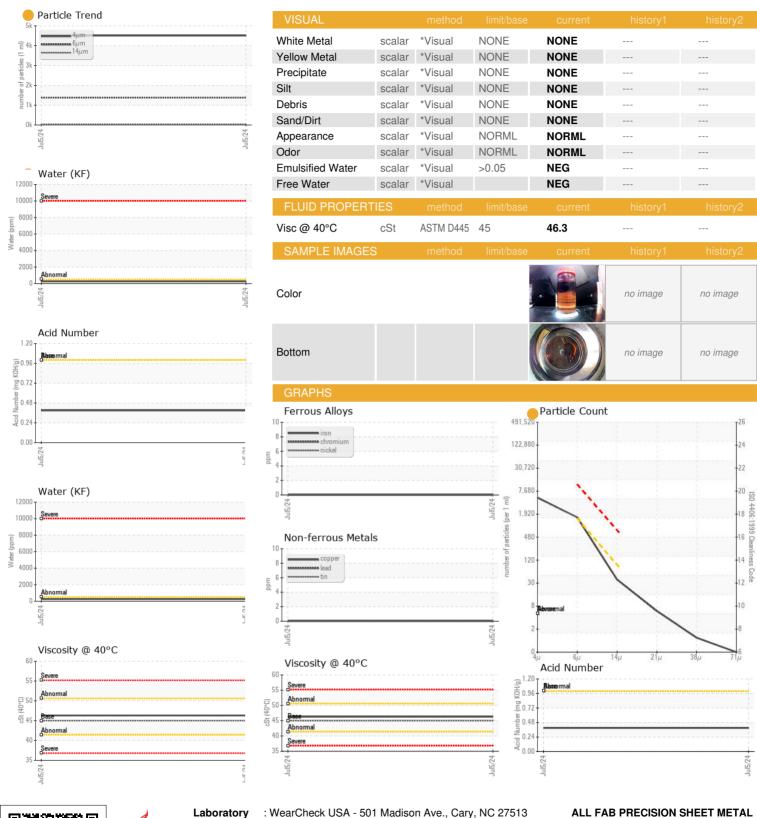





Certificate 12367

Laboratory Sample No.

: KCPA014199

Lab Number : 06233861 Unique Number : 11122695

Tested Diagnosed

Received

: 11 Jul 2024

: 12 Jul 2024

: 13 Jul 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Service Manager T:

Report Id: ALLSANCALI [WUSCAR] 06233861 (Generated: 07/13/2024 13:55:12) Rev: 1

Contact/Location: Service Manager - ALLSANCALI

1015 TIMOTHY DR

SAN JOSE, CA

US 95133

F: