




# OIL ANALYSIS REPORT

## Sample Rating Trend

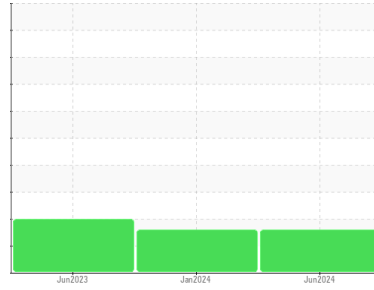

ISO



Machine Id  
**7923851 (S/N 1729)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC129302</b>	KC06066842	KC111558
Sample Date	Client Info			<b>25 Jun 2024</b>	11 Jan 2024	02 Jun 2023
Machine Age	hrs	Client Info		<b>3783</b>	2701	1905
Oil Age	hrs	Client Info		<b>3500</b>	0	520
Oil Changed	Client Info			<b>Changed</b>	N/A	Not Changd
Sample Status				<b>ABNORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	3	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>30</b>	17	56
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	100	<b>79</b>	79	89
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	3	2
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	0	2
Zinc	ppm	ASTM D5185m	0	<b>6</b>	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m		<b>11</b>	10	9
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.026</b>	0.025	0.016
ppm Water	ppm	ASTM D6304	>500	<b>262</b>	258	168.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>20441</b>	6248	40812
Particles >6µm		ASTM D7647	>1300	<b>▲ 7310</b>	● 2064	▲ 16483
Particles >14µm		ASTM D7647	>80	<b>▲ 424</b>	● 155	▲ 1027
Particles >21µm		ASTM D7647	>20	<b>▲ 61</b>	● 34	▲ 187
Particles >38µm		ASTM D7647	>4	<b>4</b>	1	▲ 14
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 22/20/16</b>	● 20/18/14	▲ 23/21/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.36</b>	0.133	0.36


# OIL ANALYSIS REPORT

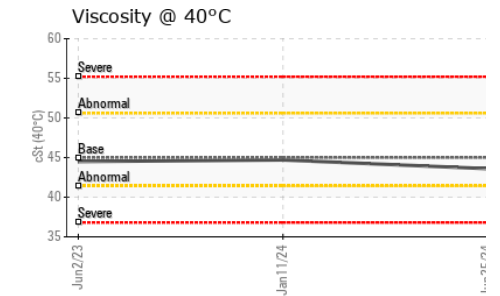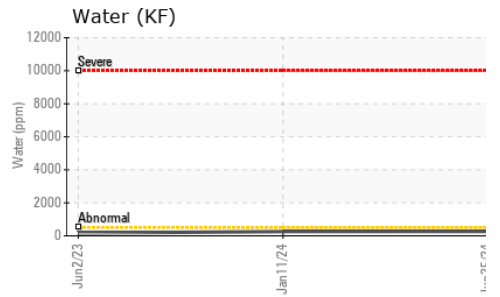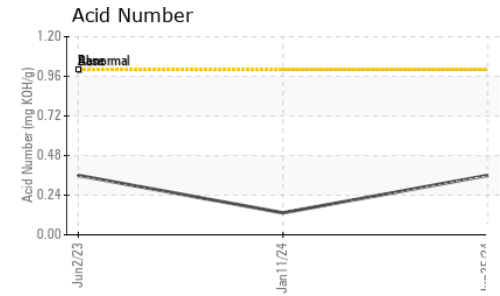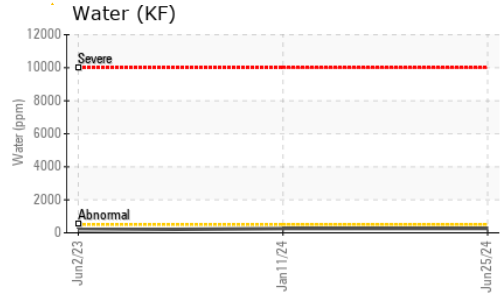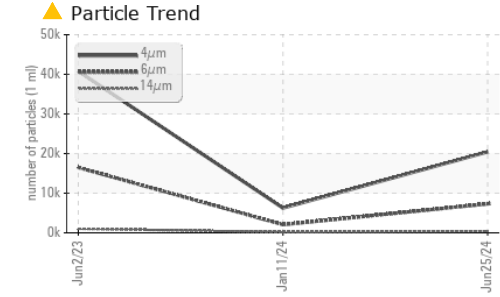



PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.6	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

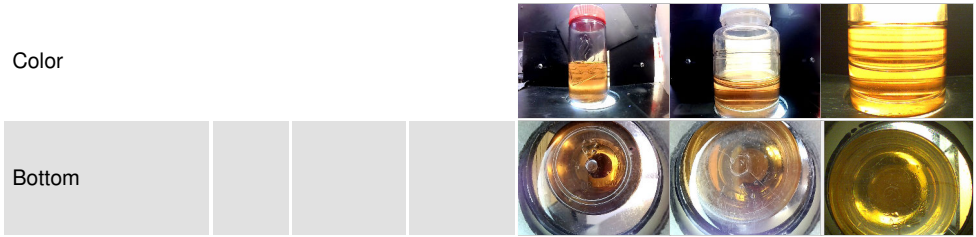

## GRAPHS

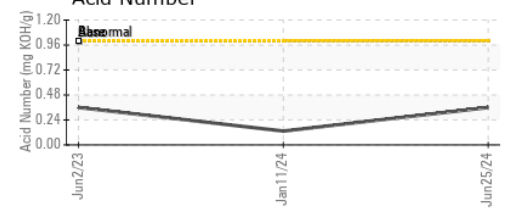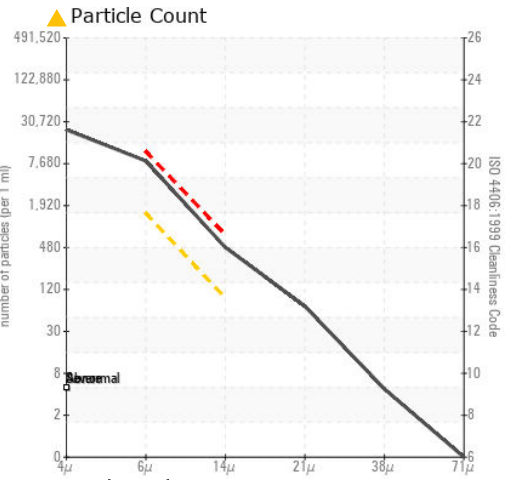

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129302  
**Lab Number** : 06233862  
**Unique Number** : 11122696  
**Test Package** : IND 2  
**Received** : 11 Jul 2024  
**Tested** : 12 Jul 2024  
**Diagnosed** : 13 Jul 2024 - Don Baldrige

**BRIDGEPORT MANUFACTURING**  
 6693 DIXIE HWY  
 BRIDGEPORT, MI  
 US 48722  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)