




# OIL ANALYSIS REPORT

## Sample Rating Trend

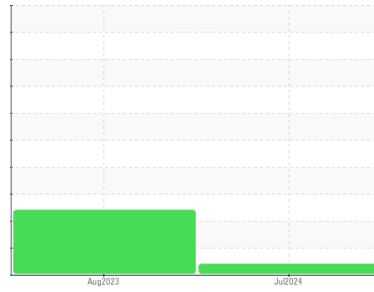

VIS DEBRIS



Area

[73609785]

Machine Id

KAESER CSD-100 6989318 (S/N 1017)

Component

Compressor

Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA014178	KCPA003627	---
Sample Date	Client Info		08 Jul 2024	29 Aug 2023	---
Machine Age	hrs	Client Info	25591	23276	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		Changed	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	6	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	8	▲ 14	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	0	1	---
Tin	ppm	ASTM D5185m >10	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	1	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m	2	<1	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m 500	82	113	---
Zinc	ppm	ASTM D5185m	22	26	---
Sulfur	ppm	ASTM D5185m	1616	1192	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	---
Sodium	ppm	ASTM D5185m	1	0	---
Potassium	ppm	ASTM D5185m >20	0	1	---
Water	%	ASTM D6304 >0.05	0.004	0.008	---
ppm Water	ppm	ASTM D6304 >500	45	82.9	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5842	19939	---
Particles >6µm	ASTM D7647	>1300	1045	▲ 2724	---
Particles >14µm	ASTM D7647	>80	33	▲ 108	---
Particles >21µm	ASTM D7647	>20	6	▲ 30	---
Particles >38µm	ASTM D7647	>4	1	3	---
Particles >71µm	ASTM D7647	>3	1	0	---
Oil Cleanliness	ISO 4406 (c)	>17/13	17/12	▲ 19/14	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	0.44	0.53	---


# OIL ANALYSIS REPORT

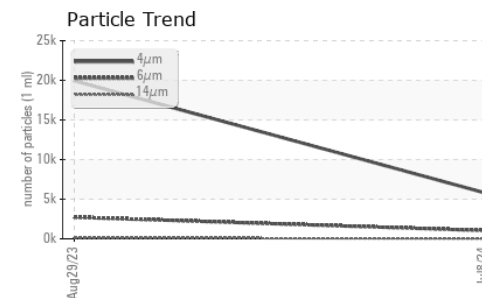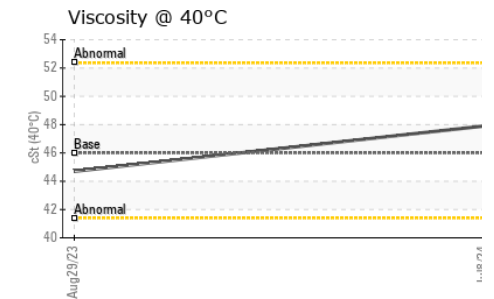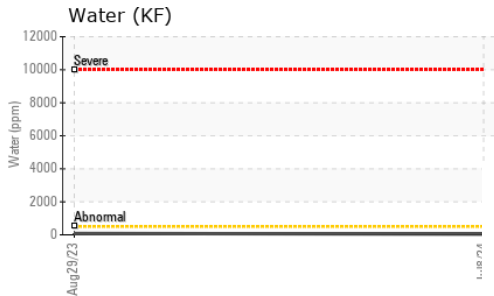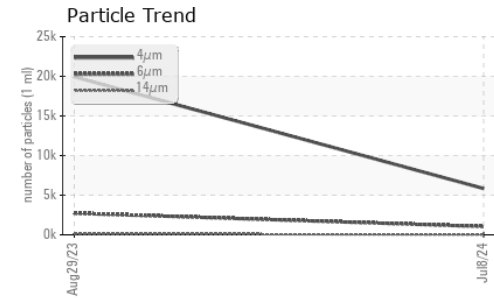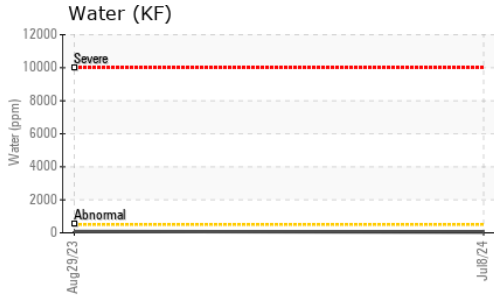






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.9	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

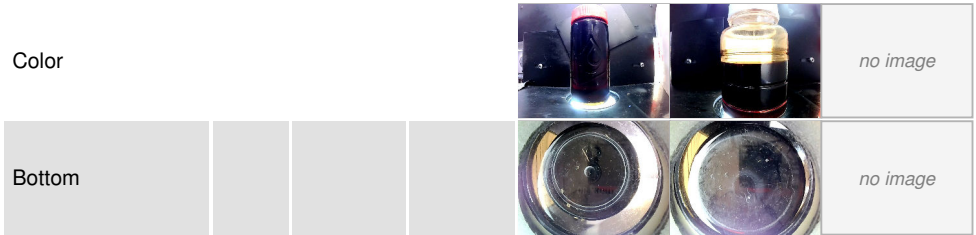

## GRAPHS

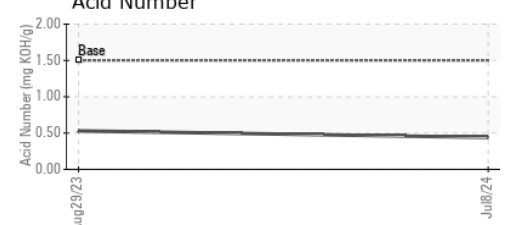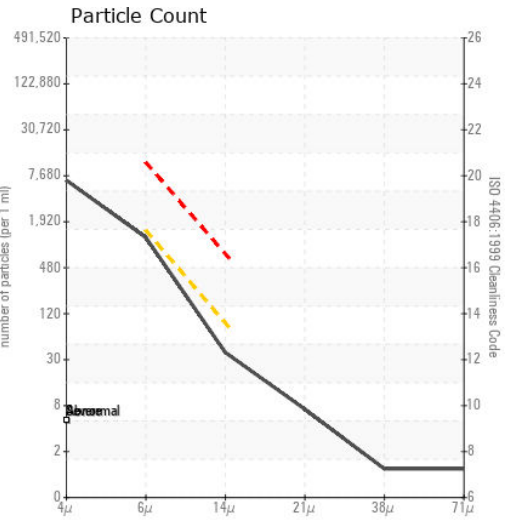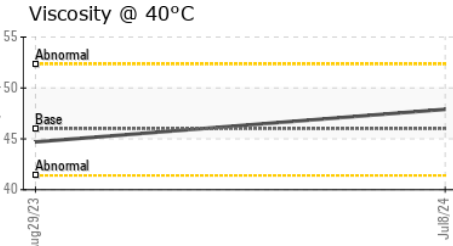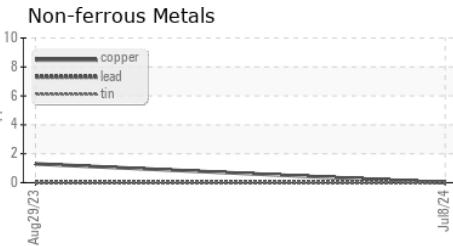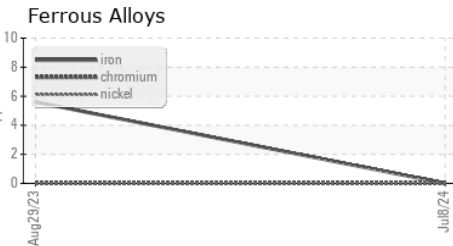

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014178 **Received** : 11 Jul 2024  
**Lab Number** : 06233866 **Tested** : 12 Jul 2024  
**Unique Number** : 11122700 **Diagnosed** : 13 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GEORGE CHIALA FARMS INC**  
 9351 FIARVIEW RD  
 HOLLISTER, CA  
 US 95023  
 Contact: JIM CASILLAS  
 JIM.CASILLAS@GCFARMS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)