


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# FES B306 (S/N 3211259)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


ct2013 Apr2015 May2016 Apr2017 Aug2018 Ju2019 Oct2022 Apr2023 Apr2024										
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2				
Sample Number		Client Info		USP0012168	USP0006747	USP0001224				
Sample Date		Client Info		11 Jul 2024	11 Apr 2024	15 Oct 2023				
Machine Age	hrs	Client Info		0	0	0				
Oil Age	hrs	Client Info		0	0	0				
Oil Changed		Client Info		N/A	N/A	N/A				
Sample Status				NORMAL	NORMAL	NORMAL				
WEAR METALS		method	limit/base	current	history1	history2				
Iron	ppm	ASTM D5185m	>8	0	2	<1				
Chromium	ppm	ASTM D5185m	>2	0	<1	0				
Nickel	ppm	ASTM D5185m		0	<1	<1				
Titanium	ppm	ASTM D5185m		0	<1	0				
Silver	ppm	ASTM D5185m	>2	0	0	0				
Aluminum	ppm	ASTM D5185m	>3	0	1	0				
Lead	ppm	ASTM D5185m	>2	0	1	<1				
Copper	ppm	ASTM D5185m	>8	0	<1	0				
Tin	ppm	ASTM D5185m	>4	0	1	0				
Vanadium	ppm	ASTM D5185m		0	<1	0				
Cadmium	ppm	ASTM D5185m		0	1	0				
ADDITIVES		method	limit/base	current	history1	history2				
Boron	ppm	ASTM D5185m		0	0	0				
Barium	ppm	ASTM D5185m		0	0	0				
Molybdenum	ppm	ASTM D5185m		0	<1	0				
Manganese	ppm	ASTM D5185m		0	<1	0				
Magnesium	ppm	ASTM D5185m		<1	0	0				
Calcium	ppm	ASTM D5185m		0	0	0				
Phosphorus	ppm	ASTM D5185m		<1	0	0				
Zinc	ppm	ASTM D5185m		<1	0	<1				
Sulfur	ppm	ASTM D5185m	50	20	0	0				
CONTAMINANTS		method	limit/base	current	history1	history2				
Silicon	ppm	ASTM D5185m	>15	5	6	2				
Sodium	ppm	ASTM D5185m		0	0	0				
Potassium	ppm	ASTM D5185m	>20	0	<1	<1				
Water	%	ASTM D6304	>0.01	0.002	0.005	0.007				
ppm Water	ppm	ASTM D6304	>100	21	56	70.6				
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2				
Particles >4µm		ASTM D7647	>10000	1783	1505	485				
Particles >6µm		ASTM D7647	>2500	422	401	150				
Particles >14µm		ASTM D7647	>320	8	22	13				
Particles >21µm		ASTM D7647	>80	0	5	2				
Particles >38µm		ASTM D7647	>20	0	1	0				
Particles >71µm		ASTM D7647	>4	0	0	0				
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/10	18/16/12	16/14/11				
FLUID DEGRADA	TION	method	limit/base	current	history1	history2				
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.015				





## **OIL ANALYSIS REPORT**













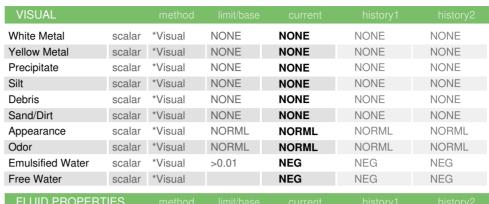

I LOID I HOI LITTILO							
Visc @ 40°C	cSt	ASTM D445	67	63.1	65.1	65.1	

SAMPLE IMAGES Color



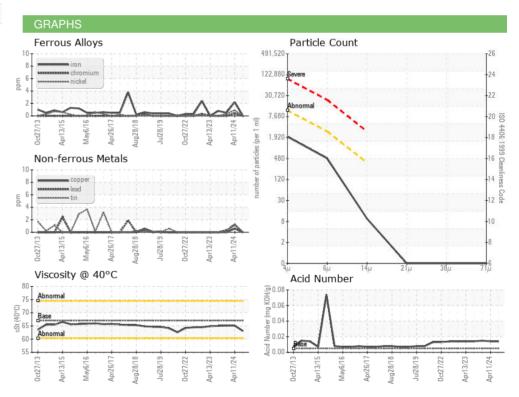





Certificate 12367

Laboratory Sample No. Lab Number

: USP0012168 : 06233882 Unique Number : 11122716 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jul 2024 **Tested** : 15 Jul 2024

Diagnosed : 15 Jul 2024 - Doug Bogart

**TYSON-NORTH RICHLAND HILLS-USP** 

6350 BLOWN CT NORTH RICHLAND HILLS, TX US 76180

Contact: JOHN MORGAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T: (817)514-3519 F: