


# **OIL ANALYSIS REPORT**

# PG46 [SO-282365] **ATLAS COPCO API211688 - SCHLEIFRING**

Component Compressor

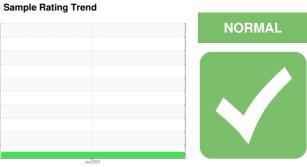

### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### Fluid Condition

The condition of the oil is acceptable for the time in service.

				Jun2024		
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001097		
Sample Date		Client Info		27 Jun 2024		
Machine Age	hrs	Client Info		16858		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		251		
Zinc	ppm	ASTM D5185m		10		
Sulfur	ppm	ASTM D5185m		779		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
	1/01::					


0.33

Acid Number (AN)

mg KOH/g ASTM D8045



# **OIL ANALYSIS REPORT**

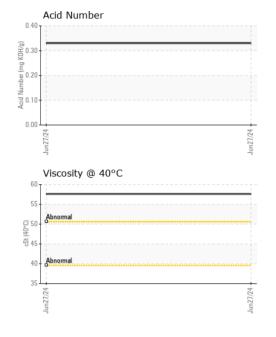



scalar scalar	method *Visual	limit/base	current	history1	history2
	*Visual	NONE			
scalar		NONE	NONE		
	*Visual	NONE	NONE		
scalar	*Visual	NONE	NONE		
scalar	*Visual	NONE	NONE		
scalar	*Visual	NONE	NONE		
scalar	*Visual	NONE	NONE		
scalar	*Visual	NORML	NORML		
scalar	*Visual	NORML	NORML		
scalar	*Visual	>0.1	NEG		
scalar	*Visual		NEG		
ES	method	limit/base	current	history1	history2
cSt	ASTM D445		57.6		
	method	limit/base	current	history1	history2
				no image	no image
	scalar scalar scalar scalar scalar scalar scalar	*Visual scalar *ASTM D445	scalar *Visual NONE scalar *Visual NONE scalar *Visual NONE scalar *Visual NORML scalar *Visual NORML scalar *Visual NORML scalar *Visual >0.1 scalar *Visual scalar *Visual scalar *Visual scalar *ASTM D445	scalar *Visual NONE NONE scalar *Visual NONE NONE scalar *Visual NONE NONE scalar *Visual NORML NORML scalar *Visual NORML NORML scalar *Visual NORML NORML scalar *Visual >0.1 NEG scalar *Visual NORML NORML scalar	scalar *Visual NONE NONE scalar *Visual NONE NONE scalar *Visual NONE NONE scalar *Visual NORML NORML scalar *Visual NEG scalar *Visual NORML NORML


## **GRAPHS** Ferrous Alloys

**Bottom** 









no image

no image





Certificate 12367

Laboratory Sample No.

Lab Number : 06233950 Unique Number : 11122784

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0001097 Received Tested

Diagnosed

: 15 Jul 2024 : 15 Jul 2024 - Sean Felton

: 11 Jul 2024

US 60143 Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

**FLUID-AIRE DYNAMICS** 

225 SPRING LAKE DR

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact/Location: ED DIENER - UCFLUSCH

Report Id: UCFLUSCH [WUSCAR] 06233950 (Generated: 07/15/2024 10:46:09) Rev: 1

ITASCA, IL