


# OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY

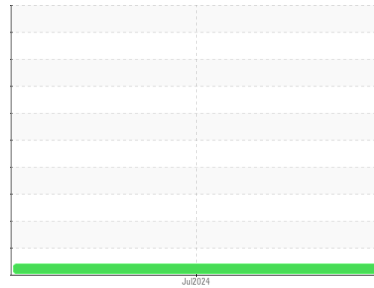

Machine Id  
**CUMMINS LD MANN S**  
Component  
**Port Genset**  
Fluid  
**KENDALL D3 40WT (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The oil viscosity is higher than normal. The BN result indicates that there is suitable alkalinity remaining in the oil.

**SAMPLE INFORMATION**    method    limit/base    current    history1    history2

Sample Number	Client Info		<b>HRE0000267</b>	---	---
Sample Date	Client Info		<b>05 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>11852</b>	---	---
Oil Age	hrs	Client Info	<b>1000</b>	---	---
Oil Changed		Client Info	<b>Not Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

**CONTAMINATION**    method    limit/base    current    history1    history2

Fuel	WC Method	>4.0	<b>&lt;1.0</b>	---	---
Water	WC Method	>0.1	<b>NEG</b>	---	---
Glycol	WC Method		<b>NEG</b>	---	---

**WEAR METALS**    method    limit/base    current    history1    history2

Iron	ppm	ASTM D5185m	>50	<b>53</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>1</b>	---	---
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>5</b>	---	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>12	<b>4</b>	---	---
Lead	ppm	ASTM D5185m	>17	<b>6</b>	---	---
Copper	ppm	ASTM D5185m	>70	<b>14</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES**    method    limit/base    current    history1    history2

Boron	ppm	ASTM D5185m		<b>18</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>17</b>	---	---
Manganese	ppm	ASTM D5185m		<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>91</b>	---	---
Calcium	ppm	ASTM D5185m		<b>3537</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>821</b>	---	---
Zinc	ppm	ASTM D5185m		<b>1032</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>3846</b>	---	---

**CONTAMINANTS**    method    limit/base    current    history1    history2

Silicon	ppm	ASTM D5185m	>25	<b>7</b>	---	---
Sodium	ppm	ASTM D5185m		<b>6</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---




**INFRA-RED**    method    limit/base    current    history1    history2

Soot %	%	*ASTM D7844		<b>0.5</b>	---	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>16.3</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>28.1</b>	---	---

**FLUID DEGRADATION**    method    limit/base    current    history1    history2

Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>31.5</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		<b>6.8</b>	---	---





# OIL ANALYSIS REPORT

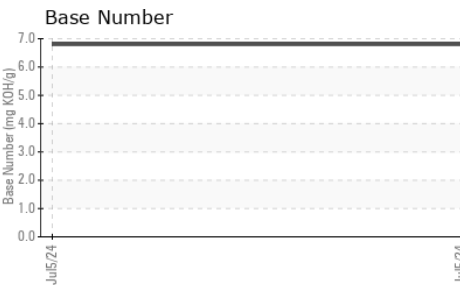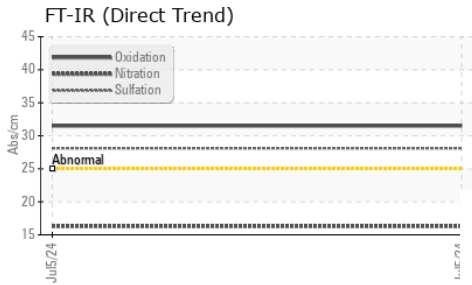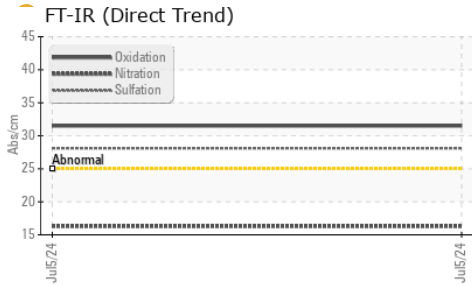

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	● 17.5	---	---

### GRAPHS

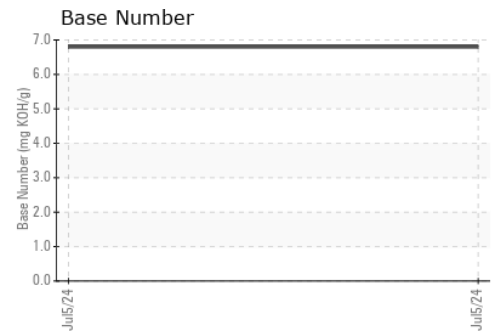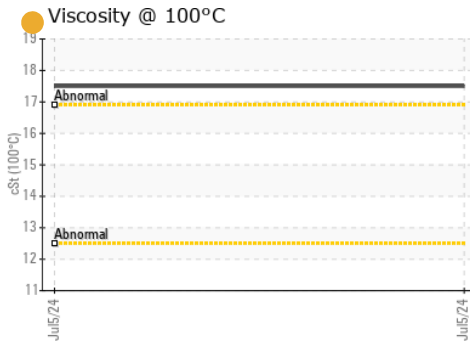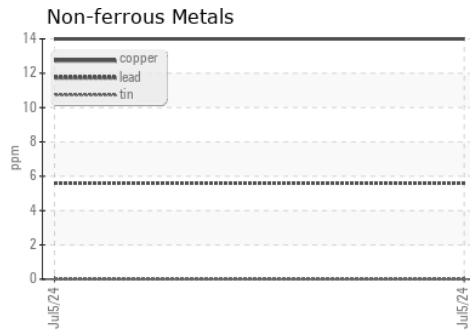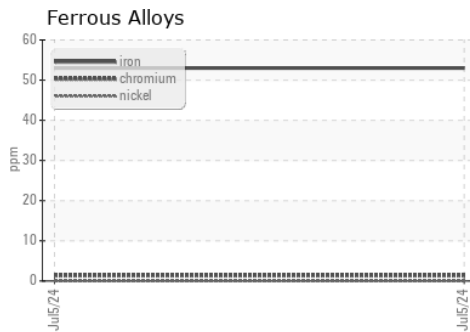

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HRE0000267      **Received** : 11 Jul 2024  
**Lab Number** : 06234362      **Tested** : 12 Jul 2024  
**Unique Number** : 11123196      **Diagnosed** : 14 Jul 2024 - Don Baldrige  
**Test Package** : FLEET

**SUPERIOR MARINE**  
 201 KELLY LANE  
 CHESAPEAKE, OH  
 US 45619

Contact: DARRELL KEARNS  
 darrellkearns@superiormarineinc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: