




OIL ANALYSIS REPORT

Sample Rating Trend

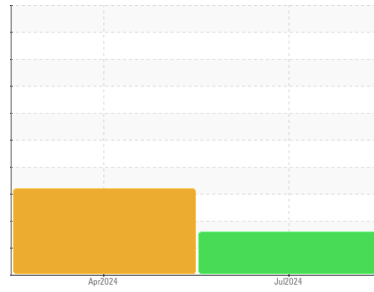

WATER



Machine Id
NTC/4PH2/GB

Component
Gearbox

Fluid
ROYAL PURPLE THERMYL-GLYDE 320 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0807538	WC0807541	---
Sample Date	Client Info		08 Jul 2024	18 Apr 2024	---
Machine Age	mths	Client Info	0	0	---
Oil Age	mths	Client Info	1	6	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	41	77
Chromium	ppm	ASTM D5185m	>15	<1	0
Nickel	ppm	ASTM D5185m	>15	0	0
Titanium	ppm	ASTM D5185m		2	5
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0
Lead	ppm	ASTM D5185m	>100	4	2
Copper	ppm	ASTM D5185m	>200	<1	0
Tin	ppm	ASTM D5185m	>25	0	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		<1	0
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		<1	0
Magnesium	ppm	ASTM D5185m		0	<1
Calcium	ppm	ASTM D5185m		54	0
Phosphorus	ppm	ASTM D5185m		139	239
Zinc	ppm	ASTM D5185m		0	3
Sulfur	ppm	ASTM D5185m		24433	6184

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	6	14
Sodium	ppm	ASTM D5185m		2	0
Potassium	ppm	ASTM D5185m	>20	<1	0
Water	%	ASTM D6304	>0.2	▲ 0.262	▲ 0.233
ppm Water	ppm	ASTM D6304	>2000	▲ 2620	▲ 2330






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5298	---	---
Particles >6µm	ASTM D7647	>5000	2886	---	---
Particles >14µm	ASTM D7647	>640	491	---	---
Particles >21µm	ASTM D7647	>160	165	---	---
Particles >38µm	ASTM D7647	>40	26	---	---
Particles >71µm	ASTM D7647	>10	3	---	---
Oil Cleanliness	ISO 4406 (c)	>--/19/16	20/19/16	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.25	0.38


OIL ANALYSIS REPORT

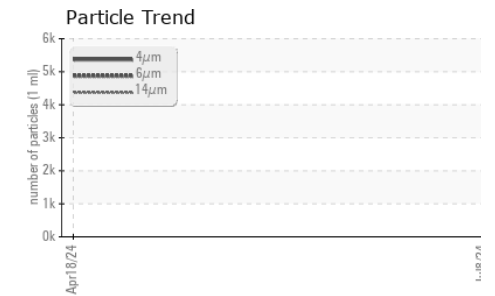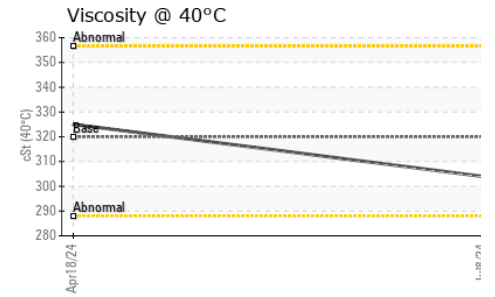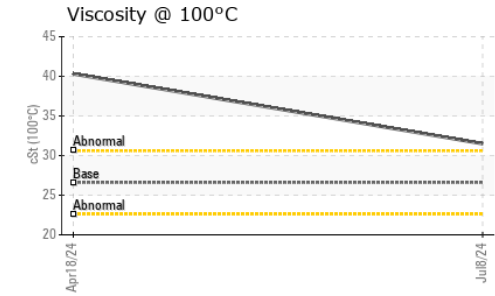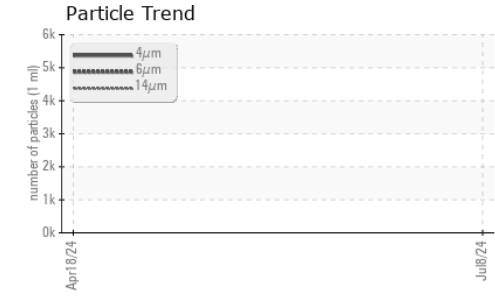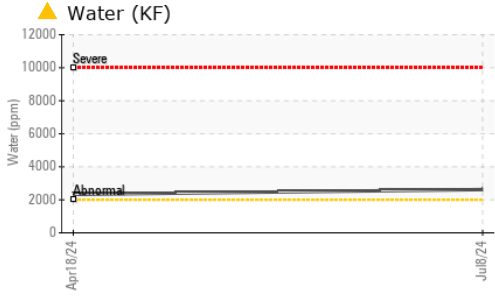






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ MODER	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	● HAZY	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	0.2%	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	304	325
Visc @ 100°C	cSt	ASTM D445	26.6	31.5	40.3
Viscosity Index (VI)	Scale	ASTM D2270	110	142	177

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

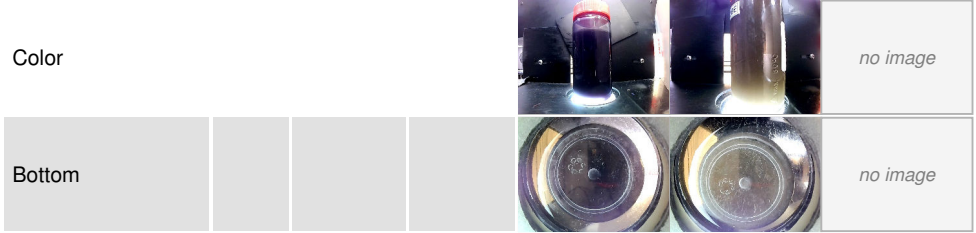

GRAPHS

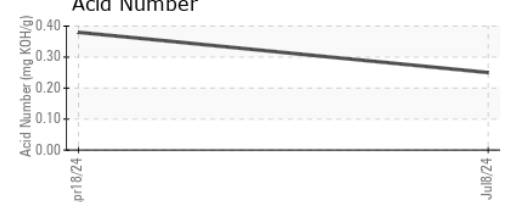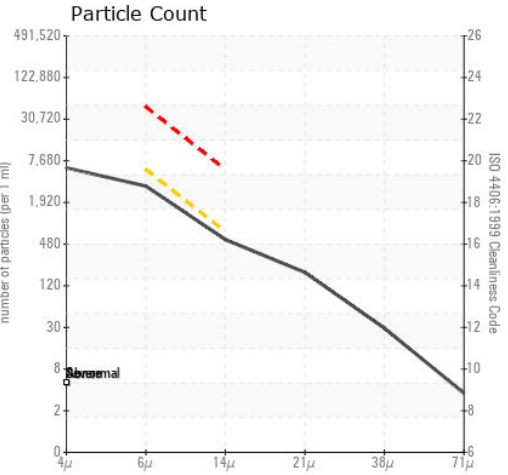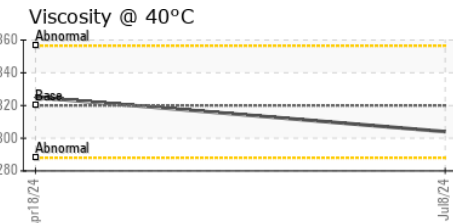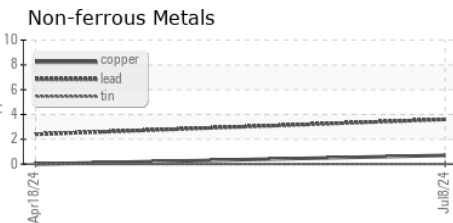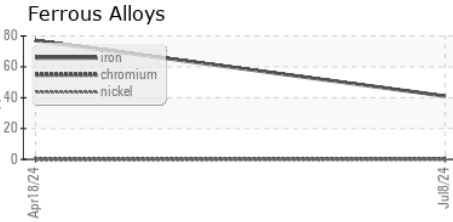

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807538 **Received** : 12 Jul 2024
Lab Number : 06234873 **Tested** : 18 Jul 2024
Unique Number : 11123707 **Diagnosed** : 18 Jul 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

J/POWER-BD
 JP
 Contact: KENTO OKUHARA
 Mitsuo_Miyahara@jpower.co.jp

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)