




# OIL ANALYSIS REPORT

Sample Rating Trend

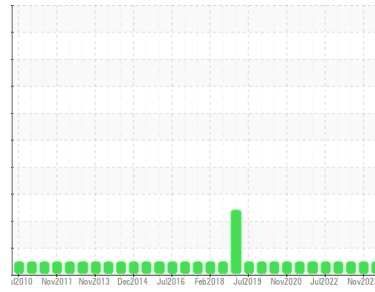

**NORMAL**



Machine Id  
**1WM/OG/JPBD**

Component  
**Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0932113</b>	WC0807391	WC0807266
Sample Date	Client Info		<b>18 Apr 2024</b>	06 Nov 2023	07 Apr 2023
Machine Age	mths	Client Info	<b>0</b>	0	70
Oil Age	mths	Client Info	<b>82</b>	77	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>10</b>	7	8
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >200	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	1	3
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 485	<b>422</b>	410	440
Zinc	ppm	ASTM D5185m 0	<b>35</b>	23	28
Sulfur	ppm	ASTM D5185m	<b>4893</b>	4461	5626

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>1</b>	1	1
Sodium	ppm	ASTM D5185m >15	<b>2</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	5

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>807</b>	1751	779
Particles >6µm	ASTM D7647	>5000	<b>187</b>	352	94
Particles >14µm	ASTM D7647	>640	<b>18</b>	13	7
Particles >21µm	ASTM D7647	>160	<b>5</b>	4	2
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>17/15/11</b>	18/16/11	17/14/10


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	<b>1.03</b>	1.03	1.11




# OIL ANALYSIS REPORT


Viscosity @ 100°C

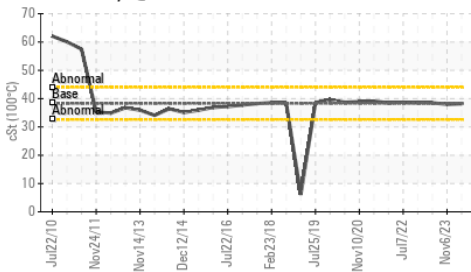


Particle Trend

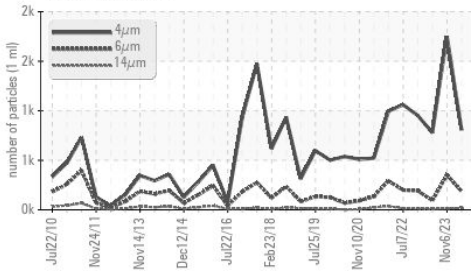


Viscosity @ 100°C

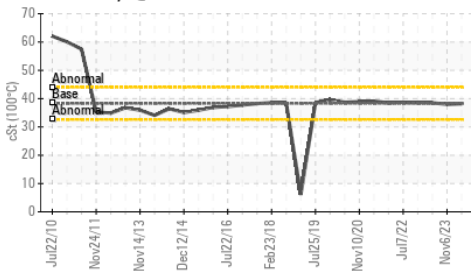

Viscosity @ 40°C

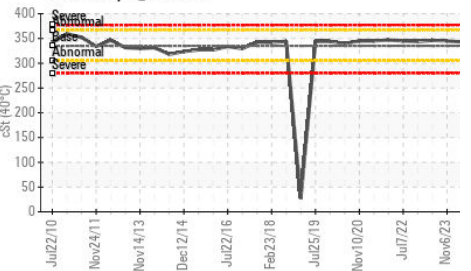

Particle Trend

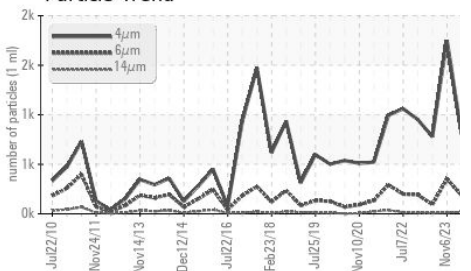


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	345	346
Visc @ 100°C	cSt	ASTM D445	38.3	38.0	38.5
Viscosity Index (VI)	Scale	ASTM D2270	164	159	161






SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

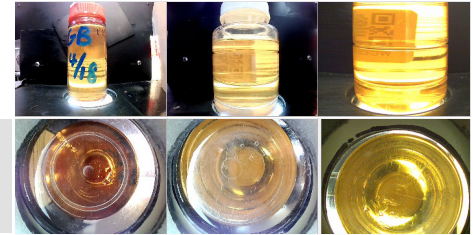

Bottom

## GRAPHS

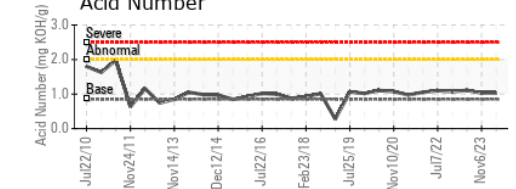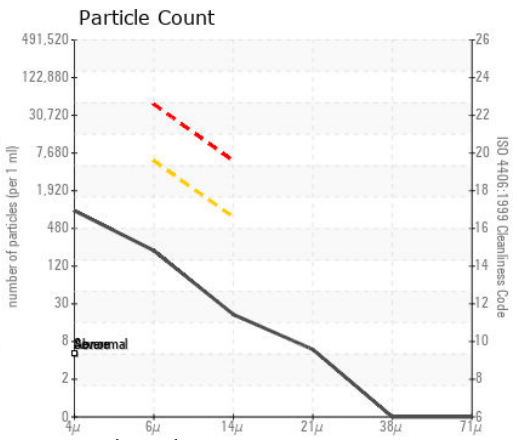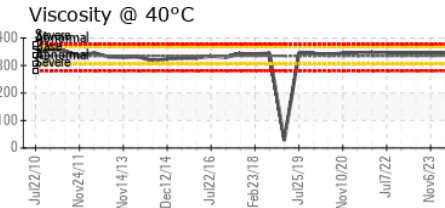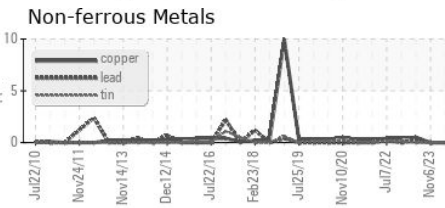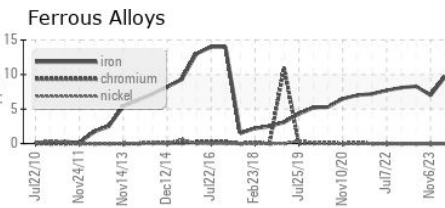

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0932113 Received : 12 Jul 2024  
 Lab Number : 06234877 Tested : 15 Jul 2024  
 Unique Number : 11123711 Diagnosed : 15 Jul 2024 - Don Baldrige  
 Test Package : PLANT ( Additional Tests: KV100, VI )

JPHYTEC

JP  
 Contact: Service

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: