

## **OIL ANALYSIS REPORT**

Sample Rating Trend



[73642111] **KAESER 8401727** Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

Area

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020779	KCPA003176	
Sample Date		Client Info		02 Jul 2024	05 Jun 2023	
Machine Age	hrs	Client Info		5222	2288	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	3	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	9	25	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	56	71	
Calcium	ppm		0	<1	<1	
Phosphorus	ppm	ASTM D5185m	0	2	<1	
Zinc	ppm		0	4	6	
Sulfur	ppm	ASTM D5185m	23500	19960	21029	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		10	10	
Potassium	ppm	ASTM D5185m	>20	4	7	
Water	%	ASTM D6304	>0.05	0.016		
ppm Water	ppm	ASTM D6304	>500	170		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
FLUID CLEANLIN Particles >4µm	ESS	method ASTM D7647	limit/base		history1 7294	history2
	ESS			current		history2 
Particles >4µm	ESS	ASTM D7647		current 12010	7294	history2
Particles >4μm Particles >6μm	ESS	ASTM D7647 ASTM D7647	>1300	current 12010 ▲ 4307	7294 <b>2</b> 733	history2
Particles >4μm Particles >6μm Particles >14μm	ESS	ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80	current 12010 ▲ 4307 ▲ 280	7294 2733 130	
Particles >4μm Particles >6μm Particles >14μm Particles >21μm	ESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80 >20 >4	current     12010     ▲ 4307     ▲ 280     ▲ 52	7294 2733 130 29	
Particles >4µm Particles >6µm Particles >14µm Particles >21µm Particles >38µm	ESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80 >20 >4	current   12010   ▲ 4307   ▲ 280   ▲ 52   2	7294 ▲ 2733 ▲ 130 ▲ 29 2	
Particles >4µm Particles >6µm Particles >14µm Particles >21µm Particles >38µm Particles >71µm		ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>1300 >80 >20 >4 >3	current   12010   ▲ 4307   ▲ 280   ▲ 52   2   0	7294 ▲ 2733 ▲ 130 ▲ 29 2 0	


Contact/Location: MG WOODWORK ? - MGWSAN Page 1 of 2




# **OIL ANALYSIS REPORT**





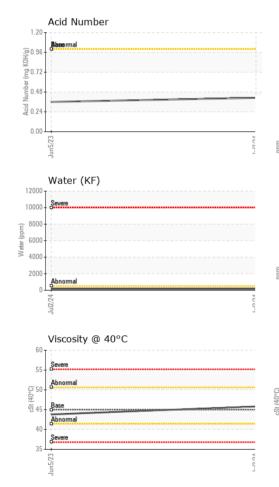

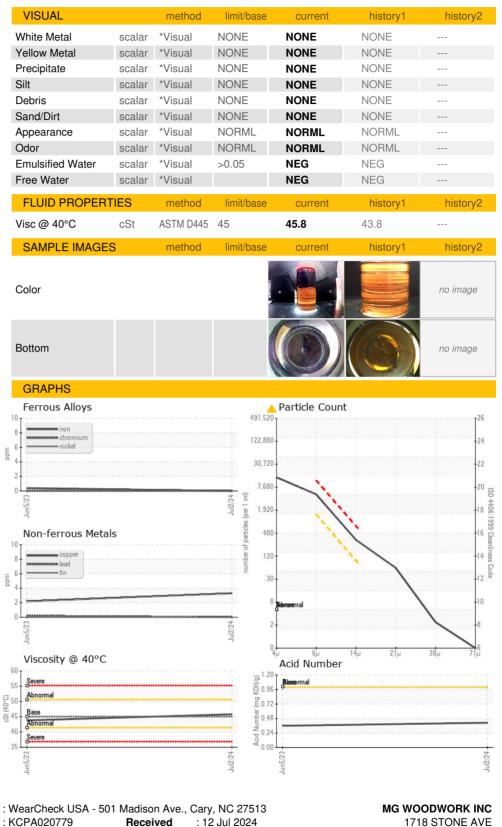



Sample No. : KCPA020779 Received : 12 Jul 2024 Lab Number Tested : 15 Jul 2024 SAN JOSE, CA : 06234903 : 15 Jul 2024 - Don Baldridge Unique Number : 11123737 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: MG WOODWORK Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. mgwoodwork@att.net \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: MGWSAN [WUSCAR] 06234903 (Generated: 07/15/2024 14:23:15) Rev: 1

Laboratory

Contact/Location: MG WOODWORK ? - MGWSAN

US 95125

T:

F: