




# OIL ANALYSIS REPORT

Sample Rating Trend

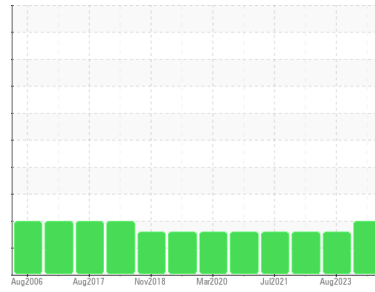

ISO



Machine Id  
**KAESER SM-11 2217766 (S/N 1276)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA019281</b>	KCPA004447	KCP42013
Sample Date	Client Info			<b>27 Jun 2024</b>	07 Aug 2023	02 Mar 2022
Machine Age	hrs	Client Info		<b>56818</b>	54565	50898
Oil Age	hrs	Client Info		<b>2253</b>	0	1447
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	5	7
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	100	<b>18</b>	7	31
Calcium	ppm	ASTM D5185m	0	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>2</b>	4	0
Zinc	ppm	ASTM D5185m	0	<b>8</b>	6	11
Sulfur	ppm	ASTM D5185m	23500	<b>20044</b>	21536	18471

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>4</b>	1	6
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	2
Water	%	ASTM D6304	>0.05	<b>0.015</b>	0.009	0.008
ppm Water	ppm	ASTM D6304	>500	<b>154</b>	95.1	82.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>10192</b>	3865	42310
Particles >6µm		ASTM D7647	>1300	<b>▲ 4756</b>	● 1425	▲ 16142
Particles >14µm		ASTM D7647	>80	<b>▲ 853</b>	▲ 218	▲ 1388
Particles >21µm		ASTM D7647	>20	<b>▲ 256</b>	▲ 67	▲ 210
Particles >38µm		ASTM D7647	>4	<b>▲ 7</b>	2	▲ 11
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 21/19/17</b>	▲ 19/18/15	▲ 21/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.39</b>	0.45	0.46


# OIL ANALYSIS REPORT

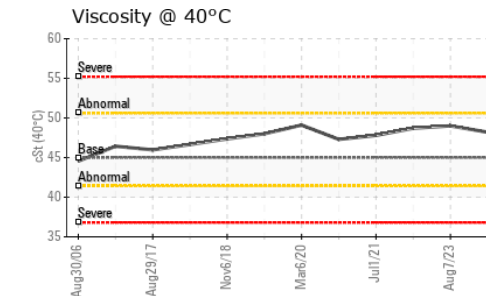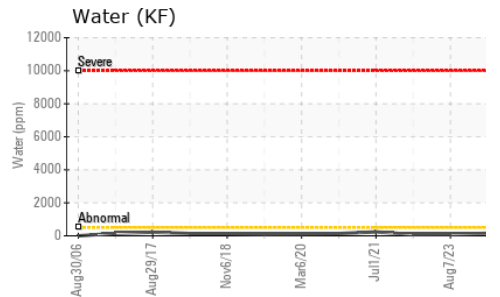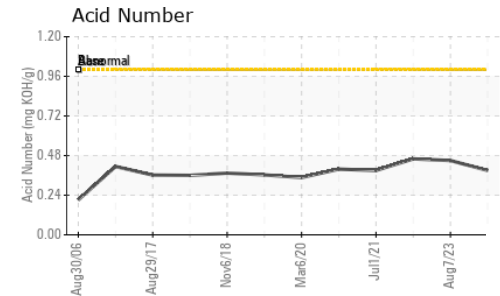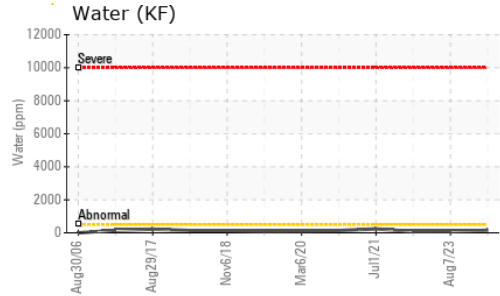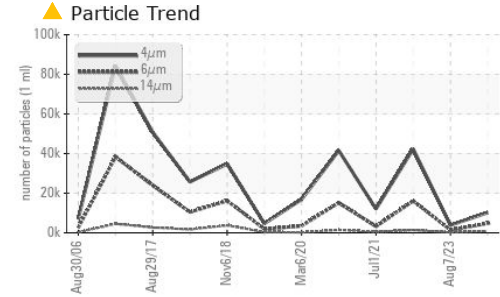






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.2	49.0	48.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

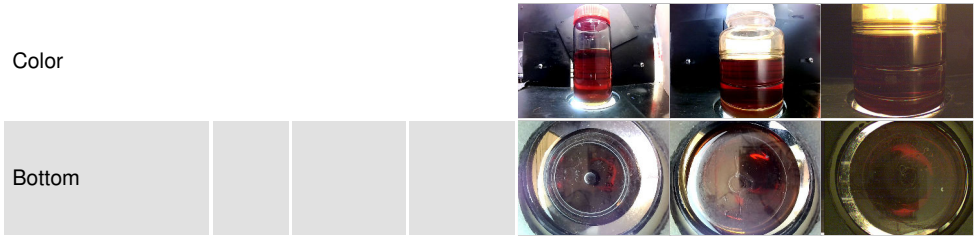

## GRAPHS

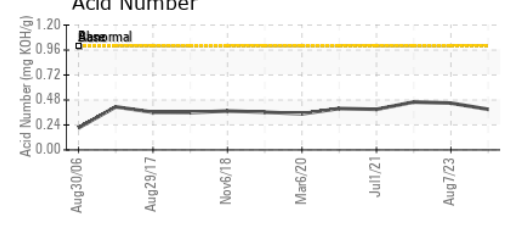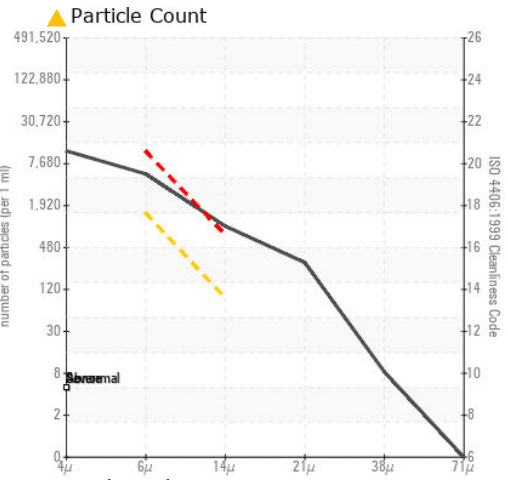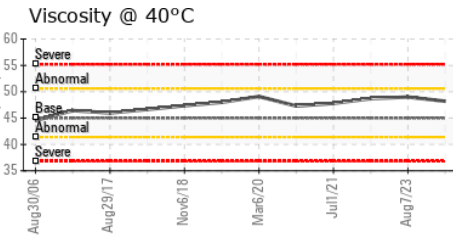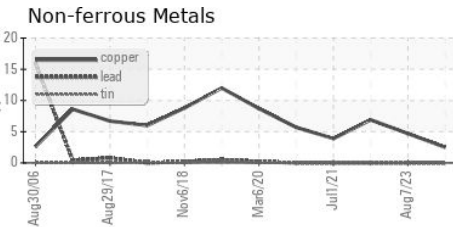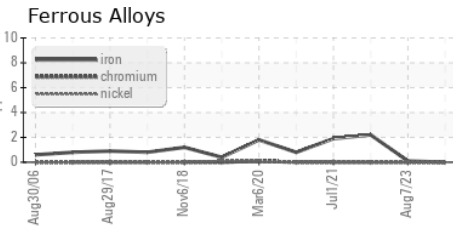

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA019281 **Received** : 12 Jul 2024  
**Lab Number** : 06234905 **Tested** : 15 Jul 2024  
**Unique Number** : 11123739 **Diagnosed** : 15 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**SEVEN CYCLES**  
 125 WALNUT ST. ENTRANCE B  
 WATERTOWN, MA  
 US 02472  
 Contact: SKIP BROWN  
 skip.brown@sevencycles.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)