




# OIL ANALYSIS REPORT

Sample Rating Trend

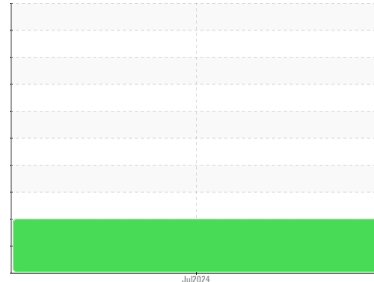

**WATER**



Machine Id

**KAESER 9112975**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA020729</b>	---	---
Sample Date	Client Info		<b>09 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>1147</b>	---	---
Oil Age	hrs	Client Info	<b>1147</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>3</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 90	<b>30</b>	---	---
Calcium	ppm	ASTM D5185m 2	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>20</b>	---	---
Zinc	ppm	ASTM D5185m	<b>15</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>19395</b>	---	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>8</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---
Water	%	ASTM D6304 >0.05	<b>▲ 0.240</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>▲ 2400</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.30</b>	---	---

# OIL ANALYSIS REPORT

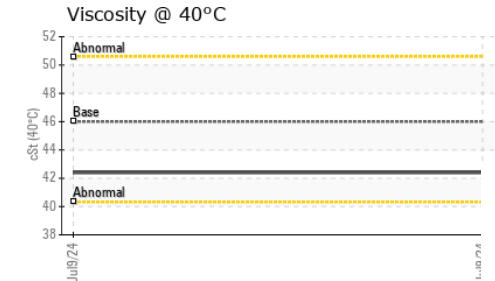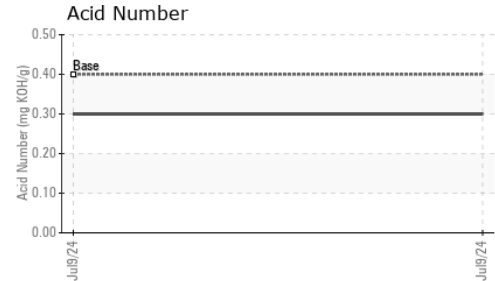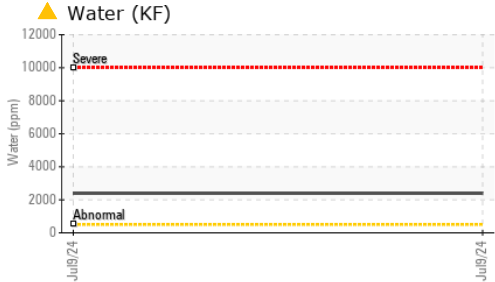





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>▲ MODER</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>▲ 0.2%</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>42.4</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

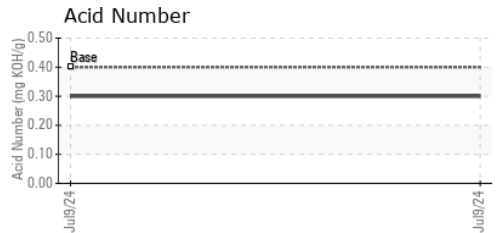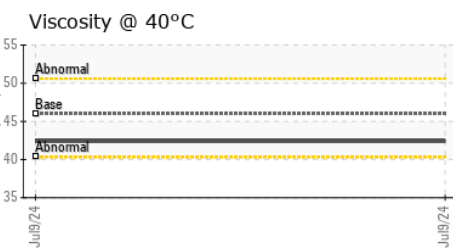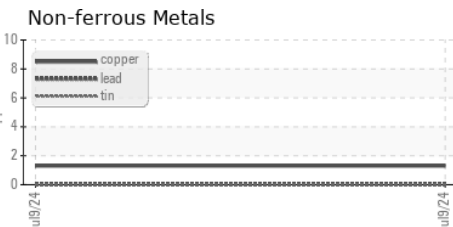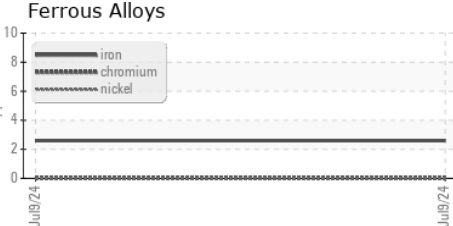

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA020729  
**Lab Number** : **06234911**  
**Unique Number** : 11123745  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 12 Jul 2024  
**Tested** : 15 Jul 2024  
**Diagnosed** : 15 Jul 2024 - Don Baldrige

**AMAZON.COM SERVICES LLC DLI6**  
 6201 AVIATOR DR  
 HAZELWOOD, MO  
 US 63042  
 Contact: AGGRAYDE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: