




# OIL ANALYSIS REPORT

Sample Rating Trend

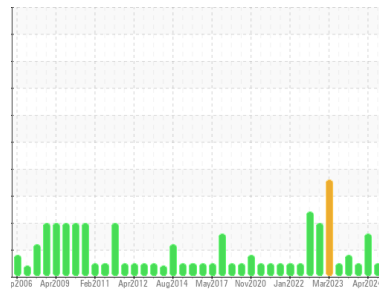

**NORMAL**



Machine Id

**058CM12010**

Component

**Turbine**

Fluid

**ROYAL PURPLE SYNFILM GT 32 (500 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0041034</b>	RP0020490	RP0028192
Sample Date	Client Info		<b>11 Jul 2024</b>	09 Apr 2024	21 Jan 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	2
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>58</b>	68	81
Calcium	ppm	ASTM D5185m	<b>2</b>	5	3
Phosphorus	ppm	ASTM D5185m	<b>64</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.03	<b>0.011</b>	0.012	0.006
ppm Water	ppm	ASTM D6304 >300	<b>112</b>	121	66






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2125</b>	58125	1090
Particles >6µm	ASTM D7647	>1300	<b>550</b>	▲ 18751	299
Particles >14µm	ASTM D7647	>160	<b>76</b>	▲ 1375	35
Particles >21µm	ASTM D7647	>40	<b>25</b>	▲ 315	12
Particles >38µm	ASTM D7647	>10	<b>3</b>	8	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	<b>18/16/13</b>	▲ 23/21/18	17/15/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.34</b>	0.35	0.35

# OIL ANALYSIS REPORT

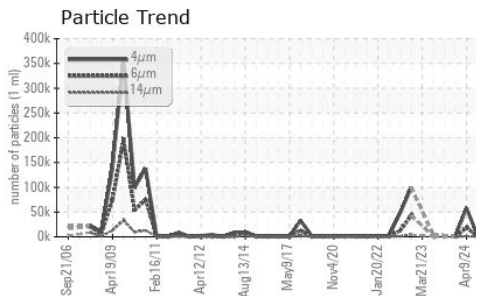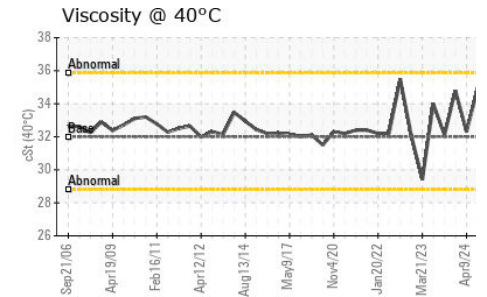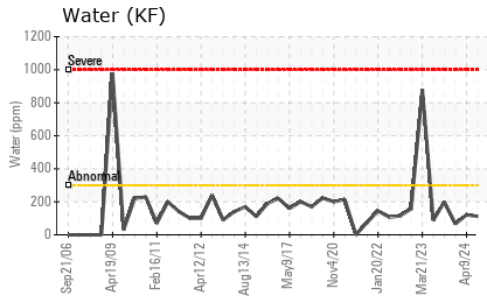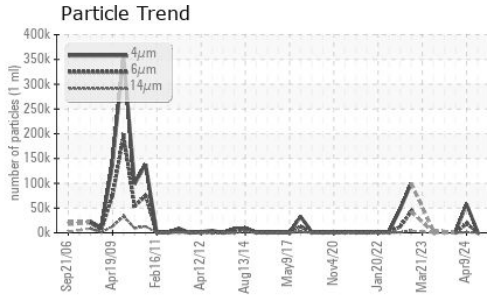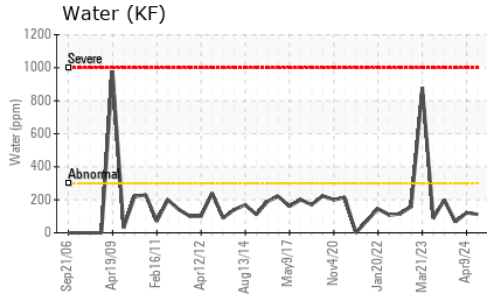






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	34.9	32.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

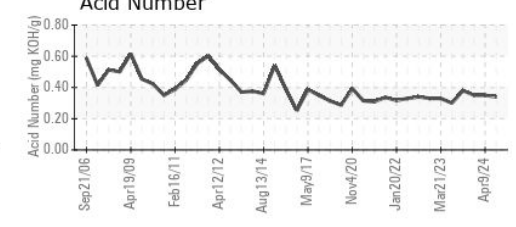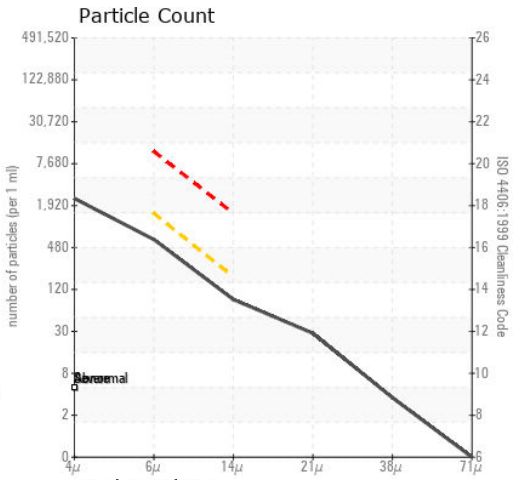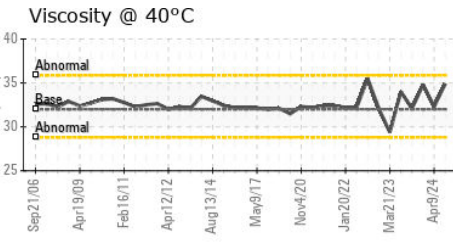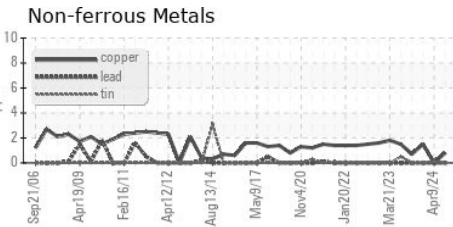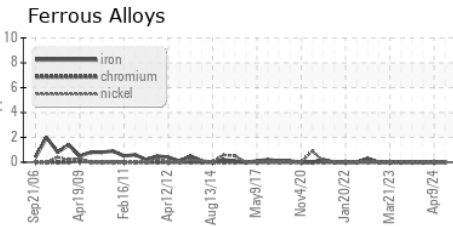

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0041034 **Received** : 12 Jul 2024  
**Lab Number** : 06234929 **Tested** : 15 Jul 2024  
**Unique Number** : 11123763 **Diagnosed** : 15 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**ENTERPRISE PRODUCTS**  
P.O. BOX 573  
MONT BELVIEU, TX  
US 77580  
Contact: TOMMY EDWARDS  
tedwards@eprod.com  
T: (281)217-1411  
F: (281)385-4327

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)