




OIL ANALYSIS REPORT

Sample Rating Trend

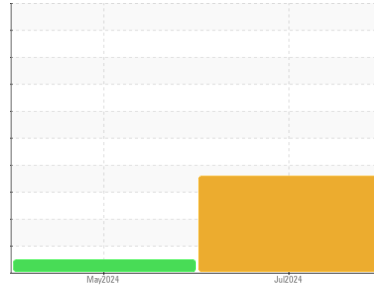

WATER



Area
MISSION RANCHO
 Machine Id
MISSION RANCHO C1
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #13 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			USP0012279	USP0011523	---
Sample Date	Client Info			11 Jul 2024	08 May 2024	---
Machine Age	hrs	Client Info		59465	54291	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	4	3	---
Chromium	ppm	ASTM D5185m	>2	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	<1	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>3	<1	0	---
Lead	ppm	ASTM D5185m	>2	0	0	---
Copper	ppm	ASTM D5185m	>8	0	<1	---
Tin	ppm	ASTM D5185m	>4	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m		0	0	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		0	10	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	8	5	---
Sodium	ppm	ASTM D5185m		0	<1	---
Potassium	ppm	ASTM D5185m	>20	<1	2	---
Water	%	ASTM D6304	>0.01	▲ 0.049	---	---
ppm Water	ppm	ASTM D6304	>100	▲ 494	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ 44938	---	---
Particles >6µm		ASTM D7647	>320	▲ 12295	---	---
Particles >14µm		ASTM D7647	>80	▲ 409	---	---
Particles >21µm		ASTM D7647	>20	▲ 60	---	---
Particles >38µm		ASTM D7647	>4	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/15/13	▲ 23/21/16	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014	---	---




OIL ANALYSIS REPORT

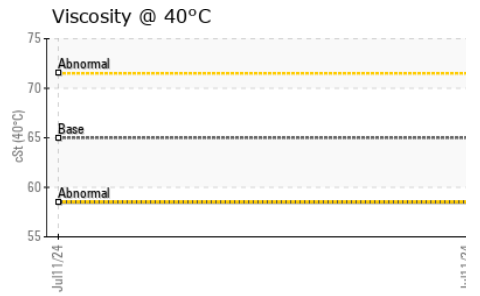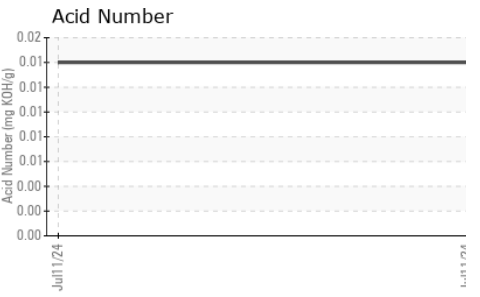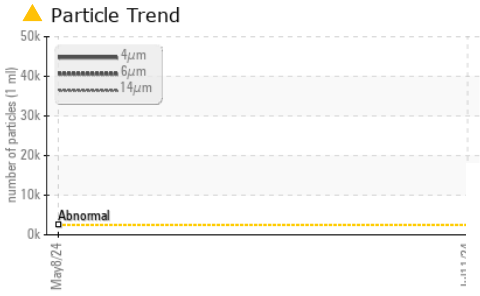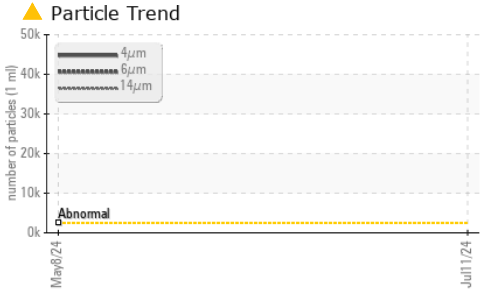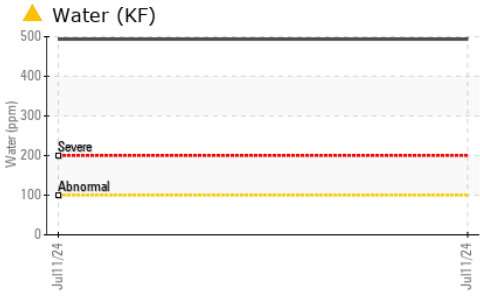






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.0	58.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

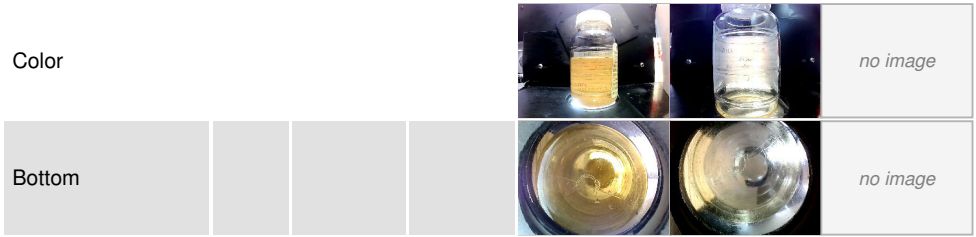

GRAPHS

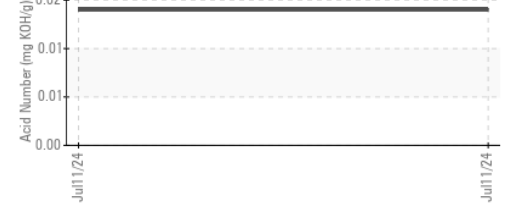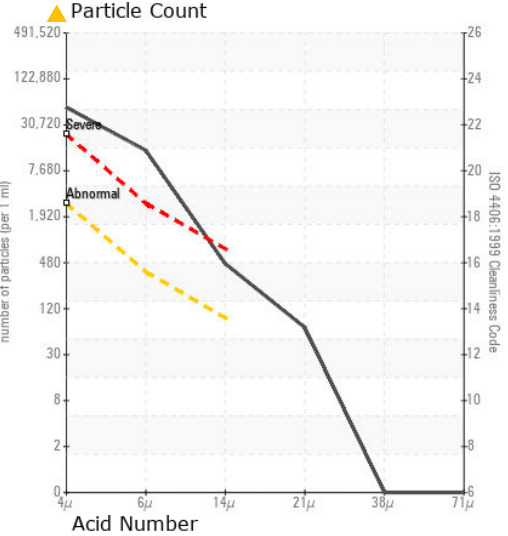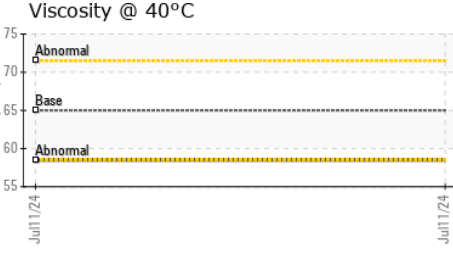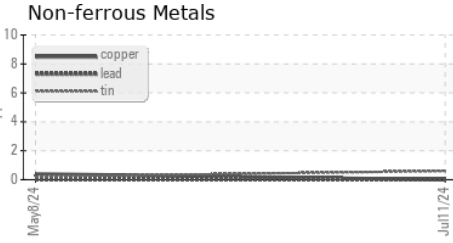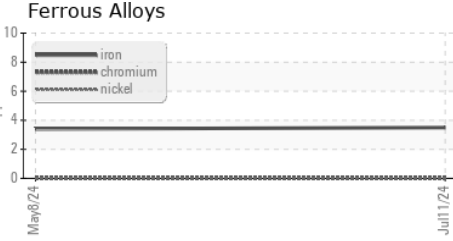

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0012279 **Received** : 12 Jul 2024
Lab Number : 06234994 **Tested** : 15 Jul 2024
Unique Number : 11123828 **Diagnosed** : 15 Jul 2024 - Doug Bogart
Test Package : IND 2

RACE ENGINEERING CORP
 12871 WESTERN AVE, SUITE E
 GARDEN GROVE, CA 92841
 Contact: TODD CARTER
 ttrace@verizon.net
 T: (714)895-3488
 F: (714)895-5125

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)