


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

LSS SC1 (S/N 1183)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Aug2021	Apr2022 Oct2022	Aprž023 Sep2023 Aj	or 2 024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012266	USP0006499	USP0004829
Sample Date		Client Info		11 Jul 2024	21 Apr 2024	16 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	0
Chromium	ppm	ASTM D5185m	>2	0	<1	<1
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	2	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	0
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>0.01	0.001	0.00	0.002
ppm Water	ppm	ASTM D6304	>100	8	0	16
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	534	180	716
Particles >6µm		ASTM D7647	>2500	146	67	116
Particles >14µm		ASTM D7647	>640	8	8	12
Particles >21µm		ASTM D7647	>160	1	2	4
Particles >38µm		ASTM D7647	>40	0	0	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	16/14/10	15/13/10	17/14/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.014





OIL ANALYSIS REPORT



	cle Tren	a				
20k (m 15k - Albour 15k - Albour 5k - Albour 15k - Albour	4μm 14μm 14μm					
ok Ok						
Aug13/21	Apr27/22	Oct13/22 -	Apr10/23	Sep 20/23	Apr21/24	







VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2

FLUID PROPER	711ES	method			riistory i	riistoryz
Visc @ 40°C	cSt	ASTM D445	67	65.4	67.5	66.8


CANADIE	IN A A OFFICE
SAMPLE	IMAGES

Color

Bottom





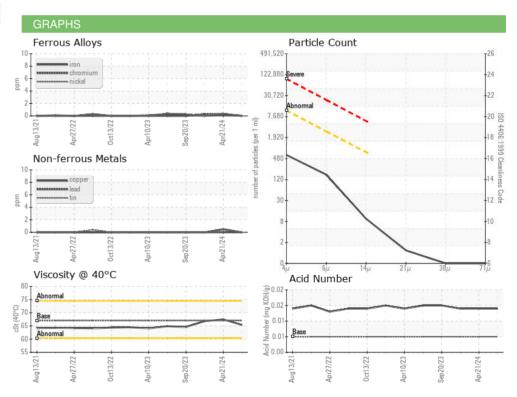





Certificate 12367

Laboratory Sample No.

: USP0012266 Lab Number : 06235001 Unique Number : 11123835 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 12 Jul 2024 **Tested** : 15 Jul 2024 Diagnosed

: 15 Jul 2024 - Doug Bogart

KraftHeinz - Cedar Rapids - Plant 8370

4601 C ST SW CEDAR RAPIDS, IA US 52404

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: