


OIL ANALYSIS REPORT

Sample Rating Trend

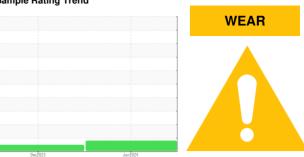

Machine Id

FRICK B4 (S/N 10241B90249336)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base		la i a ta mud	history O
	IATION		ilmit/base	current	history1	history2
Sample Number		Client Info		WC0933209	WC0878475	
Sample Date		Client Info		04 Jun 2024	21 Dec 2023	
Machine Age	hrs	Client Info		19739	17540	
Oil Age	hrs	Client Info		0	17542	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<u> </u>	6	
Chromium	ppm	ASTM D5185m	>2	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>3	<1	0	
Lead	ppm	ASTM D5185m	>2	0	0	
Copper	ppm	ASTM D5185m	>8	0	0	
Tin	ppm	ASTM D5185m	>4	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		0	0	
Phosphorus	ppm	ASTM D5185m		0	0	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		4	26	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.01	0.001	0.001	
ppm Water	ppm	ASTM D6304	>100	14	14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.014


Acid Number (AN)

mg KOH/g ASTM D974

0.014



OIL ANALYSIS REPORT

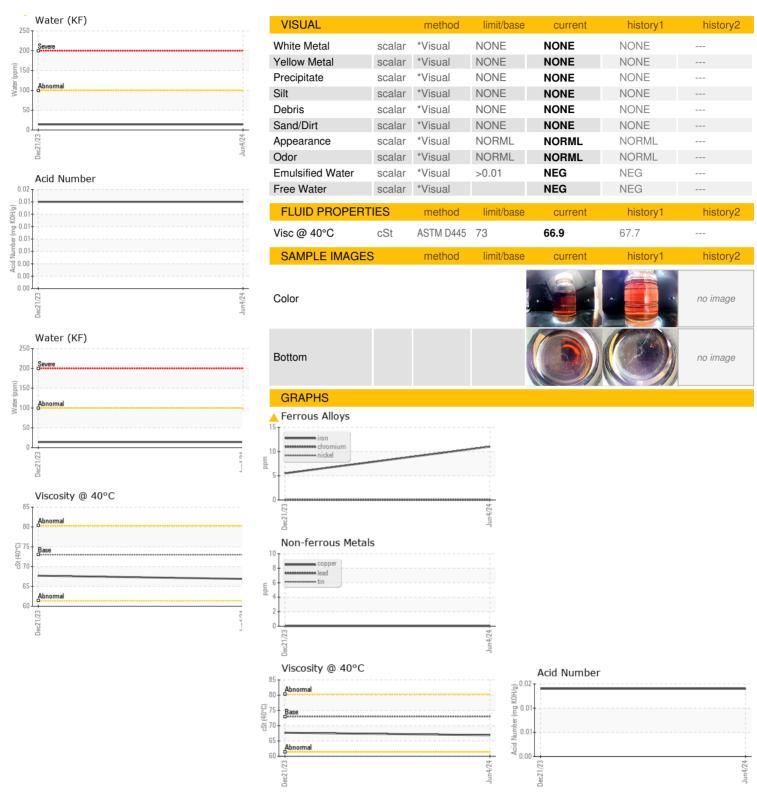





Certificate 12367

Sample No.

Laboratory Lab Number : 06235038 Unique Number : 11123872 Test Package : IND 2

: WC0933209

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 12 Jul 2024 **Tested** : 15 Jul 2024

Diagnosed : 15 Jul 2024 - Don Baldridge

US 60403 Contact: Service Manager

RICH PRODUCTS

CRESTHILL, IL

31511 DIVISION ST

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: RICCRE [WUSCAR] 06235038 (Generated: 07/15/2024 15:13:05) Rev: 1

Contact/Location: Service Manager - RICCRE

T:

F: