


OIL ANALYSIS REPORT

9200 COOLING TOWER **COOLING TOWER FAN A (B9201A)**

Gearbox

HPL COMPRESSOR LIFE 220 (14 GAL)





Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0961009		
Sample Date		Client Info		08 Jul 2024		
Machine Age	yrs	Client Info		1		
Oil Age	yrs	Client Info		1		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		20		
Iron	ppm	ASTM D5185m	>200	2		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>100	0		
Copper	ppm	ASTM D5185m	>200	2		
Tin	ppm	ASTM D5185m	>25	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		145		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		23676		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.27		



OIL ANALYSIS REPORT

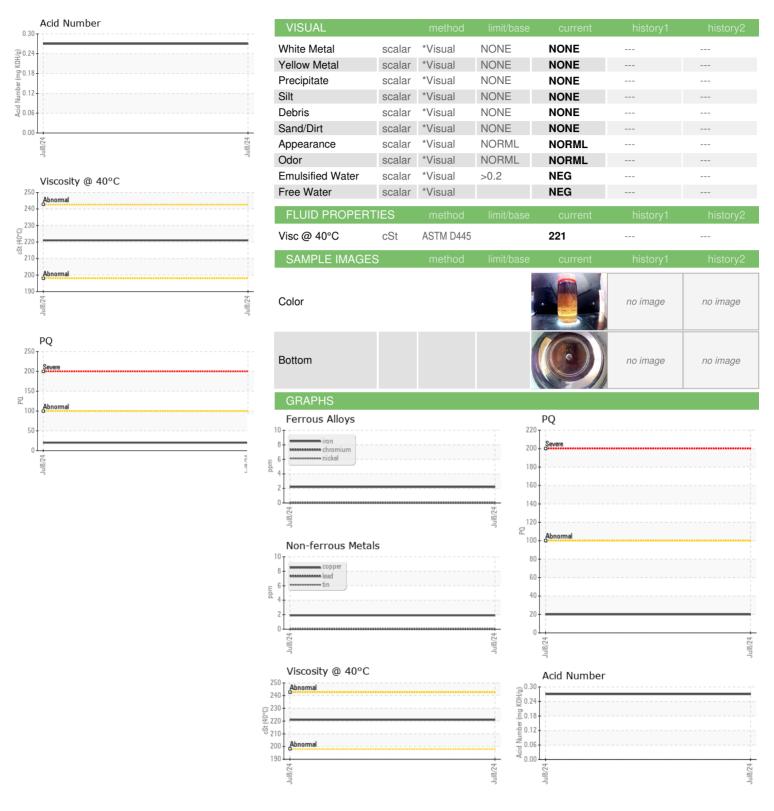





Laboratory Sample No.

: WC0961009 Lab Number : 06235083 Unique Number : 11123917

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 12 Jul 2024

Tested : 15 Jul 2024 Diagnosed : 15 Jul 2024 - Don Baldridge

Test Package : PLANT Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US NITROGEN-AUSTIN POWDER

471 POTTERTOWN RD MIDWAY, TN

US 37809 Contact: HARRY DALLIS

harry.dallis@austinpowder.com

T: (423)612-7903